

# 8B0C0160HC00.000-1

## 1 General information

- Extensive protective measures

## 2 Order data

Model number	Short description	Figure
	<b>Cold plate or feed-through mounting</b>	
8B0C0160HC00.000-1	ACOPOSmulti auxiliary supply module 16 A, HV, cold plate or feed-through mounting	
	<b>Required accessories</b>	
	<b>Terminal block sets</b>	
8BZ0C032000.000-1A	Screw clamp set for ACOPOSmulti 8B0C0xx0Hx00.000-1 modules: 1x 8TB2106.2010-00	
	<b>Optional accessories</b>	
	<b>Fan modules</b>	
8BXF001.0000-00	ACOPOSmulti fan module, replacement fan for ACOPOSmulti modules (8BxP/8B0C/8BVI/8BVE/8B0K)	
	<b>Terminal blocks</b>	
8TB2106.2010-00	6-pin screw clamp, single row, spacing: 5.08 mm, label 1: numbered serially	
8TB2106.2210-00	Push-in terminal block 6-pin, 1-row, spacing: 5.08 mm, label 1: numbered consecutively	

Table 1: 8B0C0160HC00.000-1 - Order data

## 3 Technical data

Model number	8B0C0160HC00.000-1
<b>General information</b>	
Cooling and mounting method	Cold plate or feed-through mounting
Certifications	
CE	Yes
KC	Yes
UL	cULus E225616 Power conversion equipment
<b>DC bus connection</b>	
Voltage	
Nominal	750 VDC
Operating range in continuous operation	260 to 800 VDC
Full continuous power	315 to 800 VDC
Continuous power consumption	Max. 445 W
Power dissipation with continuous power <sup>1)</sup>	22 W (0% continuous power) 27 W (50% continuous power) 45 W (100% continuous power)
DC bus capacitance	220 nF
Design	ACOPOSmulti backplane
<b>24 VDC output</b>	
Continuous power <sup>2)</sup>	400 W
Output voltage	
DC bus voltage (U <sub>DC</sub> ): 260 to 315 VDC	25 VDC * (U <sub>DC</sub> / 315)
DC bus voltage (U <sub>DC</sub> ): 315 to 800 VDC	24 VDC ±6%
Continuous current	16 ADC
Reduction of continuous power at ambient temperatures starting at 40°C	No reduction
Reduction of continuous power depending on installation elevation	
Starting at 500 m above sea level	40 W per 1000 m
Reduction of continuous power depending on cooling method	No reduction
Startup delay	Max. 1 s
Startup time	Approx. 5 to 20 ms
Residual ripple	Typ. 50 mV <sub>SS</sub>

Table 2: 8B0C0160HC00.000-1 - Technical data

Model number	8B0C0160HC00.000-1
<b>24 VDC internal system voltage supply</b>	
Output voltage <sup>3)</sup>	25 VDC ±1.6%
Peak current (<4 s)	
DC bus voltage (U <sub>DC</sub> ): 350 to 800 VDC	21 ADC
<b>Protective measures</b>	
Open circuit protection	Yes
Overload protection	Yes
Short circuit protection	Yes
Feedback protection	Max. 26 VDC (also when switched off)
Overtemperature protection	Yes
Dielectric strength to ground	±50 VDC
Output/Input isolation	SELV/PELV requirements
Design	ACOPOSmulti backplane
<b>Operating conditions</b>	
Permissible mounting orientations	
Hanging vertically	Yes
Lying horizontally	Yes
Standing horizontally	No
Installation at elevations above sea level	
Nominal	0 to 500 m
Maximum <sup>4)</sup>	4000 m
Pollution degree per EN 61800-5-1	2 (non-conductive pollution)
Overvoltage category per EN 61800-5-1	III
Degree of protection per EN 60529	IP20
<b>Environmental conditions</b>	
Temperature	
Operation	
Nominal	5 to 40°C
Maximum	55°C
Storage	-25 to 55°C
Transport	-25 to 70°C
Relative humidity	
Operation	5 to 85%
Storage	5 to 95%
Transport	Max. 95% at 40°C
<b>Mechanical characteristics</b>	
Dimensions <sup>5)</sup>	
Width	53 mm
Height	317 mm
Depth	
Cold plate	212 mm
Feed-through mounting	209 mm
Weight	Approx. 2.5 kg
Module width	1

Table 2: 8B0C0160HC00.000-1 - Technical data

- 1) Continuous power on the 24 VDC output
- 2) Valid under the following conditions: 750 VDC DC bus voltage, 55°C ambient temperature, installation elevation <500 m above sea level, no derating due to cooling type.
- 3) The output voltage is limited to max. 60 VDC in the event of error.
- 4) Continuous operation at an installation elevation of 500 m to 4,000 m above sea level is possible taking the specified reduction of continuous power into account. Requirements that go beyond this must be arranged with B&R.
- 5) These dimensions refer to the actual device dimensions including the respective mounting plate. Make sure to leave additional space above and below the devices for mounting, connections and air circulation.

## 4 Status indicators

Status indicators are located on the black cover of each module.

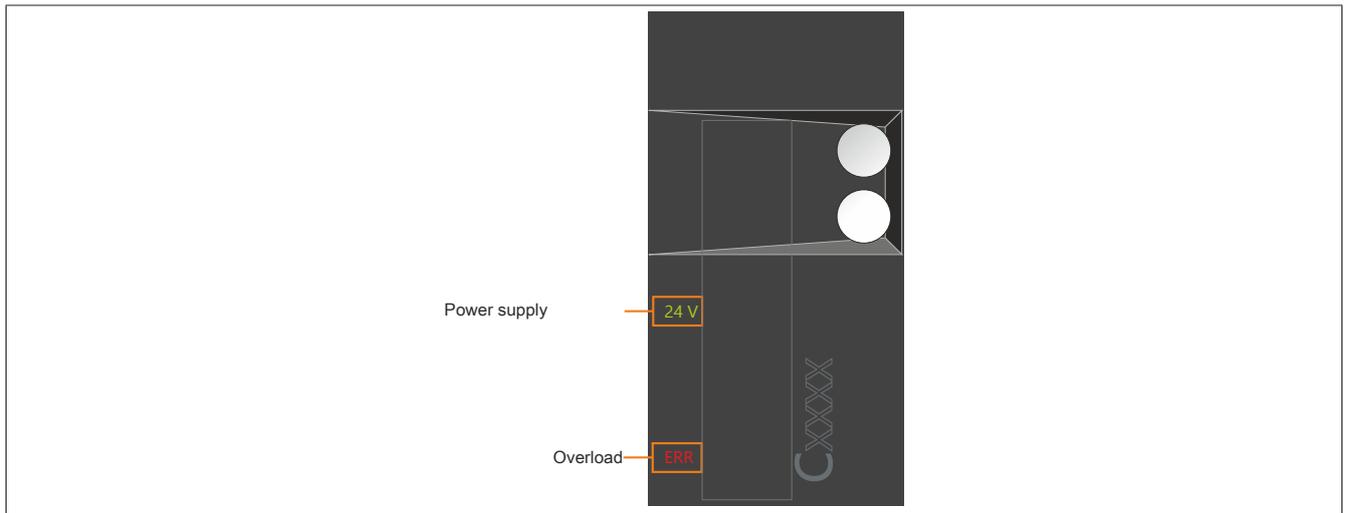


Figure 1: Auxiliary supply modules (8B0C0xx0Hx00.000-1) - Status indicator groups

### 4.1 Auxiliary supply modules - LED status indicators


Status indicator group	Label	Color	Function	Description
Power supply	24 V	Green	24 V OK	The 24 VDC internal system power supply is within the permissible tolerance.
Overload	ERR	Red	Overload	The module is not supplied via the DC bus. <sup>1)</sup> The 24 VDC internal system power supply is outside of the permissible tolerance (overload, overtemperature, short circuit, etc.).

Table 3: 8B0C auxiliary supply modules - LED status indicators

1) The module is enabled via input CR\_OK, no electrical contact to the backplane module - check the lower mounting screw.

## 5 Dimension diagram and installation dimensions

### 5.1 Cold plate

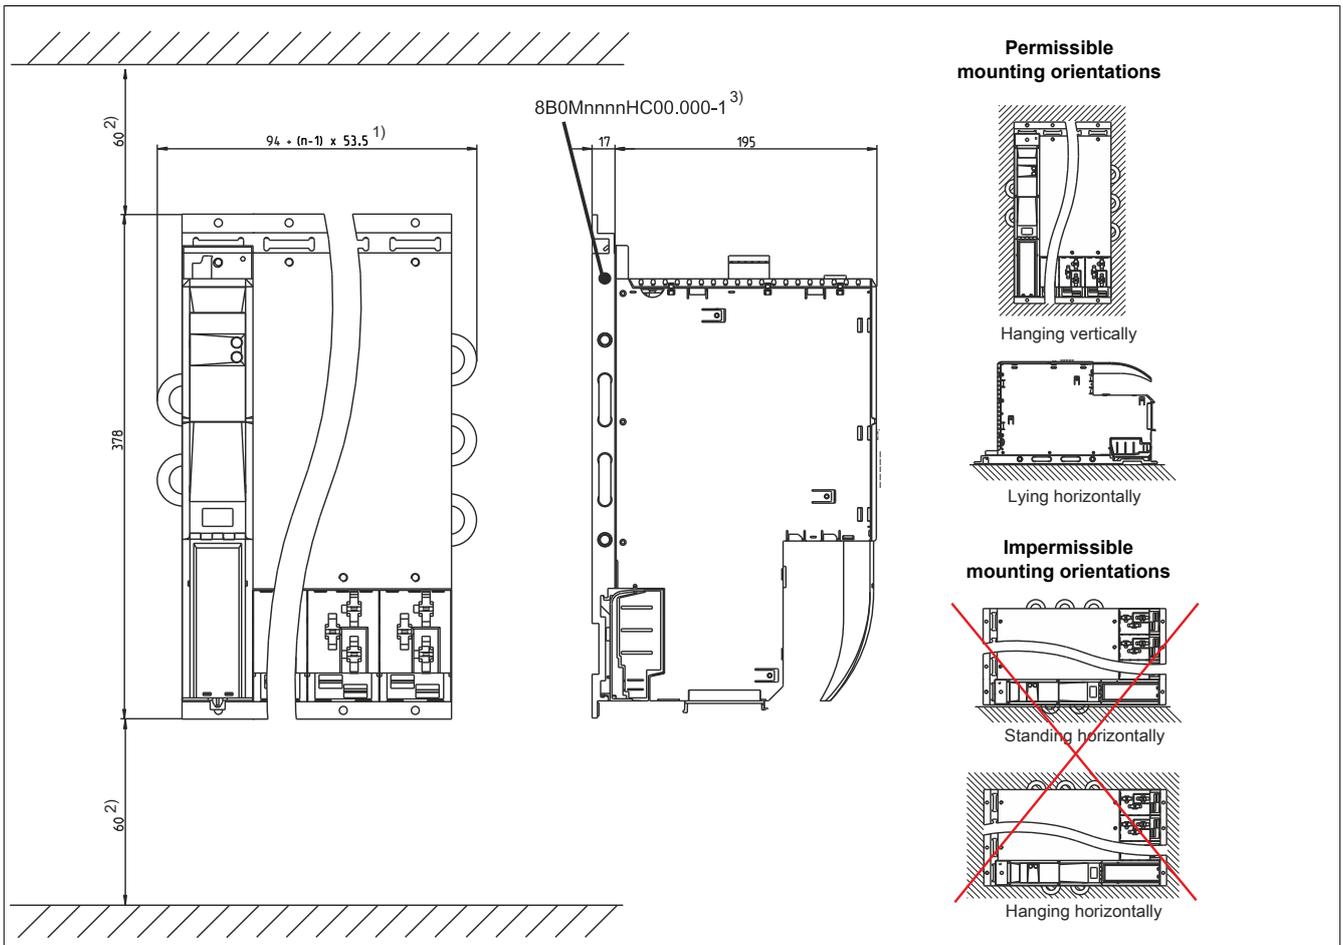

- 1) n... Number of width units on the mounting plate
- 2) For sufficient air circulation, a clearance of at least 60 mm must be provided above the mounting plate and below the module.
- 3) nnnn indicates the number of slots (e.g. 0160 refers to 16 slots).

### Information:

**When mounting ACOPOSmulti modules for cold-plate or feed-through mounting, be sure not to scratch the backplane. This can impair thermal dissipation to the mounting plate.**

**Do not set down ACOPOSmulti modules for cold-plate or feed-through mounting on their bottom side. Doing so could break the clips that hold the unit is fan. Broken clips make it more difficult to replace the fans later on.**

## 5.2 Feed-through mounting

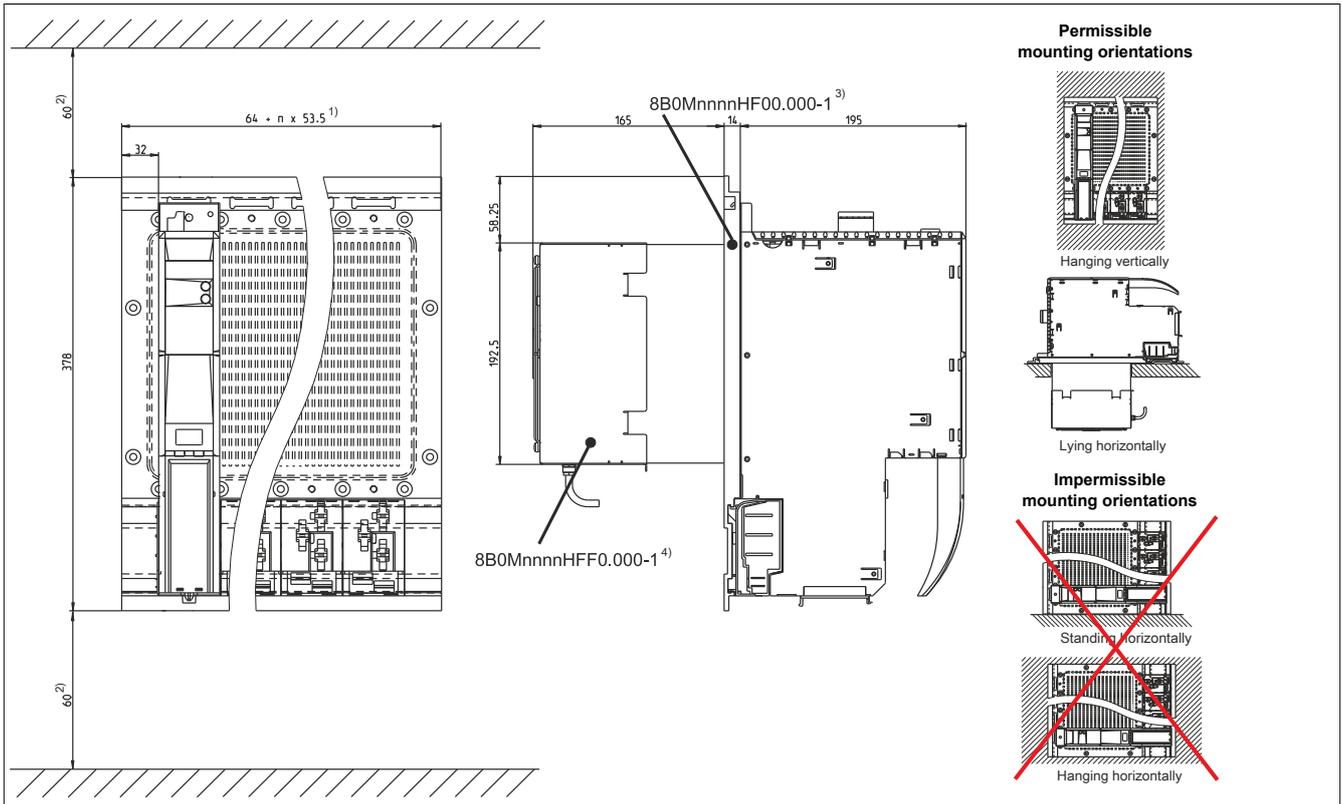


Figure 3: Feed-through mounting - Dimension diagram and installation dimensions

- 1) n... Number of width units on the mounting plate
- 2) For sufficient air circulation, a clearance of at least 60 mm must be provided above the mounting plate and below the module.
- 3) nnnn indicates the number of slots (e.g. 0160 refers to 16 slots).
- 4) For sufficient air circulation, a clearance of at least 100 mm must be provided around the fan module.

### Information:

**When mounting ACOPOSmulti modules for cold-plate or feed-through mounting, be sure not to scratch the backplane. This can impair thermal dissipation to the mounting plate.**

**Do not set down ACOPOSmulti modules for cold-plate or feed-through mounting on their bottom side. Doing so could break the clips that hold the unit is fan. Broken clips make it more difficult to replace the fans later on.**

## 6 Wiring

### 6.1 8B0C0160Hx00.000-1, 8B0C0320Hx00.000-1 - Pinout overview

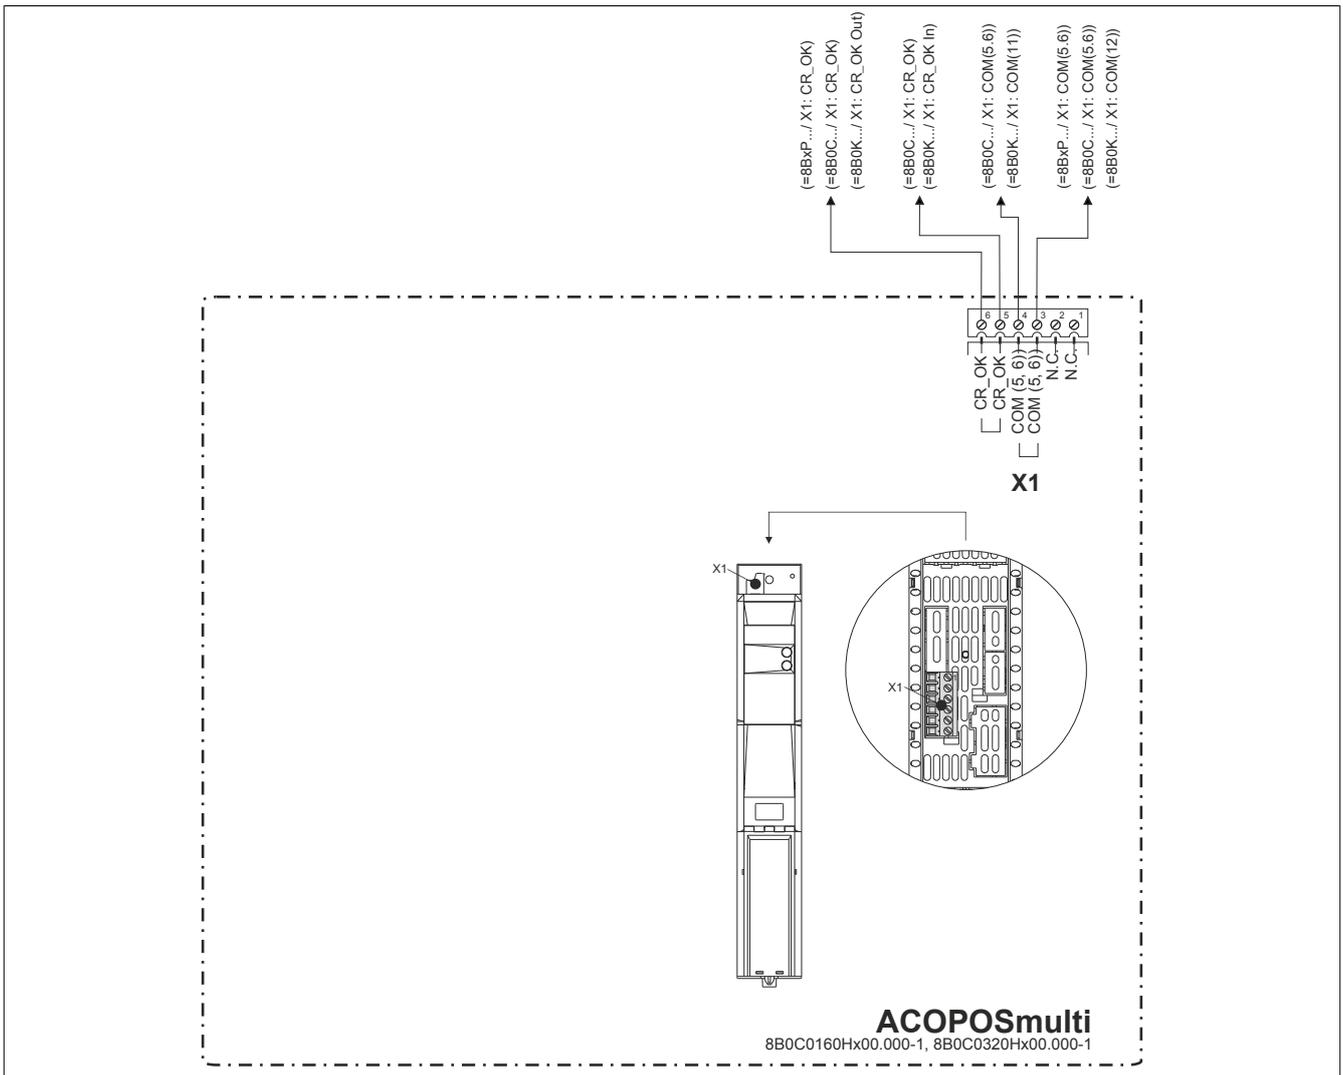


Figure 4: 8B0C0160Hx00.000-1, 8B0C0320Hx00.000-1 - Pinout overview

### 6.2 Connector X1 - Pinout

	Pin	Description	Function
	1	---	---
	2	---	---
	3	COM (5, 6)	DC bus ready 0 V
	4	COM (5, 6)	DC bus ready 0 V
	5	CR_OK	DC bus ready
	6	CR_OK	DC bus ready

Table 4: Connector X1 - Pinout

### 6.3 Input/Output circuit diagram

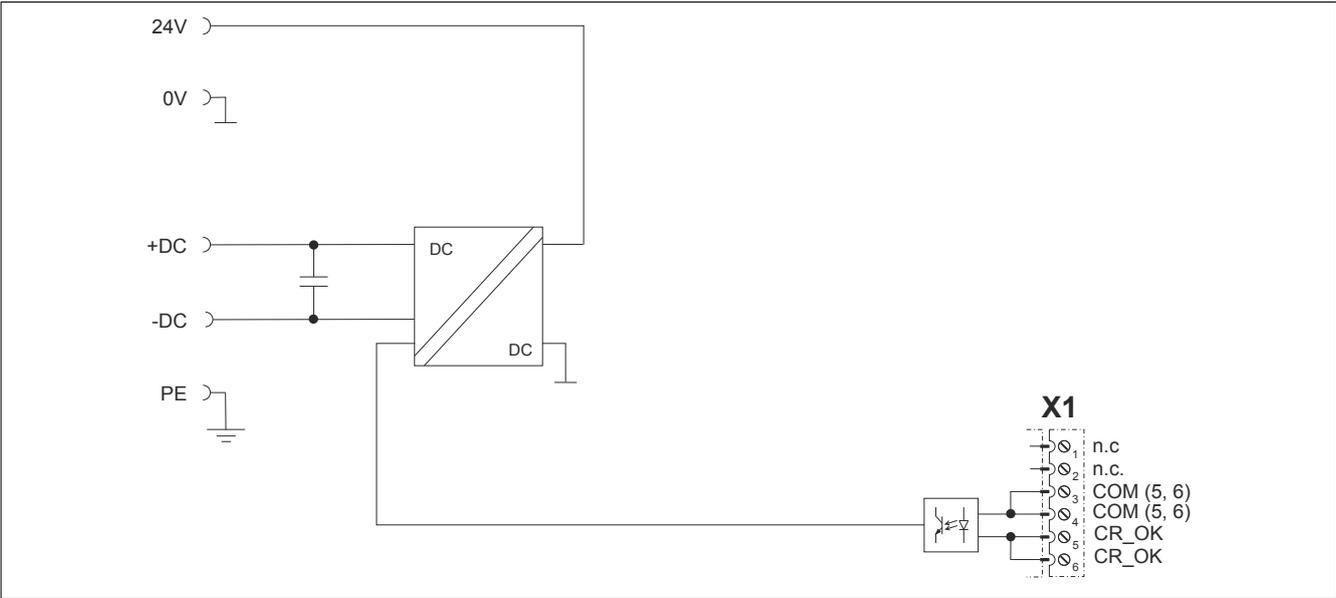


Figure 5: 8B0C0160Hx00.000-1, 8B0C0320Hx00.000-1 - Input/Output circuit diagram