

Power Panel T50

User's manual

Version: **2.04 (November 2022)**
Order no.: **MAPPT50-ENG**

Translation of the original documentation

Publishing information

B&R Industrial Automation GmbH

B&R Strasse 1

5142 Eggelsberg

Austria

Telephone: +43 7748 6586-0

Fax: +43 7748 6586-26

office@br-automation.com

Disclaimer

All information in this document is current as of its creation. The contents of this document are subject to change without notice. B&R Industrial Automation GmbH assumes unlimited liability in particular for technical or editorial errors in this document only (i) in the event of gross negligence or (ii) for culpably inflicted personal injury. Beyond that, liability is excluded to the extent permitted by law. Liability in cases in which the law stipulates mandatory unlimited liability (such as product liability) remains unaffected. Liability for indirect damage, consequential damage, business interruption, loss of profit or loss of information and data is excluded, in particular for damage that is directly or indirectly attributable to the delivery, performance and use of this material.

B&R Industrial Automation GmbH notes that the software and hardware designations and brand names of the respective companies used in this document are subject to general trademark, brand or patent protection.

Hardware and software from third-party suppliers referenced in this document is subject exclusively to the respective terms of use of these third-party providers. B&R Industrial Automation GmbH assumes no liability in this regard. Any recommendations made by B&R Industrial Automation GmbH are not contractual content, but merely non-binding information for which no liability is assumed. When using hardware and software from third-party suppliers, the relevant user documentation of these third-party suppliers must additionally be consulted and, in particular, the safety guidelines and technical specifications contained therein must be observed. The compatibility of the products from B&R Industrial Automation GmbH described in this document with hardware and software from third-party suppliers is not contractual content unless this has been separately agreed in individual cases; in this respect, warranty for such compatibility is excluded in any case, and it is the sole responsibility of the customer to verify this compatibility in advance.

1 Introduction.....	6
1.1 Manual history.....	6
1.2 Information about this document.....	7
1.2.1 Organization of notices.....	7
1.2.2 Guidelines.....	7
1.2.3 Software-specific information.....	7
2 General safety guidelines.....	8
2.1 Intended use.....	8
2.2 Protection against electrostatic discharge.....	8
2.2.1 Packaging.....	8
2.2.2 Regulations for proper ESD handling.....	9
2.3 Regulations and measures.....	9
2.4 Transport and storage.....	9
2.5 Installation.....	10
2.6 Operation.....	10
2.6.1 Protection against contact with electrical parts.....	10
2.6.2 Ambient conditions - Dust, moisture, aggressive gases.....	10
2.6.3 Programs, viruses and malicious programs.....	10
2.7 Cybersecurity disclaimer for products.....	11
3 System overview.....	12
3.1 Compact solution.....	12
3.2 Flexibility.....	12
3.3 Simple HMI.....	12
3.4 Model number key.....	13
4 Device description.....	14
4.1 Type overview.....	14
4.2 General technical data.....	14
4.2.1 System requirements.....	14
4.2.2 Projected capacitive touch (PCT).....	15
4.2.3 Viewing angles.....	16
4.2.4 Surface resistance.....	16
4.3 Power Panel T50 - 5.0" variants.....	17
4.3.1 Order data.....	17
4.3.2 Content of delivery.....	17
4.3.3 Technical data.....	18
4.3.4 Temperature/Humidity diagram.....	20
4.3.5 Dimensions.....	21
4.4 Power Panel T50 - 7.0" variants.....	22
4.4.1 Order data.....	22
4.4.2 Content of delivery.....	22
4.4.3 Technical data.....	23
4.4.4 Temperature/Humidity diagram.....	25
4.4.5 Dimensions.....	26
4.5 Power Panel T50 - 10.1" variants.....	27
4.5.1 Order data.....	27
4.5.2 Content of delivery.....	27
4.5.3 Technical data.....	28
4.5.4 Temperature/Humidity diagram.....	30
4.5.5 Dimensions.....	31
4.6 Power Panel T50 - 12.1" variants.....	32
4.6.1 Order data.....	32
4.6.2 Content of delivery.....	32
4.6.3 Technical data.....	33
4.6.4 Temperature/Humidity diagram.....	35

4.6.5 Dimensions.....	36
4.7 Power Panel T50 - 15.6" variants.....	37
4.7.1 Order data.....	37
4.7.2 Content of delivery.....	37
4.7.3 Technical data.....	38
4.7.4 Temperature/Humidity diagram.....	40
4.7.5 Derating of the display brightness.....	40
4.7.6 Dimensions.....	41
4.8 Connection elements.....	43
4.8.1 Ethernet interface.....	43
4.8.2 USB interfaces.....	44
4.8.3 Power supply.....	45
5 Commissioning.....	46
5.1 Installation.....	46
5.1.1 Requirements for the installation cutout.....	46
5.1.2 Installing with retaining clips.....	47
5.1.3 Mounting orientations.....	48
5.1.4 Grounding (functional ground).....	49
5.1.5 Securing the connecting cables.....	49
5.1.6 Requirements for the cables used.....	49
5.2 Operating the Power Panel.....	50
5.2.1 Keyboard.....	50
5.2.2 Mouse.....	50
6 Configuration.....	51
6.1 Service pages.....	51
6.1.1 Overview.....	55
6.1.2 Service page <i>Startup</i>	56
6.1.3 Service page <i>Network</i>	57
6.1.4 Service page <i>Time</i>	60
6.1.5 Service page <i>Screen</i>	61
6.1.6 Service page <i>Audio</i>	63
6.1.7 Service page <i>Gesture</i>	64
6.1.8 Service page <i>VNC</i>	65
6.1.9 Service page <i>Web</i>	68
6.1.10 Service page <i>Storage</i>	73
6.1.11 Service page <i>Update</i>	75
6.1.12 Service page <i>Backup & Reset</i>	80
6.1.13 Service page <i>Security</i>	81
6.1.14 Service page <i>OPC UA</i>	82
6.1.15 Service page <i>Remote Access</i>	84
6.1.16 Service page <i>Save & Exit</i>	86
6.1.17 Service page <i>About & Info</i>	87
6.2 Update.....	88
6.2.1 Updating with Automation Studio and USB flash drive.....	88
6.2.2 Updating with a downloaded from the website and USB flash drive.....	89
6.2.3 Duplicating an existing setup using a USB flash drive.....	89
7 Software.....	90
7.1 License information about the PPT System.....	90
7.2 Notes about the PPT system.....	91
7.2.1 PPT image 1.0.1.....	91
7.3 Web browser information.....	91
7.3.1 Installing certificates in the browser.....	91
7.3.2 Supported fonts.....	91
7.3.3 Supported video formats.....	92

7.3.4 User agent.....	92
7.4 File formats.....	93
7.4.1 PPT image.....	93
7.4.2 System settings.....	93
7.4.3 Boot logo.....	93
7.4.4 Boot animation.....	94
7.5 Access to shared memory areas.....	94
7.6 RFB extension.....	95
7.6.1 Temperature monitoring.....	95
7.6.2 Adjusting display brightness.....	96
7.6.3 Outputting an audio signal.....	96
7.7 OPC UA server.....	97
7.7.1 Information model.....	97
7.7.2 Description of the nodes of the information model.....	103
8 Maintenance.....	136
8.1 Cleaning.....	136
8.2 User tips for increasing the display's service life.....	136
8.2.1 Backlight.....	136
8.2.2 Screen burn-in.....	136
9 Accessories.....	138
9.1 Overview.....	138
9.2 OTB6102 - 2-pin terminal block for power supply.....	139
9.2.1 Order data.....	139
9.2.2 Technical data.....	139
9.3 6ACCRPP2.0000-000.....	140
9.3.1 Order data.....	140
9.3.2 Technical data.....	140
9.4 6ACCRPP2.0001-000.....	141
9.4.1 Order data.....	141
9.4.2 Technical data.....	141
9.5 Storage media.....	142
9.6 Cables.....	142
10 International and national certifications.....	143
10.1 Overview of certifications.....	143
10.2 EU directives and standards (CE).....	144
10.2.1 Overview of standards.....	145
10.2.2 Requirements for immunity to disturbances.....	146
10.2.3 Emission requirements.....	148
10.2.4 Mechanical conditions.....	149
10.2.5 Electrical safety.....	150
10.3 Underwriters Laboratories (UL).....	151
10.4 Offshore/Maritime.....	152
10.5 Additional certifications.....	153
11 Environmentally friendly disposal.....	154
11.1 Separation of materials.....	154

1 Introduction

Information:

B&R makes every effort to keep documents as current as possible. The most current versions are available for download on the B&R website (www.br-automation.com).

1.1 Manual history

Version	Date	Comment ¹⁾
2.04	November 2022	<p>New content:</p> <ul style="list-style-type: none"> • Technical data update: Added UKCA certification. • Updated documentation for PPT system 1.6.0. • New note about default hostname if it is not defined (see "Hostname" on page 57). • New options on service page Web: <ul style="list-style-type: none"> ⇒ "Ignore server certificate errors" on page 70 ⇒ "Enable Screen Capture" on page 71 ⇒ "Suppress Screen Capture security warning" on page 71 • New option on service page Network: "Back end WebSocket port" on page 85 • New OPC UA parameters: <ul style="list-style-type: none"> ⇒ Parameters for remote access: RemoteAccessModeWebGL, RemoteAccessPortWebGL, RemoteAccessWSPortWebGL, RemoteAccessModeVNC, RemoteAccessPortVNC ⇒ Parameters for boot animation: BootAnimationDelay, BootAnimationLeftPos, BootAnimationTopPos ⇒ Parameters for VNC: VNCConnectionMonitor ⇒ Parameters for web: IgnoreServerCertificateErrors, EnableScreenCapture, SuppressScrnCaptSecWarn • Updated chapter "International and national certifications" with UKCA certification. • Removed section "ATEX directive 2014/34/EU" from chapter International and national certifications. • Removed section "Instructions for use in Ex zone 2 / 22" from chapter Commissioning.
2.03	May 2022	<p>New content:</p> <ul style="list-style-type: none"> • Added section "ATEX directive 2014/34/EU" in chapter International and national certifications. • Added section "Instructions for use in Ex zone 2 / 22" in chapter Commissioning. • Updated section "Installing with retaining clips": Securing the retaining clips correctly.
2.02	December 2021	<p>New Content:</p> <ul style="list-style-type: none"> • Updated documentation for PPT system 1.5.2. • New option Enable connection monitor and corresponding information about VNC connection monitoring in section "Service page VNC" on page 65.
2.01	June 2021	<p>New content:</p> <ul style="list-style-type: none"> • Added section "License information about the PPT System" on page 90. <p>Corrections, changes and updates:</p> <ul style="list-style-type: none"> • Added voltage range and power consumption to the technical data.
2.00	April 2021	<p>New content:</p> <ul style="list-style-type: none"> • Updated documentation for PPT system 1.5.0. • Added function for remote access (see "Service page Remote Access" on page 84). • Added option Set/Override viewport settings for web browser (see "Service page Web" on page 68). • Added option Background color for VNC client (see "Service page VNC" on page 65). • Added parameters to the OPC UA interface: <ul style="list-style-type: none"> ⇒ RemoteAccess ⇒ VNCBackgroundColor ⇒ SetOverrideViewport ⇒ ViewportSettings • Added methods to the OPC UA interface: <ul style="list-style-type: none"> ⇒ StartRemoteAccess ⇒ StopRemoteAccess <p>Corrections, changes and updates:</p> <ul style="list-style-type: none"> • Changed disclaimer. • Added note about SNMP and TFTP in section "Load configuration from PLC (button)" on page 76. • Changed test values in section "Requirements for immunity to disturbances" on page 146.

1) Editorial changes are not listed.

1.2 Information about this document

This document is not intended for end customers! The safety guidelines required for end customers must be incorporated into the operating instructions for end customers in the respective national language by the machine manufacturer or system provider.

1.2.1 Organization of notices

Safety notices

Contain **only** information that warns of dangerous functions or situations.


Signal word	Description
Danger!	Failure to observe these safety guidelines and notices will result in death, severe injury or substantial damage to property.
Warning!	Failure to observe these safety guidelines and notices can result in death, severe injury or substantial damage to property.
Caution!	Failure to observe these safety guidelines and notices can result in minor injury or damage to property.
Notice!	Failure to observe these safety guidelines and notices can result in damage to property.

General notices

Contain **useful** information for users and instructions for avoiding malfunctions.

Signal word	Description
Information:	Useful information, application tips and instructions for avoiding malfunctions.

1.2.2 Guidelines



European dimension standards apply to all dimension diagrams.

All dimensions, specifications in dimension diagrams and associated tables are in millimeters [mm].

Unless otherwise specified, the following general tolerances apply:

Nominal dimension range	General tolerance per DIN ISO 2768 medium
Up to 6 mm	±0.1 mm
Over 6 to 30 mm	±0.2 mm
Over 30 to 120 mm	±0.3 mm
Over 120 to 400 mm	±0.5 mm
Over 400 to 1000 mm	±0.8 mm

1.2.3 Software-specific information

Information:


Graphics and paths to menu commands and help topics contained in this document refer to a specific Automation Studio version. There may be differences in display and path specifications when using a different version.

2 General safety guidelines

Notice!

If the device is not used in accordance with the manufacturer's instructions, the protection provided by the device may be impaired.

The following symbols appear on the device or its packaging:

Symbol	Explanation
	<p>Observe the operating instructions!</p> <p>This documentation contains information about types of potential hazards and enables you to identify risks and implement countermeasures.</p>

2.1 Intended use

In all cases, applicable national and international standards, regulations and safety measures must be taken into account and observed!

The B&R products described in this manual are intended for use in industry and industrial applications. The intended use includes control, operation, monitoring, drive and HMI tasks as part of automation processes in machines and systems.

B&R products are only permitted to be used in their original condition. Modifications and extensions are only permitted if they are described in this manual.

B&R excludes liability for damage of any kind resulting from the use of B&R products in any intended way.

B&R products have not been designed, developed and manufactured for use that involves fatal risks or hazards that could result in death, injury, serious physical harm or other loss without the assurance of exceptionally stringent safety precautions.

B&R products are explicitly not intended for use in the following applications:

- Monitoring and control of thermonuclear processes
- Weapon systems control
- Flight and traffic control systems for passenger and freight transport
- Health monitoring and life support systems

2.2 Protection against electrostatic discharge

Electrical assemblies that can be damaged by electrostatic discharge (ESD) must be handled accordingly.

2.2.1 Packaging

- Electrical assemblies with housing do not require special ESD packaging but must be handled properly (see "[Electrical assemblies with housing](#)" on page 9).
- Electrical assemblies without housing are protected by ESD-suitable packaging.

2.2.2 Regulations for proper ESD handling

Electrical assemblies with housing

- Do not touch the connector contacts on the device (bus data contacts).
- Do not touch the connector contacts of connected cables.
- Do not touch the contact tips on circuit boards.

Electrical assemblies without housing

The following applies in addition to "Electrical assemblies with housing":

- All persons handling electrical assemblies and devices in which electrical assemblies are installed must be grounded.
- Assemblies are only permitted to be touched on the narrow sides or front plate.
- Always place assemblies on suitable surfaces (ESD packaging, conductive foam, etc.).

Information: Metallic surfaces are not suitable surfaces!

- Assemblies must not be subjected to electrostatic discharges (e.g. due to charged plastics).
- A minimum distance of 10 cm from monitors or television sets must be maintained.
- Measuring instruments and devices must be grounded.
- Test probes of floating potential measuring instruments must be discharged briefly on suitable grounded surfaces before measurement.

Individual components

- ESD protective measures for individual components are implemented throughout B&R (conductive floors, shoes, wrist straps, etc.).
- The increased ESD protective measures for individual components are not required for handling B&R products at customer locations.

2.3 Regulations and measures

Electronic devices are generally not failsafe. If the programmable logic controller, operating or monitoring device or uninterruptible power supply fails, the user is responsible for ensuring that connected devices, such as motors, are brought to a safe state.

When using programmable logic controllers as well as when using operating and monitoring devices as control systems in conjunction with a Soft PLC (e.g. Automation Runtime or similar product) or Slot PLC (e.g. B&R LS251 or similar product), the safety measures that apply to industrial controllers (protection by protective equipment such as emergency stops) must be observed in accordance with applicable national and international regulations. This also applies to all other connected devices, such as drives.

All work such as installation, commissioning and servicing are only permitted to be carried out by qualified personnel. Qualified personnel are persons who are familiar with the transport, installation, assembly, commissioning and operation of the product and have the appropriate qualifications for their job (e.g. IEC 60364). National accident prevention regulations must be observed.

The safety guidelines, information about connection conditions (nameplate and documentation) and limit values specified in the technical data must be read carefully before installation and commissioning and must be strictly observed.

2.4 Transport and storage

During transport and storage, devices must be protected against undue stress (mechanical stress, temperature, humidity, aggressive atmosphere).

2.5 Installation

- The devices are not ready for use and must be installed and wired according to the requirements of this documentation in order to comply with EMC limit values.
- Installation must be carried out according to the documentation using suitable equipment and tools.
- Devices are only permitted to be installed in a voltage-free state and by qualified personnel.
- General safety regulations and national accident prevention regulations must be observed.
- The electrical installation must be carried out in accordance with relevant regulations (e.g. wire cross section, fuse protection, protective ground connection).
- Take the necessary protective measures against electrostatic discharge (see ["Protection against electrostatic discharge" on page 8](#)).

2.6 Operation

2.6.1 Protection against contact with electrical parts

In order to operate programmable logic controllers, operating and monitoring devices and the uninterruptible power supply, it is necessary for certain components to carry dangerous voltages over 42 VDC. Touching one of these components can result in a life-threatening electric shock. There is a risk of death, serious injury or damage to property.

Before switching on the programmable logic controllers, operating and monitoring devices and uninterruptible power supply, it must be ensured that the housing is properly connected to ground potential (PE rail). The ground connection must also be made if the operating and monitoring device and uninterruptible power supply are only connected for testing purposes or only operated for a short time!

Before switching on, live parts must be securely covered. All covers must be kept closed during operation.

2.6.2 Ambient conditions - Dust, moisture, aggressive gases

The use of operating and monitoring devices (e.g. industrial PCs, Power Panels, Mobile Panels) and uninterruptible power supplies in dusty environments must be avoided. This can result in dust deposits that affect the functionality of the device. Sufficient cooling may then no longer be ensured, especially in systems with an active cooling unit (fan).

The presence of aggressive gases in the environment can also result in malfunctions. In combination with high temperature and relative humidity, aggressive gases – for example with sulfur, nitrogen and chlorine components – trigger chemical processes that can very quickly impair or damage electronic components. Blackened copper surfaces and cable ends in existing installations are indicators of aggressive gases.

When operated in rooms with dust and condensation that can endanger functionality, operating and monitoring devices such as Automation Panels or Power Panels are protected on the front against the ingress of dust and moisture when installed correctly (e.g. cutout installation). The back of all devices must be protected against the ingress of dust and moisture, however, or the dust deposits must be removed at suitable intervals.

2.6.3 Programs, viruses and malicious programs

Any data exchange or installation of software using data storage media (e.g. floppy disk, CD-ROM, USB flash drive) or via networks or the Internet poses a potential threat to the system. It is the direct responsibility of the user to avert these dangers and to take appropriate measures such as virus protection programs and firewalls to protect against them and to use only software from trustworthy sources.

2.7 Cybersecurity disclaimer for products

B&R products communicate via a network interface and were developed for secure connection with internal and, if necessary, other networks such as the Internet.

Information:

In the following, B&R products are referred to as "product" and all types of networks (e.g. internal networks and the Internet) are referred to as "network".

It is the sole responsibility of the customer to establish and continuously ensure a secure connection between the product and the network. In addition, appropriate security measures must be implemented and maintained to protect the product and entire network from any security breaches, unauthorized access, interference, digital intrusion, data leakage and/or theft of data or information.

B&R Industrial Automation GmbH and its subsidiaries are not liable for damages and/or losses in connection with security breaches, unauthorized access, interference, digital intrusion, data leakage and/or theft of data or information.

The aforementioned appropriate security measures include, for example:

- Segmentation of the network (e.g. separation of the IT network from the control network¹⁾)
- Use of firewalls
- Use of authentication mechanisms
- Encryption of data
- Use of anti-malware software

Before B&R releases products or updates, they are subjected to appropriate functional testing. Independently of this, we recommend that our customers develop their own test processes in order to be able to check the effects of changes in advance. Such changes include, for example:

- Installation of product updates
- Significant system modifications such as configuration changes
- Deployment of updates or patches for third-party software (non-B&R software)
- Hardware replacement

These tests should ensure that implemented security measures remain effective and that systems in the customer's environment behave as expected.

¹⁾ The term "control network" refers to computer networks used to connect control systems. The control network can be divided into zones, and there can be several separate control networks within a company or site. The term "control systems" refers to all types of B&R products such as controllers (e.g. X20), HMI systems (e.g. Power Panel T30), process control systems (e.g. APROL) and supporting systems such as engineering workstations with Automation Studio.

3 System overview

The Power Panel T50 is equipped with an integrated browser and can also be used as a Visual Components client. This Power Panel has Ethernet and USB interfaces as well as various configuration options.



Power Panel T50 devices with glass front and multi-touch technology are compact, easy to configure and perfectly suited for premium machine designs.

The high sensitivity and accuracy of the projected capacitive touch screen improves usability. The multi-touch technology also makes it possible to integrate convenient gestures like zooming and swiping.

Highlights

- High-quality, slim design
- Multi-touch capability
- Widescreen variants up to 15.6" HD
- Easy configuration
- Web-based or VNC-based HMI

3.1 Compact solution

Power Panels are characterized by their compact design, low installation depth and intelligent arrangement of cable outlets. The panels are therefore particularly space-saving and easy to install. They also have no hard disks, fans or batteries, which makes them maintenance-free. The front of the panel provides IP65 protection, making these devices extremely well-suited for harsh industrial environments.

3.2 Flexibility

Power Panel T50 devices are available in 5 different display sizes from 5.0" to 15.6" (see ["Type overview" on page 14](#)).

Landscape and portrait formats add even more flexibility to the machine layout.

Regardless of model, size and color, what all these devices have in common is a shallow installation depth and minimized border width. At the same time, no compromises were made with regard to stability and seal integrity.

3.3 Simple HMI

The Power Panel T50 is a dedicated HMI device that can be operated in 2 different terminal modes:

- Terminal as VNC client for VNC-based HMI applications created with Visual Components in Automation Studio.
- Terminal with web browser technology (full screen mode).








3.4 Model number key

Product range																			
6												Device with browser technology							
Product family																			
P		P												Power Panel					
Model																			
T												Terminal series							
Variant (processor power)																			
5		0												2x ARM processor (Cortex-A9, dual core)					
Diagonal																			
		0		5		0									5.0"				
		0		7		0									7.0"				
		1		0		1									10.1"				
		1		2		1									12.1"				
		1		5		6									15.6"				
Resolution																			
2												WVGA (800 x 480) landscape							
B												HD (1366 x 768) landscape							
E												WXGA (1280 x 800) landscape							
Display / Touch screen technology																			
-		1												Color TFT display and projected capacitive touch screen (PCT, glass)					
Optional interfaces and features																			
0												No optional interfaces/features							
6												Integrated switch with second Ethernet interface							
Front design																			
Standard variants																			
B												Black							
A												Black, anti-glare glass							
Industry-specific variant																			
I		.		.		.									Seq. number: I[0...Z][0...Z][0...Z]				
Customized glass front variant																			
G		.		.		.									Seq. number: G[0...Z][0...Z][0...Z]				
Completely customized variant																			
C		.		.		.									Seq. number: C[0...Z][0...Z][0...Z]				
Settings or OS variant																			
Customized settings, configurations, boot logo, etc.																			
S		.		.		.									Seq. number: S[0...Z][0...Z]				
Customized OS variant																			
I		.		.		.									Seq. number: I[0...Z][0...Z]				
Model or I/O variants																			
																Base model			
																- 0 1 Derivative: Consecutive number [0...Z]			
Examples																			
6	P	P	T	5	0	.	0	7	0	2	-	1	0	A	Power Panel T50, 7.0" , glass front (anti-glare), 1x Gigabit Ethernet. CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 7.0" , 800 x 480 (WVGA) resolution, projected capacitive touch screen, multi-touch support, anti-glare glass front with black frame, landscape and portrait format configurable with software. Interfaces: 1x Ethernet 10/100/1000 Mbit/s, 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.				
6	P	P	T	5	0	.	1	0	1	E	-	1	6	B	Power Panel T50, 10.1" , glass front, 2x Gigabit Ethernet (integrated switch). CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 10.1" , 1280 x 800 (WXGA) resolution, projected capacitive touch screen, multi-touch support, glass front with black frame, landscape and portrait format configurable with software. Interfaces: 2x Ethernet 10/100/1000 Mbit/s (integrated switch), 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.				
6	P	P	T	5	0	.	1	0	1	E	-	1	6	A	Power Panel T50, 10.1" , glass front (anti-glare), 2x Gigabit Ethernet (integrated switch). CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 10.1" , 1280 x 800 (WXGA) resolution, projected capacitive touch screen, multi-touch support, anti-glare glass front with black frame, landscape and portrait format configurable with software. Interfaces: 2x Ethernet 10/100/1000 Mbit/s (integrated switch), 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.				

4 Device description

4.1 Type overview

Panel size	5.0"	7.0"	10.1"	12.1"	15.6"
Model number	6PPT50. 0502 -1xx	6PPT50. 0702 -1xx	6PPT50. 101E -1xx	6PPT50. 121E -1xx	6PPT50. 156B -1xx
					
Format/Resolution	Portrait/Landscape format				
Resolution	WVGA 800 x 480	WVGA 800 x 480	WXGA 1280 x 800	WXGA 1280 x 800	HD 1366 x 768
Model number	0502	0702	101E	121E	156B
	6PPT50. xxxx -xxx				
Front	Black				
	Glass			Glass, non-reflective	
Model number	6PPT50.xxxx-xx B			6PPT50.xxxx-xx A	
Interfaces/Features					
	1 Ethernet interface			2 Ethernet interfaces, integrated switch	
Model number	6PPT50.xxxx-x 0 x			6PPT50.xxxx-x 6 x	

4.2 General technical data

Name	Description
Processor	ARM processor, Cortex A9, dual core, 800 MHz
Memory	1 GB DDRAM (64-bit bandwidth)
Interfaces	1 or 2 Ethernet interfaces 10/100BASE-T/1000BASE-T 2x USB 2.0 interfaces
Other	Protection: IP65 (front), IP20 (back) Temperature range from -20 to 60°C Fanless Power supply 24 VDC -15%/+20%
Multi-touch gestures	Multi-touch gestures are supported by mapp View (web-based HMI application). Neither the VNC client nor VC4 integrated in Automation Studio supports multi-touch gestures. However, VC4 recognizes and evaluates multiple pressed touch buttons or hotspots on multi-touch displays.

4.2.1 System requirements

General system requirements for Power Panel T50:

Function	Starting with AS version	Starting with AR version	Starting with hardware upgrade
General support for Power Panel T50	4.3.3	4.33	-
OPC UA configuration in Automation Studio	-	-	1.2.0.0

* AS ... Automation Studio, AR ... Automation Runtime

4.2.2 Projected capacitive touch (PCT)

A new touch screen controller with improved properties is used starting with the second generation of devices:

Power Panel T50	1st device generation	2nd device generation
Operation		
Number of fingers	5	10
Glove operation	Yes, with limitations	Yes
Passive stylus pens	Yes	Yes
Active stylus pens	No	No
Error detection		
Ball of hand	No	Yes
Water	No	Yes
Front		
Hardened front glass	Yes	Yes

Hardware revisions of device generations

Order number	6PPT50.0502-xxx	6PPT50.0702-xxx	6PPT50.101E-xxx	6PPT50.121E-xxx	6PPT50.156B-xxx
Panel size	5.0"	7.0"	10.1"	12.1"	15.6"
1. Device generation	<C0	<D0	<D0	<C0	<C0
2. Device generation	≥C0	≥D0	≥D0	≥C0	≥C0

Operation with gloves



Projected capacitive touch screens (PCT) are suitable for operation with or without gloves.

A large number of gloves (rubber gloves, light/heavy leather gloves, disposable latex gloves, etc.) are supported.

Due to the variety of commercially available gloves, however, B&R cannot guarantee all types.

Support for stylus pens

Passive stylus pens:

In principle, the Power Panel supports passive stylus pens. Due to the large number of passive stylus pens available on the market, there may be functional differences. For this reason, B&R cannot comprehensively guarantee their functionality.


Active stylus pens are not supported!

Touch actions during cleaning

Touch actions can be triggered during cleaning of the PCT touch screen. If this is not desired, this behavior must be taken into account in the application.

4.2.3 Viewing angles

For the viewing angles values (U, D, R, L) of the display types, see the technical data of the respective device.

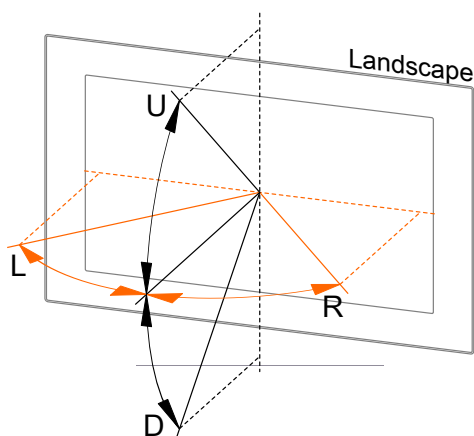

Legend	Display viewing angle
U	From top
D	From bottom
L	From left
R	From right

The viewing angles are specified for the horizontal (L, R) and vertical (U, D) axes in reference to the vertical axis of the display. The specified viewing angles above always refer to the standard mounting orientation of the respective Power Panel.

Standard mounting orientation: Interfaces are at the bottom.

4.2.4 Surface resistance

Chemical resistance of the front glass per ASTM D 1308-02 and ASTM F 1598-95 for an exposure time of 24 hours without visible changes:

- | | | |
|--|--------------------------------|--|
| • Acetone | • Vinegar | • Naphtha |
| • Alkaline cleaning agents | • Ethanol | • Caustic soda 5% |
| • Ammonia 5% | • Grease | • Nitric acid 70% |
| • Gasoline (unleaded) | • Ammonia-based glass cleaners | • Hydrochloric acid 5% |
| • Beer | • Sidolin glass cleaner | • Lubricants |
| • Brake fluid | • Graphite | • Sulphuric acid 40% |
| • Chlorine-alkaline cleaning and disinfecting agents (pH value min. 11) 1.5% | • Hydraulic fluid (Skydrol) | • Suntan oil and UV radiation |
| • Hydrogen chloride 6% | • Isopropanol | • Cooking oil |
| • Coca-Cola | • Coffee | • Stamping ink |
| • Diesel | • Ink | • Tea |
| • Diesel oil | • Lysol | • Turpentine |
| • Dimethylbenzene | • Methylbenzene | • Turpentine oil replacement (thinner) |
| | • Methyl ethyl ketone | • Trichloroethylene |

4.3 Power Panel T50 - 5.0" variants

4.3.1 Order data


Order number	Short description	Figure
	Power Panel T50	
6PPT50.0502-10B	Power Panel T50, 5.0", glass front, 1x Gigabit Ethernet. CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 5.0", 800 x 480 (WVGA) resolution, projected capacitive touch screen, multi-touch support, glass front with black frame, landscape and portrait format configurable with software. Interfaces: 1x Ethernet 10/100/1000 Mbit/s, 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.	
6PPT50.0502-10A	Power Panel T50, 5.0", glass front (anti-glare), 1x Gigabit Ethernet. CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 5.0", 800 x 480 (WVGA) resolution, projected capacitive touch screen, multi-touch support, anti-glare glass front with black frame, landscape and portrait format configurable with software. Interfaces: 1x Ethernet 10/100/1000 Mbit/s, 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.	
6PPT50.0502-16B	Power Panel T50, 5.0", glass front, 2x Gigabit Ethernet (integrated switch). CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 5.0", 800 x 480 (WVGA) resolution, projected capacitive touch screen, multi-touch support, glass front with black frame, landscape and portrait format configurable with software. Interfaces: 2x Ethernet 10/100/1000 Mbit/s (integrated switch), 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.	
6PPT50.0502-16A	Power Panel T50, 5.0", glass front (anti-glare), 2x Gigabit Ethernet (integrated switch). CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 5.0", 800 x 480 (WVGA) resolution, projected capacitive touch screen, multi-touch support, anti-glare glass front with black frame, landscape and portrait format configurable with software. Interfaces: 2x Ethernet 10/100/1000 Mbit/s (integrated switch), 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.	
	Included in delivery	
	Terminal blocks	
0TB6102.2110-01	Accessory terminal block, 2-pin (3.81), cage clamp terminal block 1.5 mm ²	
	Optional accessories	
	Other	
6ACCRPP2.0000-000	Installation kit for Power Panel T-Series variants: 8x retaining clips with torque limiting, 1x 2-pin cage clamp terminal block, 1x 2-pin screw clamp terminal block. See the accessories of the Power Panel variant in the corresponding data sheet or on the website.	
	Terminal blocks	
0TB6102.2010-01	Accessory terminal block, 2-pin (3.81), screw clamp terminal block 1.5 mm ²	
	USB accessories	
5MMUSB.2048-01	USB 2.0 flash drive 2048 MB B&R	
5MMUSB.4096-01	USB 2.0 flash drive 4096 MB B&R	

Table: Power Panel T50 - 5.0" variants - Order data

4.3.2 Content of delivery

Name	Quantity	Description
0TB6102.2110-01	1	Accessory terminal block, 2-pin (3.81), cage clamp terminal block 1.5 mm ²
-	1	Accessory set 4x retaining clip for fastening the panel in the installation cutout

4.3.3 Technical data

Order number	6PPT50.0502-10B	6PPT50.0502-10A	6PPT50.0502-16B	6PPT50.0502-16A
General information				
LEDs	Ethernet (Link, Activity, Speed)			
B&R ID code	0xEDC0	0xF07F	0xF080	0xF081
Cooling	Passive			
Power button	No			
Reset button	No			
Buzzer	Yes			
Support				
mapp View	Yes ¹⁾			
Certifications				
CE	Yes			
UKCA	Yes			
UL	cULus E115267 Industrial control equipment			
DNV	Temperature: B (0 - 55°C) Humidity: B (up to 100%) Vibration: A (0.7 g) EMC: B (bridge and open deck)			
LR	ENV1			
ABS	Yes			
BV	EC31B Temperature: 5 - 55°C Vibration: 0.7 g EMC: Bridge and open deck			
EAC	Yes			
Controller				
Operating system	PPT50 system			
Real-time clock	No			
Processor				
Type	ARM Cortex-A9, dual core			
Clock frequency	800 MHz			
L1 cache	64 kB			
L2 cache	512 kB			
Flash	512 MB			
Mode/Node switches	No			
DRAM	1 GB (64-bit bandwidth)			
Display				
Type	TFT color			
Diagonal	5.0"			
Colors	16.7 million (RGB, 8 bits per channel)			
Resolution	WVGA, 800 x 480 pixels			
Contrast	Typ. 600:1			
Viewing angles				
Horizontal	Direction L / Direction R = Typ. 70°			
Vertical	Direction U = Typ. 50° / Direction D = Typ. 70°			
Backlight				
Type	LED			
Brightness	Typ. 400 cd/m²			
Half-brightness time ²⁾	30,000 h			
Touch screen				
Type	Multi-touch			
Technology	PCT (projected capacitive touch)			
Surface	Glass, chemical-ly hardened (6H)	Glass, chemically hard-ened (6H), anti-glare	Glass, chemical-ly hardened (6H)	Glass, chemically hard-ened (6H), anti-glare
Screen rotation	Yes			
Interfaces				
Interface				
Connection	ETH1 (IF1)		ETH1 (IF1) and ETH2 (IF2)	
Type	Ethernet			
Variant	Shielded RJ45		Shielded RJ45 (integrated 2-port switch)	
Line length	Max. 100 m between 2 stations (segment length)			
Max. transfer rate	10/100/1000 Mbit/s			
Transfer				
Physical layer	10BASE-T / 100BASE-TX / 1000BASE-T			
Half-duplex	Yes			
Full-duplex	Yes			
Autonegotiation	Yes			
Auto-MDI/MDIX	Yes			


Table: Power Panel T50 - 5.0" variants - Technical data

Order number	6PPT50.0502-10B	6PPT50.0502-10A	6PPT50.0502-16B	6PPT50.0502-16A
Interface IF3				
Type		USB 2.0		
Variant		Type A		
Current-carrying capacity		0.5 A		
Interface IF4				
Type		USB 2.0		
Variant		Type A		
Current-carrying capacity		0.5 A		
Electrical properties				
Nominal voltage		24 VDC		
Power consumption		Typ. 5.8 W ³⁾		
Max. power consumption		6.4 W ³⁾		
Fuse		3 A slow-blow, internal ⁴⁾		
Voltage range		24 VDC (-25 % / +30 %)		
Reverse polarity protection		Yes		
Electrical isolation	Ethernet (ETH1/IF1) to other inter- faces, power supply and ground		Ethernet (ETH1/IF1 and EHT2/IF2) to oth- er interfaces, power supply and ground	
Operating conditions				
Permissible mounting orientations				
Standard mounting orientation		Vertical		
Inclination		±25°		
Rotation		In 90° increments (portrait/landscape)		
All other mounting orientations		With derating: Max. operating temperature minus 5°C		
Installation elevation above sea level				
0 to 2000 m		No limitation		
>2000 m		Reduction of ambient temperature by 0.5°C per 100 m		
Degree of protection per EN 60529		Front: IP65, Back: IP20		
Ambient conditions				
Temperature				
Operation		-20 to 60°C		
Storage		-20 to 80°C		
Transport		-20 to 80°C		
Relative humidity		See temperature/humidity diagram.		
Mechanical properties				
Front				
Design		Black		
Dimensions				
Width		156 mm		
Height		112 mm		
Depth		39.7 mm		
Weight		0.6 kg		


Table: Power Panel T50 - 5.0" variants - Technical data

- 1) Due to the power of the Power Panel, the following widget classes are fully supported: A, B.
- 2) At 25°C ambient temperature. Reducing the brightness by 50% can typically result in an approximately 50% increase in the half-brightness time.
- 3) Additional power consumption per USB interface: Max. 2.75 W (depending on the connected USB device)
- 4) The internal fuse cannot be replaced by the user or reset.

4.3.4 Temperature/Humidity diagram

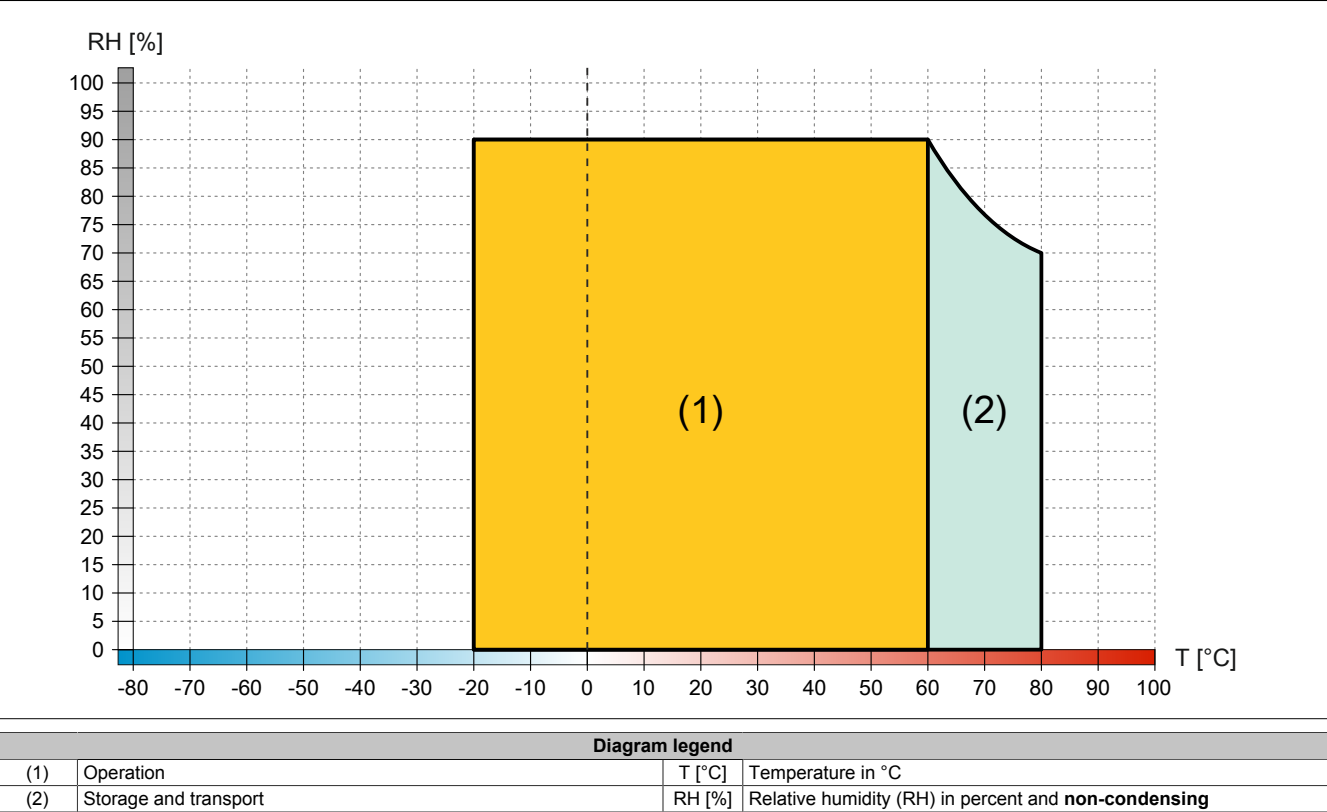

4.3.5 Dimensions

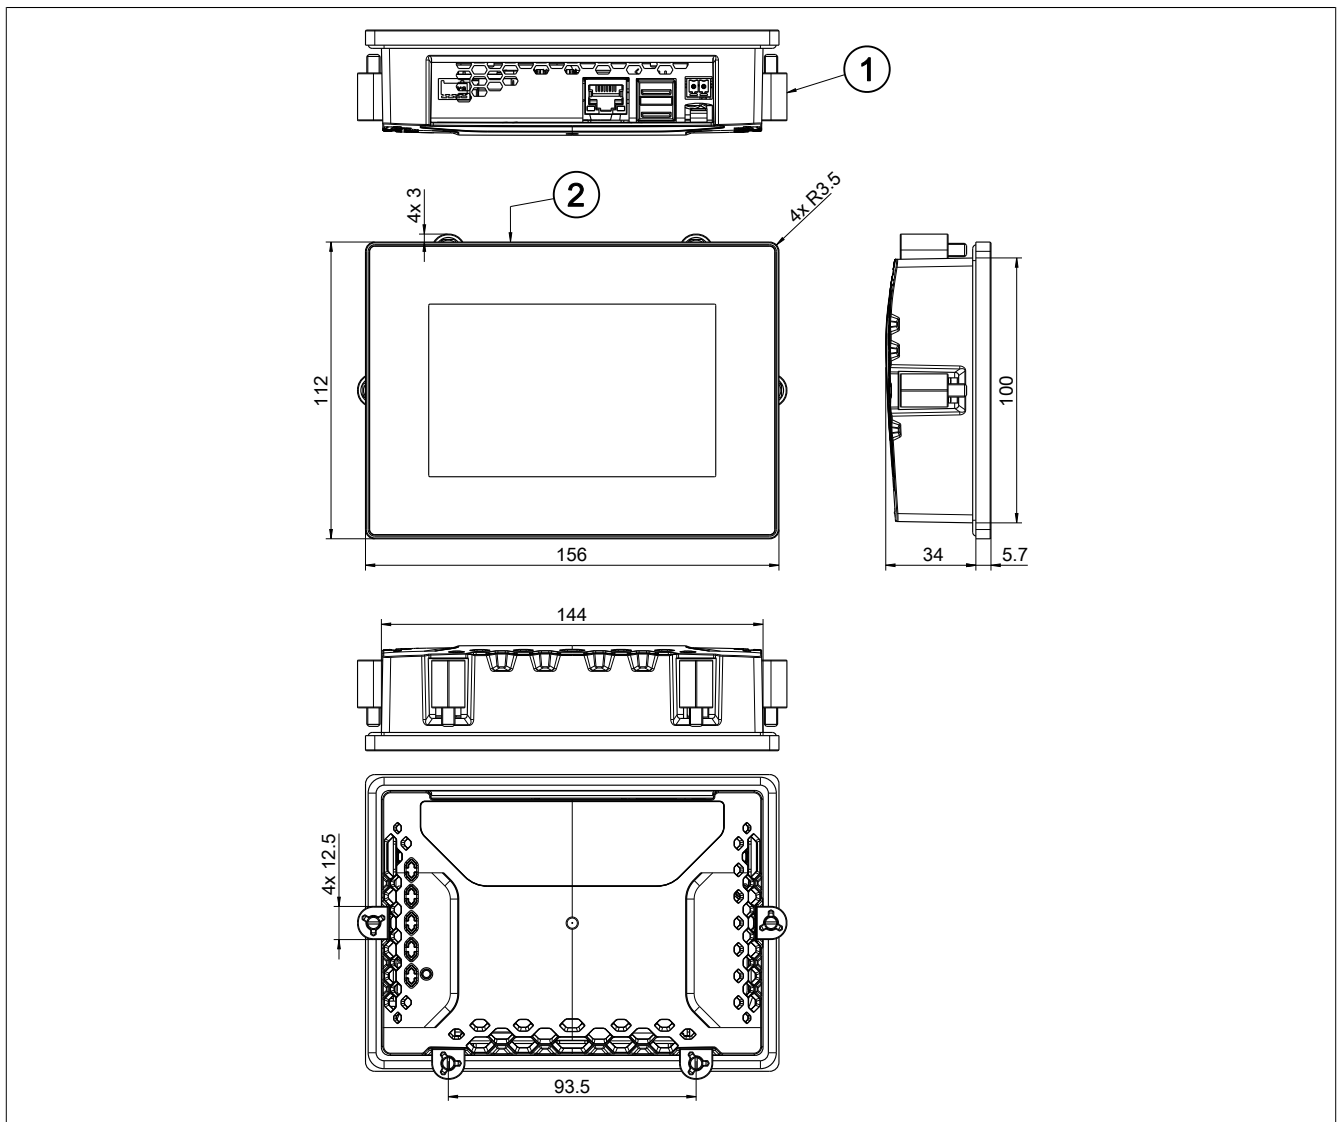

1	4x retaining clips with torque limiting
2	Anodized front plate E6/C8 (black)

Dimensions of the installation cutout for this Power Panel variant: 146 ±1 mm x 102 ±1 mm

See also "[Requirements for the installation cutout](#)" on page 46.

4.4 Power Panel T50 - 7.0" variants

4.4.1 Order data


Order number	Short description	Figure
	Power Panel T50	
6PPT50.0702-10B	Power Panel T50, 7.0", glass front, 1x Gigabit Ethernet. CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 7.0", 800 x 480 (WVGA) resolution, projected capacitive touch screen, multi-touch support, glass front with black frame, landscape and portrait format configurable with software. Interfaces: 1x Ethernet 10/100/1000 Mbit/s, 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.	
6PPT50.0702-10A	Power Panel T50, 7.0", glass front (anti-glare), 1x Gigabit Ethernet. CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 7.0", 800 x 480 (WVGA) resolution, projected capacitive touch screen, multi-touch support, anti-glare glass front with black frame, landscape and portrait format configurable with software. Interfaces: 1x Ethernet 10/100/1000 Mbit/s, 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.	
6PPT50.0702-16B	Power Panel T50, 7.0", glass front, 2x Gigabit Ethernet (integrated switch). CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 7.0", 800 x 480 (WVGA) resolution, projected capacitive touch screen, multi-touch support, glass front with black frame, landscape and portrait format configurable with software. Interfaces: 2x Ethernet 10/100/1000 Mbit/s (integrated switch), 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.	
6PPT50.0702-16A	Power Panel T50, 7.0", glass front (anti-glare), 2x Gigabit Ethernet (integrated switch). CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 7.0", 800 x 480 (WVGA) resolution, projected capacitive touch screen, multi-touch support, anti-glare glass front with black frame, landscape and portrait format configurable with software. Interfaces: 2x Ethernet 10/100/1000 Mbit/s (integrated switch), 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.	
	Included in delivery	
	Terminal blocks	
0TB6102.2110-01	Accessory terminal block, 2-pin (3.81), cage clamp terminal block 1.5 mm ²	
	Optional accessories	
	Other	
6ACCRPP2.0000-000	Installation kit for Power Panel T-Series variants: 8x retaining clips with torque limiting, 1x 2-pin cage clamp terminal block, 1x 2-pin screw clamp terminal block. See the accessories of the Power Panel variant in the corresponding data sheet or on the website.	
	Terminal blocks	
0TB6102.2010-01	Accessory terminal block, 2-pin (3.81), screw clamp terminal block 1.5 mm ²	
	USB accessories	
5MMUSB.2048-01	USB 2.0 flash drive 2048 MB B&R	
5MMUSB.4096-01	USB 2.0 flash drive 4096 MB B&R	

Table: Power Panel T50 - 7.0" variants - Order data

4.4.2 Content of delivery

Name	Quantity	Description
0TB6102.2110-01	1	Accessory terminal block, 2-pin (3.81), cage clamp terminal block 1.5 mm ²
-	1	Accessory set 6x retaining clip for fastening the panel in the installation cutout

4.4.3 Technical data

Order number	6PPT50.0702-10B	6PPT50.0702-10A	6PPT50.0702-16B	6PPT50.0702-16A
General information				
LEDs	Ethernet (Link, Activity, Speed)			
B&R ID code	0xEB2A	0xF082	0xF083	0xF084
Cooling	Passive			
Power button	No			
Reset button	No			
Buzzer	Yes			
Support				
mapp View	Yes ¹⁾			
Certifications				
CE	Yes			
UKCA	Yes			
UL	cULus E115267 Industrial control equipment			
DNV	Temperature: B (0 - 55°C) Humidity: B (up to 100%) Vibration: A (0.7 g) EMC: B (bridge and open deck)			
LR	ENV1			
ABS	Yes			
BV	EC31B Temperature: 5 - 55°C Vibration: 0.7 g EMC: Bridge and open deck			
EAC	Yes			
Controller				
Operating system	PPT50 system			
Real-time clock	No			
Processor				
Type	ARM Cortex-A9, dual core			
Clock frequency	800 MHz			
L1 cache	64 kB			
L2 cache	512 kB			
Flash	512 MB			
Mode/Node switches	No			
DRAM	1 GB (64-bit bandwidth)			
Display				
Type	TFT color			
Diagonal	7.0"			
Colors	16.7 million (RGB, 8 bits per channel)			
Resolution	WVGA, 800 x 480 pixels			
Contrast	Rev. ≥ J0: Typ. 550:1 Rev. < J0: Typ. 600:1	Rev. ≥ I0: Typ. 550:1 Rev. < I0: Typ. 600:1		Rev. ≥ J0: Typ. 550:1 Rev. < J0: Typ. 600:1
Viewing angles				
Horizontal	Direction L / Direction R = Typ. 70°			
Vertical	Revision ≥ J0: Direction U / Direction D = Typ. 50° Revision < J0: Direction U / Direction D = Typ. 60°	Revision ≥ I0: Direction U / Direction D = Typ. 50° Revision < I0: Direction U / Direction D = Typ. 60°		Revision ≥ J0: Direction U / Direction D = Typ. 50° Revision < J0: Direction U / Direction D = Typ. 60°
Backlight				
Type	LED			
Brightness	Typ. 500 cd/m²			
Half-brightness time ²⁾	50,000 h			
Touch screen				
Type	Multi-touch			
Technology	PCT (projected capacitive touch)			
Surface	Glass, chemical-ly hardened (6H)	Glass, chemically hardened (6H), anti-glare	Glass, chemical-ly hardened (6H)	Glass, chemically hardened (6H), anti-glare
Screen rotation	Yes			
Interfaces				
Interface				
Connection	ETH1 (IF1)		ETH1 (IF1) and ETH2 (IF2)	
Type	Ethernet			
Variant	Shielded RJ45		Shielded RJ45 (integrated 2-port switch)	
Line length	Max. 100 m between 2 stations (segment length)			
Max. transfer rate	10/100/1000 Mbit/s			
Transfer				
Physical layer	10BASE-T / 100BASE-TX / 1000BASE-T			
Half-duplex	Yes			
Full-duplex	Yes			
Autonegotiation	Yes			
Auto-MDI/MDIX	Yes			

Table: Power Panel T50 - 7.0" variants - Technical data

Device description

Order number	6PPT50.0702-10B	6PPT50.0702-10A	6PPT50.0702-16B	6PPT50.0702-16A
Interface IF3				
Type		USB 2.0		
Variant		Type A		
Current-carrying capacity		0.5 A		
Interface IF4				
Type		USB 2.0		
Variant		Type A		
Current-carrying capacity		0.5 A		
Electrical properties				
Nominal voltage		24 VDC		
Power consumption		Typ. 7.4 W ³⁾		
Max. power consumption		8.8 W ³⁾		
Fuse		3 A slow-blow, internal ⁴⁾		
Voltage range		24 VDC (-25 % / +30 %)		
Reverse polarity protection		Yes		
Electrical isolation	Ethernet (ETH1/IF1) to other inter- faces, power supply and ground		Ethernet (ETH1/IF1 and EHT2/IF2) to oth- er interfaces, power supply and ground	
Operating conditions				
Permissible mounting orientations				
Standard mounting orientation		Vertical		
Inclination		±25°		
Rotation		In 90° increments (portrait/landscape)		
All other mounting orientations		With derating: Max. operating temperature minus 5°C		
Installation elevation above sea level				
0 to 2000 m		No limitation		
>2000 m		Reduction of ambient temperature by 0.5°C per 100 m		
Degree of protection per EN 60529		Front: IP65, Back: IP20		
Ambient conditions				
Temperature				
Operation		-20 to 60°C		
Storage		-20 to 80°C		
Transport		-20 to 80°C		
Relative humidity		See temperature/humidity diagram.		
Mechanical properties				
Front				
Design		Black		
Dimensions				
Width		197 mm		
Height		140 mm		
Depth		42.2 mm		
Weight		0.9 kg		

Table: Power Panel T50 - 7.0" variants - Technical data

- 1) Due to the power of the Power Panel, the following widget classes are fully supported: A, B.
- 2) At 25°C ambient temperature. Reducing the brightness by 50% can typically result in an approximately 50% increase in the half-brightness time.
- 3) Additional power consumption per USB interface: Max. 2.75 W (depending on the connected USB device)
- 4) The internal fuse cannot be replaced by the user or reset.

4.4.4 Temperature/Humidity diagram


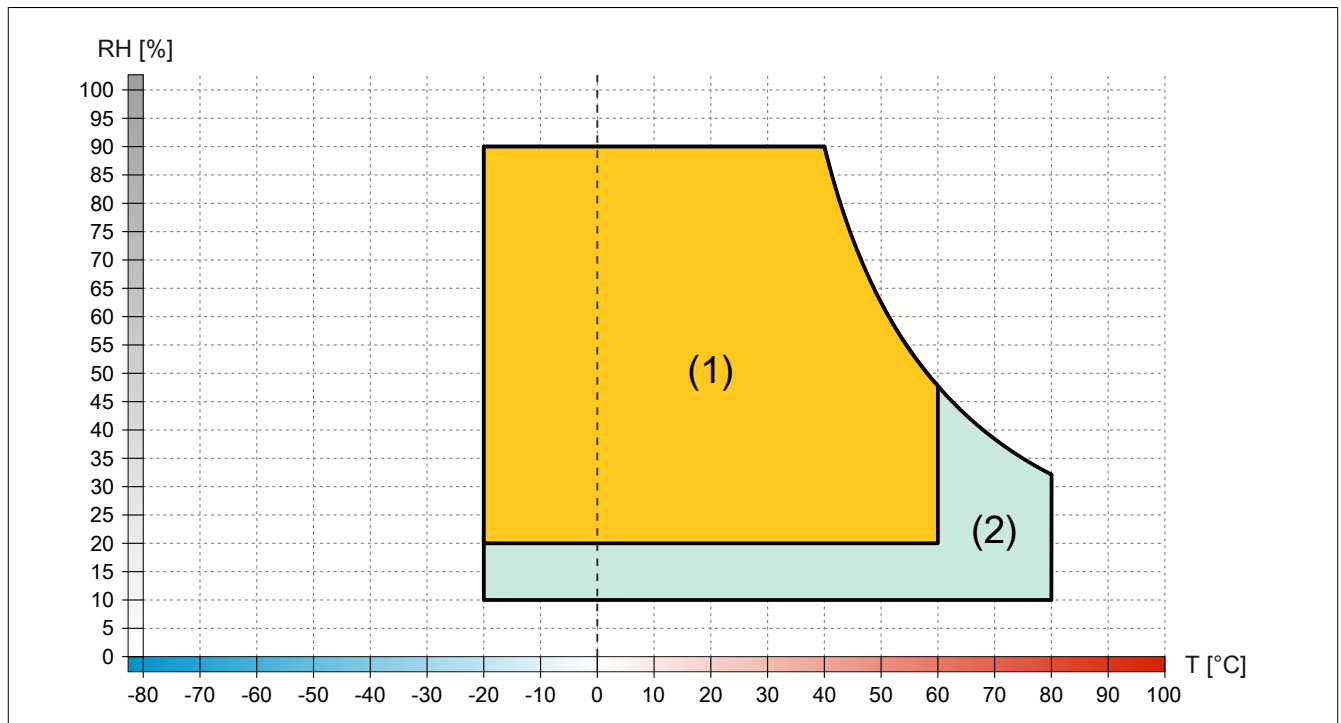


Diagram legend			
(1)	Operation	T [°C]	Temperature in °C
(2)	Storage and transport	RH [%]	Relative humidity (RH) in percent and non-condensing

4.4.5 Dimensions

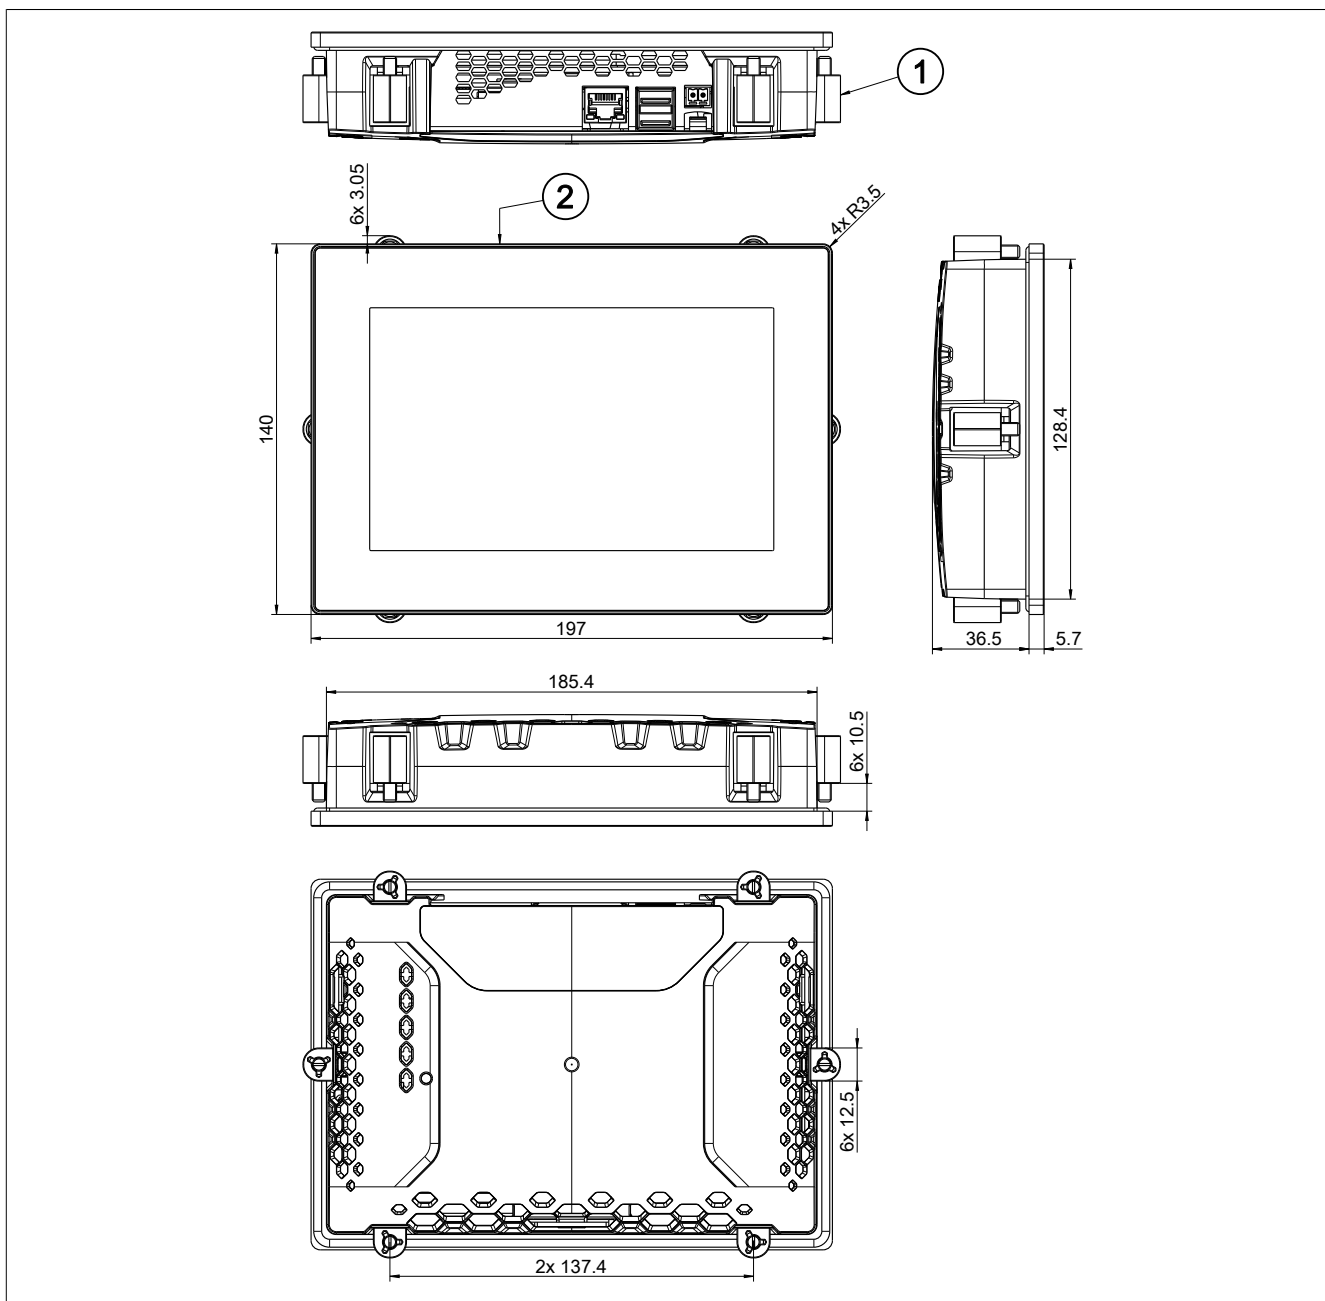

1	6x retaining clips with torque limiting
2	Anodized front plate E6/C8 (black)

Dimensions of the installation cutout for this Power Panel variant: 187 ±1 mm x 130 ±1 mm

See also "[Requirements for the installation cutout](#)" on page 46.

4.5 Power Panel T50 - 10.1" variants

4.5.1 Order data


Order number	Short description	Figure
	Power Panel T50	
6PPT50.101E-10B	Power Panel T50, 10.1", glass front, 1x Gigabit Ethernet. CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 10.1", 1280 x 800 (WXGA) resolution, projected capacitive touch screen, multi-touch support, glass front with black frame, landscape and portrait format configurable with software. Interfaces: 1x Ethernet 10/100/1000 Mbit/s, 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.	
6PPT50.101E-10A	Power Panel T50, 10.1", glass front (anti-glare), 1x Gigabit Ethernet. CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 10.1", 1280 x 800 (WXGA) resolution, projected capacitive touch screen, multi-touch support, anti-glare glass front with black frame, landscape and portrait format configurable with software. Interfaces: 1x Ethernet 10/100/1000 Mbit/s, 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.	
6PPT50.101E-16B	Power Panel T50, 10.1", glass front, 2x Gigabit Ethernet (integrated switch). CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 10.1", 1280 x 800 (WXGA) resolution, projected capacitive touch screen, multi-touch support, glass front with black frame, landscape and portrait format configurable with software. Interfaces: 2x Ethernet 10/100/1000 Mbit/s (integrated switch), 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.	
6PPT50.101E-16A	Power Panel T50, 10.1", glass front (anti-glare), 2x Gigabit Ethernet (integrated switch). CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 10.1", 1280 x 800 (WXGA) resolution, projected capacitive touch screen, multi-touch support, anti-glare glass front with black frame, landscape and portrait format configurable with software. Interfaces: 2x Ethernet 10/100/1000 Mbit/s (integrated switch), 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.	
	Included in delivery	
	Terminal blocks	
0TB6102.2110-01	Accessory terminal block, 2-pin (3.81), cage clamp terminal block 1.5 mm ²	
	Optional accessories	
	Other	
6ACCRPP2.0000-000	Installation kit for Power Panel T-Series variants: 8x retaining clips with torque limiting, 1x 2-pin cage clamp terminal block, 1x 2-pin screw clamp terminal block. See the accessories of the Power Panel variant in the corresponding data sheet or on the website.	
	Terminal blocks	
0TB6102.2010-01	Accessory terminal block, 2-pin (3.81), screw clamp terminal block 1.5 mm ²	
	USB accessories	
5MMUSB.2048-01	USB 2.0 flash drive 2048 MB B&R	
5MMUSB.4096-01	USB 2.0 flash drive 4096 MB B&R	

Table: Power Panel T50 - 10.1" variants - Order data

4.5.2 Content of delivery

Name	Quantity	Description
0TB6102.2110-01	1	Accessory terminal block, 2-pin (3.81), cage clamp terminal block 1.5 mm ²
-	1	Accessory set 8x retaining clip for fastening the panel in the installation cutout

4.5.3 Technical data

Order number	6PPT50.101E-10B	6PPT50.101E-10A	6PPT50.101E-16B	6PPT50.101E-16A
General information				
LEDs	Ethernet (Link, Activity, Speed)			
B&R ID code	0xEDC1	0xF085	0xF086	0xF087
Cooling	Passive			
Power button	No			
Reset button	No			
Buzzer	Yes			
Support				
mapp View	Yes ¹⁾			
Certifications				
CE	Yes			
UKCA	Yes			
UL	cULus E115267 Industrial control equipment			
DNV	Temperature: B (0 - 55°C) Humidity: B (up to 100%) Vibration: A (0.7 g) EMC: B (bridge and open deck)			
LR	ENV1			
ABS	Yes			
BV	EC31B Temperature: 5 - 55°C Vibration: 0.7 g EMC: Bridge and open deck			
EAC	Yes			
Controller				
Operating system	PPT50 system			
Real-time clock	No			
Processor				
Type	ARM Cortex-A9, dual core			
Clock frequency	800 MHz			
L1 cache	64 kB			
L2 cache	512 kB			
Flash	512 MB			
Mode/Node switches	No			
DRAM	1 GB (64-bit bandwidth)			
Display				
Type	TFT color			
Diagonal	10.1"			
Colors	16.7 million (RGB, 8 bits per channel)			
Resolution	WXGA, 1280 x 800 pixels			
Contrast	Typ. 800:1			
Viewing angles				
Horizontal	Direction L / Direction R = Typ. 85°			
Vertical	Direction U / Direction D = Typ. 85°			
Backlight				
Type	LED			
Brightness	Typ. 500 cd/m²			
Half-brightness time ²⁾	50,000 h			
Touch screen				
Type	Multi-touch			
Technology	PCT (projected capacitive touch)			
Surface	Glass, chemical-ly hardened (6H)	Glass, chemically hard-ened (6H), anti-glare	Glass, chemical-ly hardened (6H)	Glass, chemically hard-ened (6H), anti-glare
Screen rotation	Yes			
Interfaces				
Interface				
Connection	ETH1 (IF1)		ETH1 (IF1) and ETH2 (IF2)	
Type	Ethernet			
Variant	Shielded RJ45		Shielded RJ45 (integrated 2-port switch)	
Line length	Max. 100 m between 2 stations (segment length)			
Max. transfer rate	10/100/1000 Mbit/s			
Transfer				
Physical layer	10BASE-T / 100BASE-TX / 1000BASE-T			
Half-duplex	Yes			
Full-duplex	Yes			
Autonegotiation	Yes			
Auto-MDI/MDIX	Yes			


Table: Power Panel T50 - 10.1" variants - Technical data

Order number	6PPT50.101E-10B	6PPT50.101E-10A	6PPT50.101E-16B	6PPT50.101E-16A
Interface IF3				
Type			USB 2.0	
Variant			Type A	
Current-carrying capacity			0.5 A	
Interface IF4				
Type			USB 2.0	
Variant			Type A	
Current-carrying capacity			0.5 A	
Electrical properties				
Nominal voltage			24 VDC	
Power consumption			Typ. 8.6 W ³⁾	
Max. power consumption			10.6 W ³⁾	
Fuse			3 A slow-blow, internal ⁴⁾	
Voltage range			24 VDC (-25 % / +30 %)	
Reverse polarity protection			Yes	
Electrical isolation		Ethernet (ETH1/IF1) to other interfaces, power supply and ground		Ethernet (ETH1/IF1 and EHT2/IF2) to other interfaces, power supply and ground
Operating conditions				
Permissible mounting orientations				
Standard mounting orientation			Vertical	
Inclination			±25°	
Rotation			In 90° increments (portrait/landscape)	
All other mounting orientations			With derating: Max. operating temperature minus 5°C	
Installation elevation above sea level				
0 to 2000 m			No limitation	
>2000 m			Reduction of ambient temperature by 0.5°C per 100 m	
Degree of protection per EN 60529			Front: IP65, Back: IP20	
Ambient conditions				
Temperature				
Operation			-20 to 60°C	
Storage			-20 to 80°C	
Transport			-20 to 80°C	
Relative humidity			See temperature/humidity diagram.	
Mechanical properties				
Front				
Design			Black	
Dimensions				
Width			271.5 mm	
Height			190 mm	
Depth			42.2 mm	
Weight			1.3 kg	


Table: Power Panel T50 - 10.1" variants - Technical data

- 1) Due to the power of the Power Panel, the following widget classes are fully supported: A, B.
- 2) At 25°C ambient temperature. Reducing the brightness by 50% can typically result in an approximately 50% increase in the half-brightness time.
- 3) Additional power consumption per USB interface: Max. 2.75 W (depending on the connected USB device)
- 4) The internal fuse cannot be replaced by the user or reset.

4.5.4 Temperature/Humidity diagram

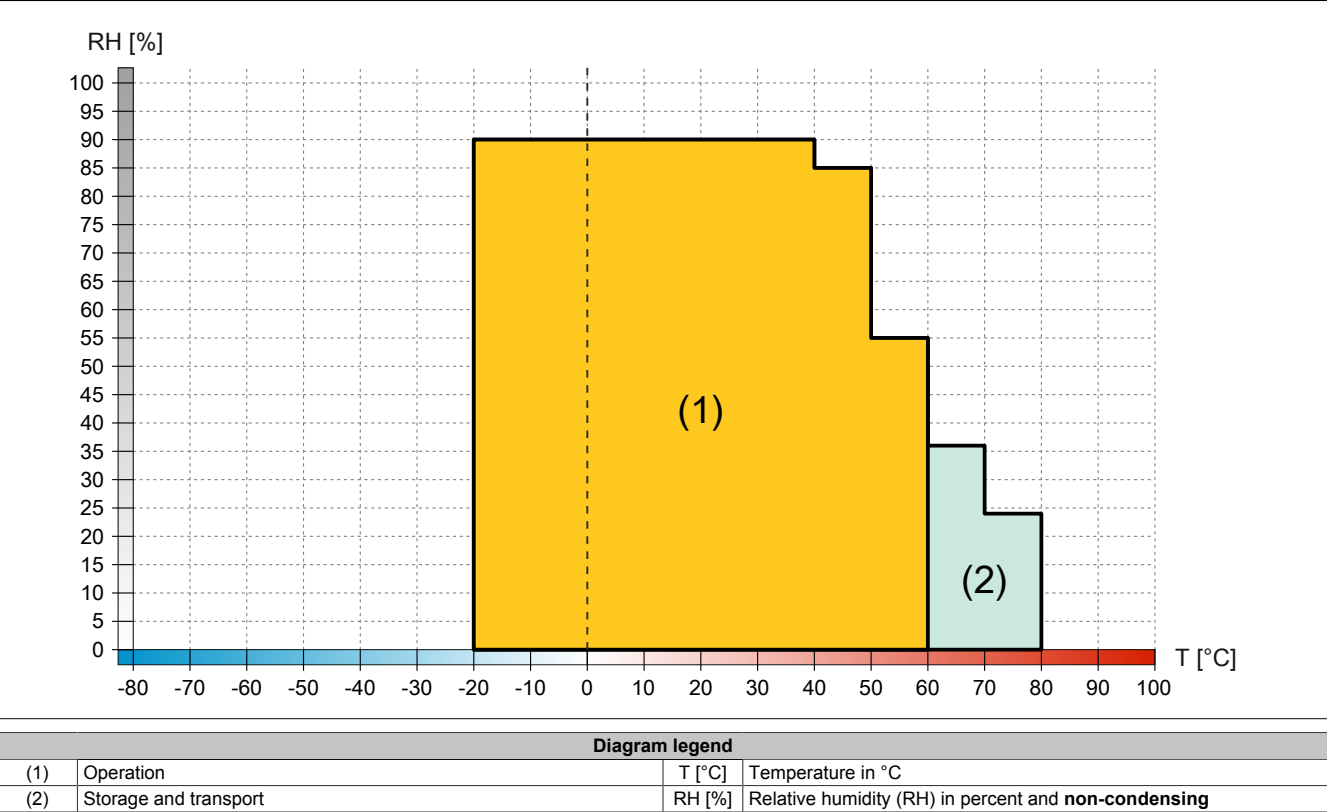

4.5.5 Dimensions

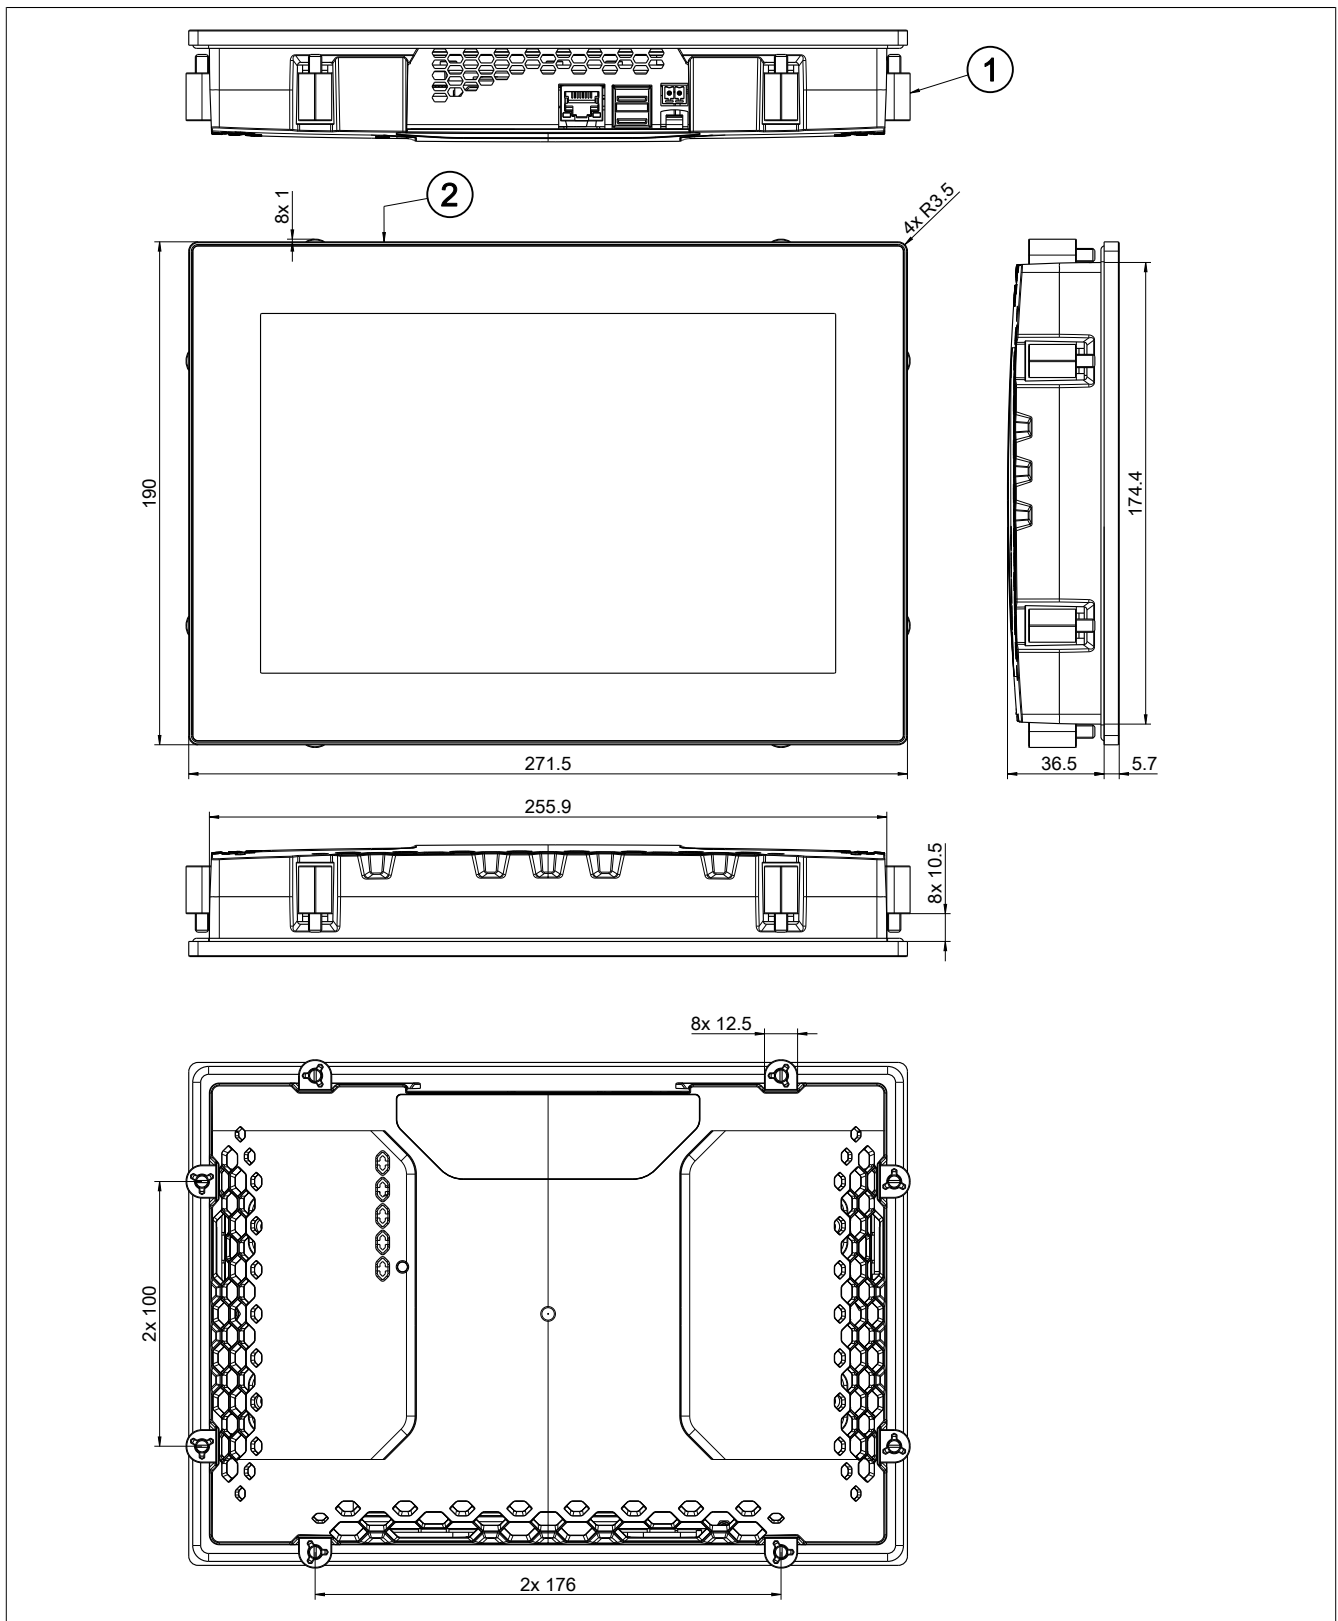

1 8x retaining clips with torque limiting

2 Anodized front plate E6/C8 (black)

Dimensions of the installation cutout for this Power Panel variant: 257.5 ±1 mm x 176 ±1 mm

See also ["Requirements for the installation cutout" on page 46.](#)

4.6 Power Panel T50 - 12.1" variants

4.6.1 Order data


Order number	Short description	Figure
	Power Panel T50	
6PPT50.121E-10B	Power Panel T50, 12.1", glass front, 1x Gigabit Ethernet. CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 12.1", 1280 x 800 (WXGA) resolution, projected capacitive touch screen, multi-touch support, glass front with black frame, landscape and portrait format configurable with software. Interfaces: 1x Ethernet 10/100/1000 Mbit/s, 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.	
6PPT50.121E-10A	Power Panel T50, 12.1", glass front (anti-glare), 1x Gigabit Ethernet. CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 12.1", 1280 x 800 (WXGA) resolution, projected capacitive touch screen, multi-touch support, anti-glare glass front with black frame, landscape and portrait format configurable with software. Interfaces: 1x Ethernet 10/100/1000 Mbit/s, 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.	
6PPT50.121E-16B	Power Panel T50, 12.1", glass front, 2x Gigabit Ethernet (integrated switch). CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 12.1", 1280 x 800 (WXGA) resolution, projected capacitive touch screen, multi-touch support, glass front with black frame, landscape and portrait format configurable with software. Interfaces: 2x Ethernet 10/100/1000 Mbit/s (integrated switch), 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.	
6PPT50.121E-16A	Power Panel T50, 12.1", glass front (anti-glare), 2x Gigabit Ethernet (integrated switch). CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 12.1", 1280 x 800 (WXGA) resolution, projected capacitive touch screen, multi-touch support, anti-glare glass front with black frame, landscape and portrait format configurable with software. Interfaces: 2x Ethernet 10/100/1000 Mbit/s (integrated switch), 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.	
	Included in delivery	
	Terminal blocks	
0TB6102.2110-01	Accessory terminal block, 2-pin (3.81), cage clamp terminal block 1.5 mm ²	
	Optional accessories	
	Other	
6ACCRPP2.0001-000	Installation kit for Power Panel T-Series variants: 9x retaining clips with torque limiting, 1x 2-pin cage clamp terminal block, 1x 2-pin screw clamp terminal block. See the accessories of the Power Panel variant in the corresponding data sheet or on the website.	
	Terminal blocks	
0TB6102.2010-01	Accessory terminal block, 2-pin (3.81), screw clamp terminal block 1.5 mm ²	
	USB accessories	
5MMUSB.2048-01	USB 2.0 flash drive 2048 MB B&R	
5MMUSB.4096-01	USB 2.0 flash drive 4096 MB B&R	

Table: Power Panel T50 - 12.1" variants - Order data

4.6.2 Content of delivery

Name	Quantity	Description
0TB6102.2110-01	1	Accessory terminal block, 2-pin (3.81), cage clamp terminal block 1.5 mm ²
-	1	Accessory set 8x retaining clip for fastening the panel in the installation cutout

4.6.3 Technical data

Order number	6PPT50.121E-10B	6PPT50.121E-10A	6PPT50.121E-16B	6PPT50.121E-16A
General information				
LEDs	Ethernet (Link, Activity, Speed)			
B&R ID code	0xF1F7	0xF1F9	0xF1F8	0xF1FA
Cooling	Passive			
Power button	No			
Reset button	No			
Buzzer	Yes			
Support				
mapp View	Yes ¹⁾			
Certifications				
CE	Yes			
UKCA	Yes			
UL	cULus E115267 Industrial control equipment			
DNV	Temperature: B (0 - 55°C) Humidity: B (up to 100%) Vibration: A (0.7 g) EMC: B (bridge and open deck)			
LR	ENV1			
ABS	Yes			
BV	EC31B Temperature: 5 - 55°C Vibration: 0.7 g EMC: Bridge and open deck			
EAC	Yes			
Controller				
Operating system	PPT50 system			
Real-time clock	No			
Processor				
Type	ARM Cortex-A9, dual core			
Clock frequency	800 MHz			
L1 cache	64 kB			
L2 cache	512 kB			
Flash	512 MB			
Mode/Node switches	No			
DRAM	1 GB (64-bit bandwidth)			
Display				
Type	TFT color			
Diagonal	12.1"			
Colors	16.7 million (RGB, 8 bits per channel)			
Resolution	WXGA, 1280 x 800 pixels			
Contrast	Typ. 800:1			
Viewing angles				
Horizontal	Direction L / Direction R = Typ. 80°			
Vertical	Direction U = Typ. 80° / Direction D = Typ. 65°			
Backlight				
Type	LED			
Brightness	Typ. 400 cd/m²			
Half-brightness time ²⁾	50,000 h			
Touch screen				
Type	Multi-touch			
Technology	PCT (projected capacitive touch)			
Surface	Glass, chemical-ly hardened (6H)	Glass, chemically hard-ened (6H), anti-glare	Glass, chemical-ly hardened (6H)	Glass, chemically hard-ened (6H), anti-glare
Screen rotation	Yes			
Interfaces				
Interface				
Connection	ETH1 (IF1)		ETH1 (IF1) and ETH2 (IF2)	
Type	Ethernet			
Variant	Shielded RJ45		Shielded RJ45 (integrated 2-port switch)	
Line length	Max. 100 m between 2 stations (segment length)			
Max. transfer rate	10/100/1000 Mbit/s			
Transfer				
Physical layer	10BASE-T / 100BASE-TX / 1000BASE-T			
Half-duplex	Yes			
Full-duplex	Yes			
Autonegotiation	Yes			
Auto-MDI/MDIX	Yes			

Table: Power Panel T50 - 12.1" variants - Technical data

Device description

Order number	6PPT50.121E-10B	6PPT50.121E-10A	6PPT50.121E-16B	6PPT50.121E-16A
Interface IF3				
Type		USB 2.0		
Variant		Type A		
Current-carrying capacity		0.5 A		
Interface IF4				
Type		USB 2.0		
Variant		Type A		
Current-carrying capacity		0.5 A		
Electrical properties				
Nominal voltage		24 VDC		
Power consumption		Typ. 9.3 W ³⁾		
Max. power consumption		11.4 W ³⁾		
Fuse		3 A slow-blow, internal ⁴⁾		
Voltage range		24 VDC (-25 % / +30 %)		
Reverse polarity protection		Yes		
Electrical isolation	Ethernet (ETH1/IF1) to other inter- faces, power supply and ground		Ethernet (ETH1/IF1 and EHT2/IF2) to oth- er interfaces, power supply and ground	
Operating conditions				
Permissible mounting orientations				
Standard mounting orientation		Vertical		
Inclination		±25°		
Rotation		In 90° increments (portrait/landscape)		
All other mounting orientations		With derating: Max. operating temperature minus 5°C		
Installation elevation above sea level				
0 to 2000 m		No limitation		
>2000 m		Reduction of ambient temperature by 0.5°C per 100 m		
Degree of protection per EN 60529		Front: IP65, Back: IP20		
Ambient conditions				
Temperature				
Operation		-20 to 60°C		
Storage		-20 to 80°C		
Transport		-20 to 80°C		
Relative humidity		See temperature/humidity diagram.		
Mechanical properties				
Front				
Design		Black		
Dimensions				
Width		324 mm		
Height		221.5 mm		
Depth		41.7 mm		
Weight		2.0 kg		

Table: Power Panel T50 - 12.1" variants - Technical data

- 1) Due to the power of the Power Panel, the following widget classes are fully supported: A, B.
- 2) At 25°C ambient temperature. Reducing the brightness by 50% can typically result in an approximately 50% increase in the half-brightness time.
- 3) Additional power consumption per USB interface: Max. 2.75 W (depending on the connected USB device)
- 4) The internal fuse cannot be replaced by the user or reset.

4.6.4 Temperature/Humidity diagram


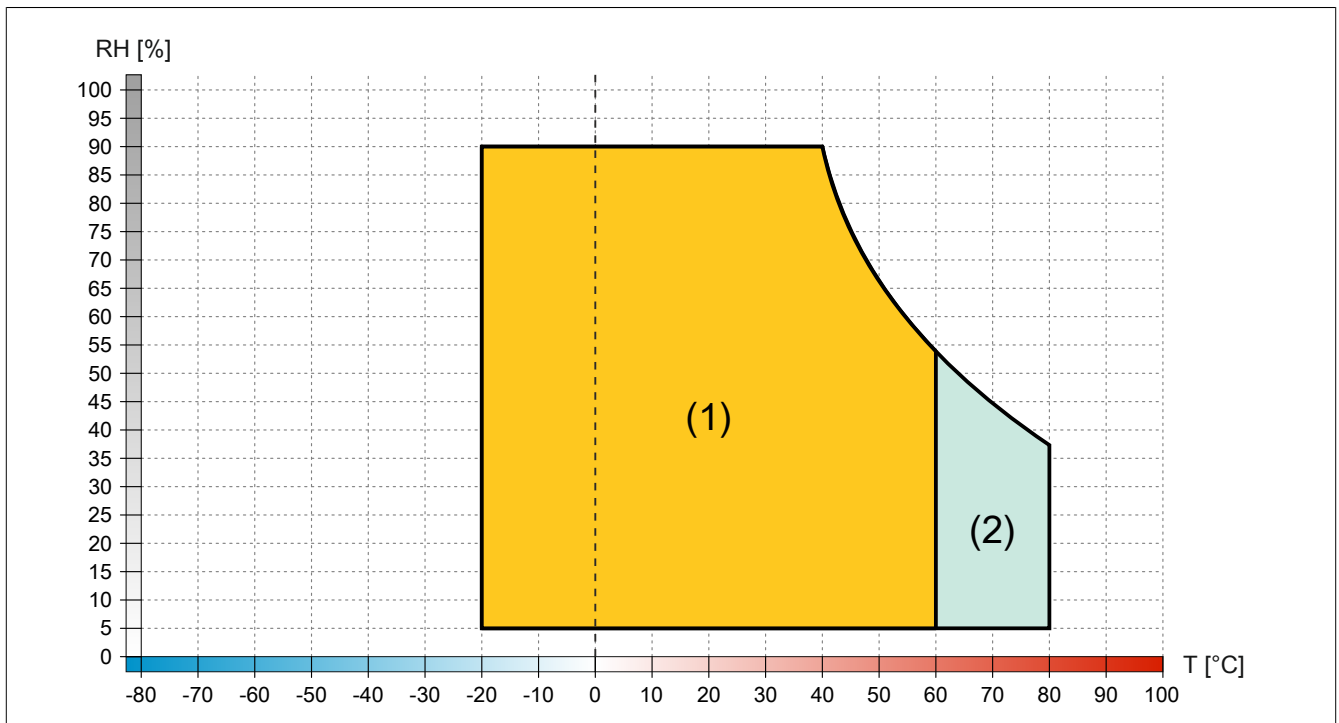


Diagram legend			
(1)	Operation	T [°C]	Temperature in °C
(2)	Storage and transport	RH [%]	Relative humidity (RH) in percent and non-condensing

4.6.5 Dimensions

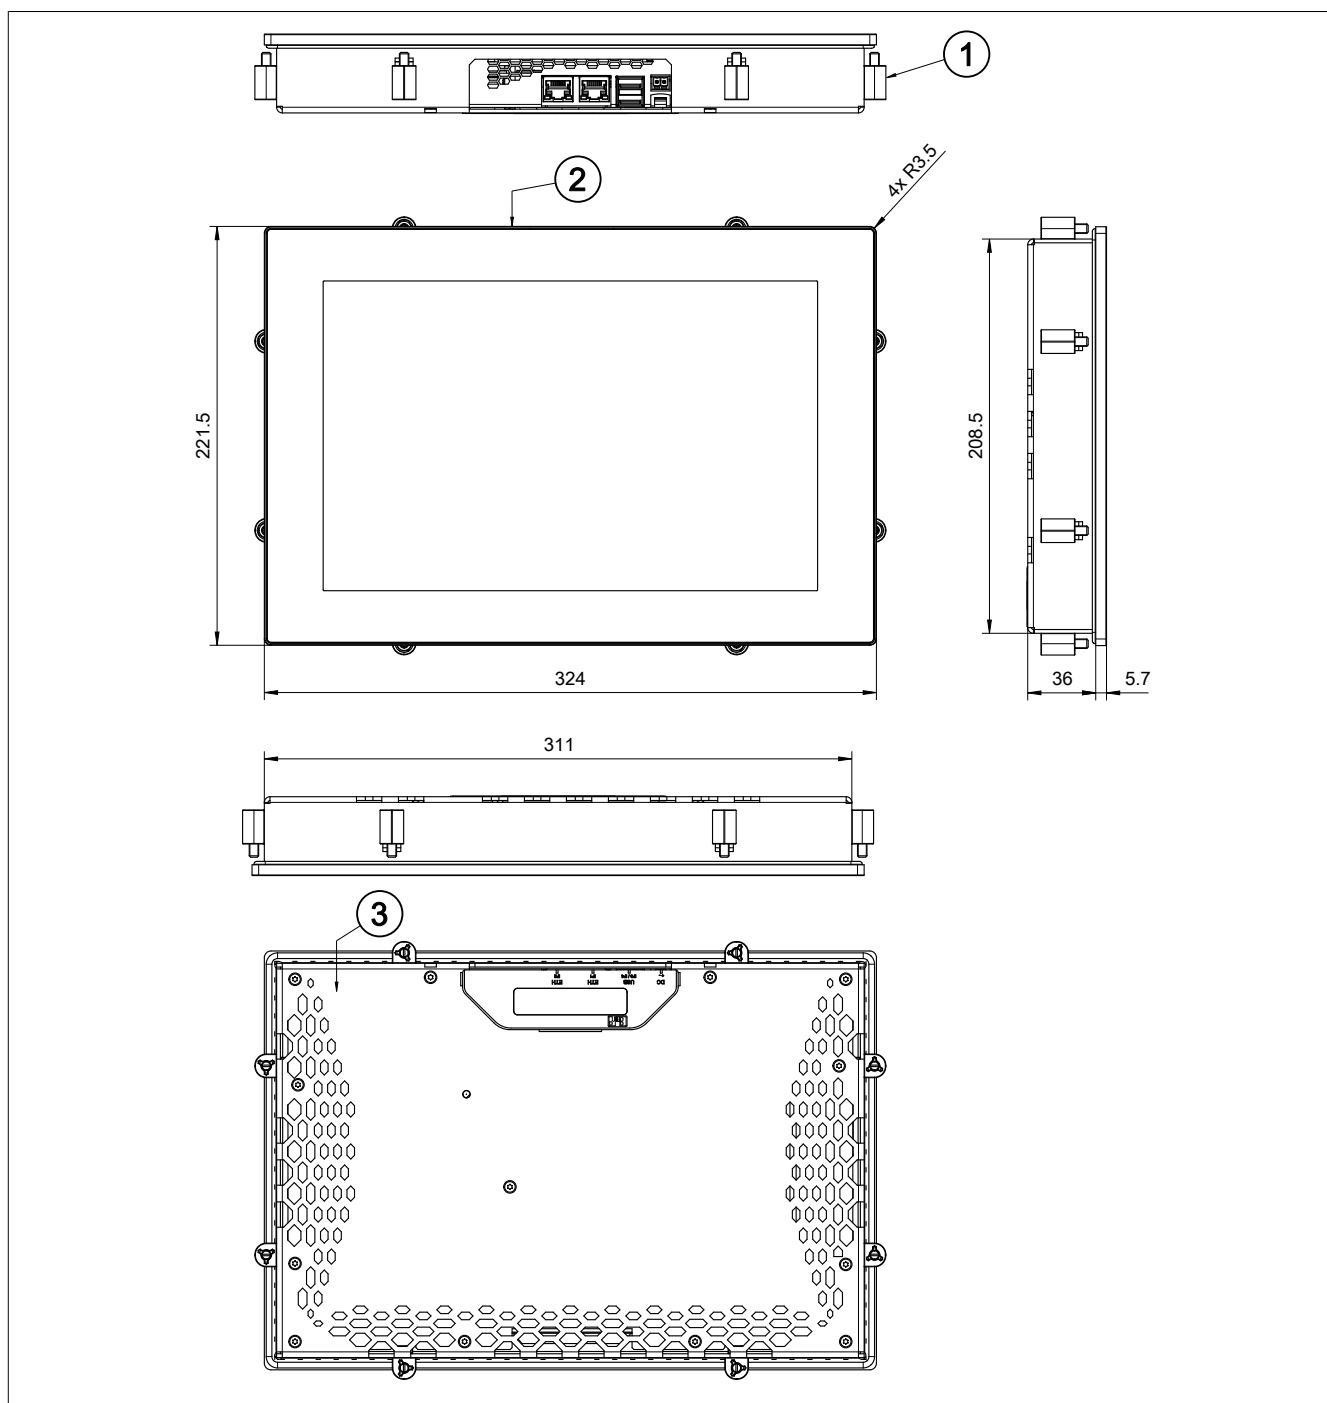

1	8x retaining clips with torque limiting
2	Anodized front plate E6/C8 (black)
3	Powder-coated cover, RAL 9005, fine structure, flat

Dimensions of the installation cutout for this Power Panel variant: 313 ±1 mm x 210.5 ±1 mm

See also ["Requirements for the installation cutout"](#) on page 46.

4.7 Power Panel T50 - 15.6" variants

4.7.1 Order data


Order number	Short description	Figure
	Power Panel T50	
6PPT50.156B-10B	Power Panel T50, 15.6", glass front, 1x Gigabit Ethernet. CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 15.6", 1366 x 768 (HD) resolution, projected capacitive touch screen, multi-touch support, glass front with black frame, landscape and portrait format configurable with software. Interfaces: 1x Ethernet 10/100/1000 Mbit/s, 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.	
6PPT50.156B-10A	Power Panel T50, 15.6", glass front (anti-glare), 1x Gigabit Ethernet. CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 15.6", 1366 x 768 (HD) resolution, projected capacitive touch screen, multi-touch support, anti-glare glass front with black frame, landscape and portrait format configurable with software. Interfaces: 1x Ethernet 10/100/1000 Mbit/s, 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.	
6PPT50.156B-16B	Power Panel T50, 15.6", glass front, 2x Gigabit Ethernet (integrated switch). CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 15.6", 1366 x 768 (HD) resolution, projected capacitive touch screen, multi-touch support, glass front with black frame, landscape and portrait format configurable with software. Interfaces: 2x Ethernet 10/100/1000 Mbit/s (integrated switch), 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.	
6PPT50.156B-16A	Power Panel T50, 15.6", glass front (anti-glare), 2x Gigabit Ethernet (integrated switch). CPU and memory: 800 MHz dual core (ARM Cortex-A9), 1 GB RAM, 512 MB onboard flash drive. Display and touch screen: 15.6", 1366 x 768 (HD) resolution, projected capacitive touch screen, multi-touch support, anti-glare glass front with black frame, landscape and portrait format configurable with software. Interfaces: 2x Ethernet 10/100/1000 Mbit/s (integrated switch), 2x USB 2.0. Client software: Integrated service page, VNC client, embedded web browser.	
	Included in delivery	
	Terminal blocks	
0TB6102.2110-01	Accessory terminal block, 2-pin (3.81), cage clamp terminal block 1.5 mm ²	
	Optional accessories	
	Other	
6ACCRPP2.0001-000	Installation kit for Power Panel T-Series variants: 9x retaining clips with torque limiting, 1x 2-pin cage clamp terminal block, 1x 2-pin screw clamp terminal block. See the accessories of the Power Panel variant in the corresponding data sheet or on the website.	
	Terminal blocks	
0TB6102.2010-01	Accessory terminal block, 2-pin (3.81), screw clamp terminal block 1.5 mm ²	
	USB accessories	
5MMUSB.2048-01	USB 2.0 flash drive 2048 MB B&R	
5MMUSB.4096-01	USB 2.0 flash drive 4096 MB B&R	

Table: Power Panel T50 - 15.6" variants - Order data

4.7.2 Content of delivery

Name	Quantity	Description
0TB6102.2110-01	1	Accessory terminal block, 2-pin (3.81), cage clamp terminal block 1.5 mm ²
-	1	Accessory set 9x retaining clip for securing the panel in the installation cutout
-	2	Cable clamps for securing / strain relief of connecting cables.

4.7.3 Technical data

Order number	6PPT50.156B-10B	6PPT50.156B-10A	6PPT50.156B-16B	6PPT50.156B-16A
General information				
LEDs	Ethernet (Link, Activity, Speed)			
B&R ID code	0xF1FB	0xF1FD	0xF1FC	0xF1FE
Cooling	Passive			
Power button	No			
Reset button	No			
Buzzer	Yes			
Support				
mapp View	Yes ¹⁾			
Certifications				
CE	Yes			
UKCA	Yes			
UL	cULus E115267 Industrial control equipment			
DNV	Temperature: B (0 - 55°C) Humidity: B (up to 100%) Vibration: A (0.7 g) EMC: B (bridge and open deck)			
LR	ENV1			
ABS	Yes			
BV	EC31B Temperature: 5 - 55°C Vibration: 0.7 g EMC: Bridge and open deck			
EAC	Yes			
Controller				
Operating system	PPT50 system			
Real-time clock	No			
Processor				
Type	ARM Cortex-A9, dual core			
Clock frequency	800 MHz			
L1 cache	64 kB			
L2 cache	512 kB			
Flash	512 MB			
Mode/Node switches	No			
DRAM	1 GB (64-bit bandwidth)			
Display				
Type	TFT color			
Diagonal	15.6"			
Colors	16.7 million (RGB, 8 bits per channel)			
Resolution	HD, 1366 x 768 pixels			
Contrast	Typ. 1000:1			
Viewing angles				
Horizontal	Direction L / Direction R = Typ. 85°			
Vertical	Direction U / Direction D = Typ. 85°			
Backlight				
Type	LED			
Brightness	Typ. 400 cd/m²			
Half-brightness time ²⁾	70,000 h			
Touch screen				
Type	Multi-touch			
Technology	PCT (projected capacitive touch)			
Surface	Glass, chemical-ly hardened (6H)	Glass, chemically hard-ened (6H), anti-glare	Glass, chemical-ly hardened (6H)	Glass, chemically hard-ened (6H), anti-glare
Screen rotation	Yes			
Interfaces				
Interface				
Connection	ETH1 (IF1)		ETH1 (IF1) and ETH2 (IF2)	
Type	Ethernet			
Variant	Shielded RJ45		Shielded RJ45 (integrated 2-port switch)	
Line length	Max. 100 m between 2 stations (segment length)			
Max. transfer rate	10/100/1000 Mbit/s			
Transfer				
Physical layer	10BASE-T / 100BASE-TX / 1000BASE-T			
Half-duplex	Yes			
Full-duplex	Yes			
Autonegotiation	Yes			
Auto-MDI/MDIX	Yes			


Table: Power Panel T50 - 15.6" variants - Technical data

Order number	6PPT50.156B-10B	6PPT50.156B-10A	6PPT50.156B-16B	6PPT50.156B-16A
Interface IF3				
Type			USB 2.0	
Variant			Type A	
Current-carrying capacity			0.5 A	
Interface IF4				
Type			USB 2.0	
Variant			Type A	
Current-carrying capacity			0.5 A	
Electrical properties				
Nominal voltage			24 VDC	
Power consumption			Typ. 15.7 W ³⁾	
Max. power consumption			22.1 W ³⁾	
Fuse			3 A slow-blow, internal ⁴⁾	
Voltage range			24 VDC (-25 % / +30 %)	
Reverse polarity protection			Yes	
Electrical isolation		Ethernet (ETH1/IF1) to other interfaces, power supply and ground		Ethernet (ETH1/IF1 and EHT2/IF2) to other interfaces, power supply and ground
Operating conditions				
Permissible mounting orientations				
Standard mounting orientation			Vertical	
Inclination			±25°	
Rotation			In 90° increments (portrait/landscape)	
All other mounting orientations			With derating: Max. operating temperature minus 5°C	
Installation elevation above sea level				
0 to 2000 m			No limitation	
>2000 m			Reduction of ambient temperature by 0.5°C per 100 m	
Degree of protection per EN 60529			Front: IP65, Back: IP20	
Ambient conditions				
Temperature				
Operation			-20 to 60°C	
Storage			-20 to 70°C	
Transport			-20 to 70°C	
Relative humidity			See temperature/humidity diagram.	
Mechanical properties				
Front				
Design			Black	
Dimensions				
Width			414 mm	
Height			258.5 mm	
Depth			41.7 mm	
Weight			3.1 kg	

Table: Power Panel T50 - 15.6" variants - Technical data

- 1) Due to the power of the Power Panel, the following widget classes are fully supported: A, B.
- 2) At 25°C ambient temperature. Reducing the brightness by 50% can typically result in an approximately 50% increase in the half-brightness time.
- 3) Additional power consumption per USB interface: Max. 2.75 W (depending on the connected USB device)
- 4) The internal fuse cannot be replaced by the user or reset.


4.7.4 Temperature/Humidity diagram

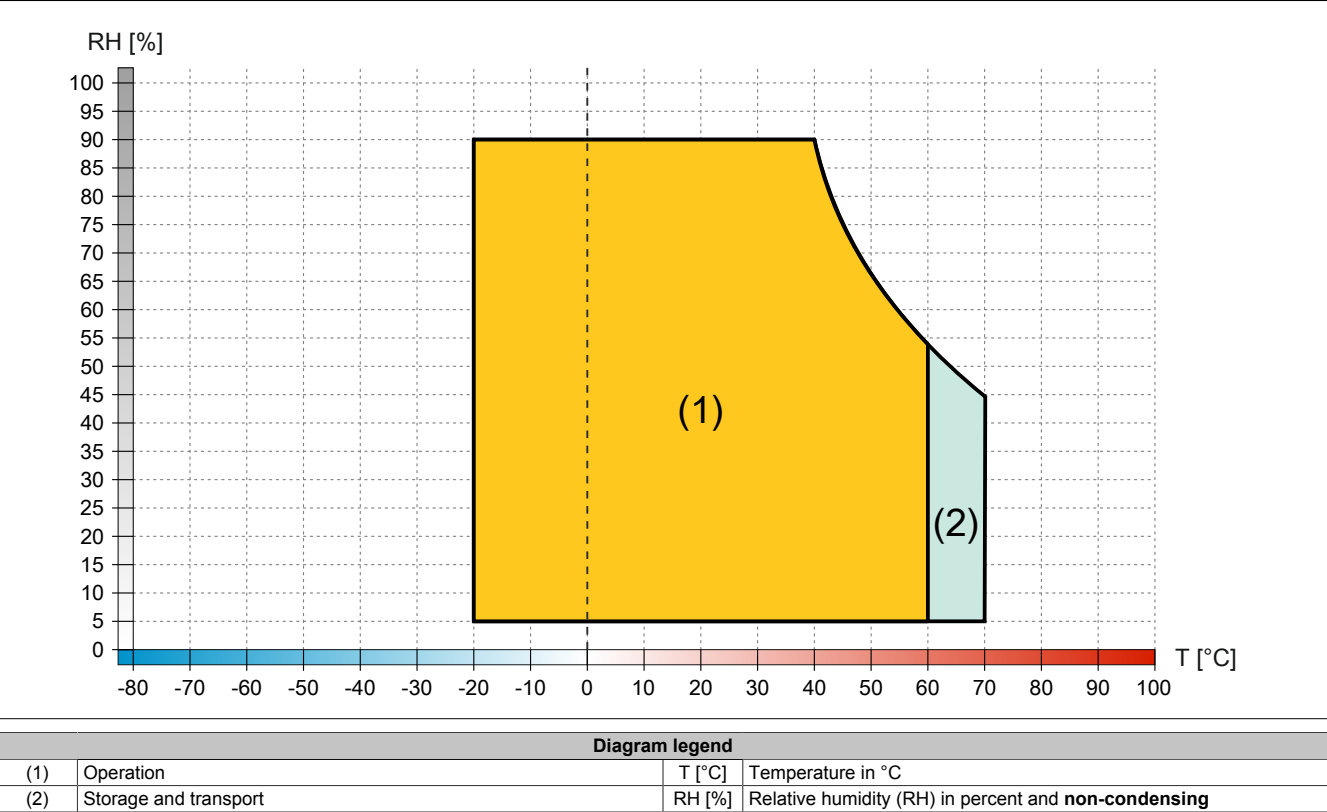

4.7.5 Derating of the display brightness

Display brightness of 15.6" variants

Operating the display at the maximum ambient temperature (see technical data) and maximum display brightness results in impairments in the display. The following derating of the display brightness must therefore be observed:

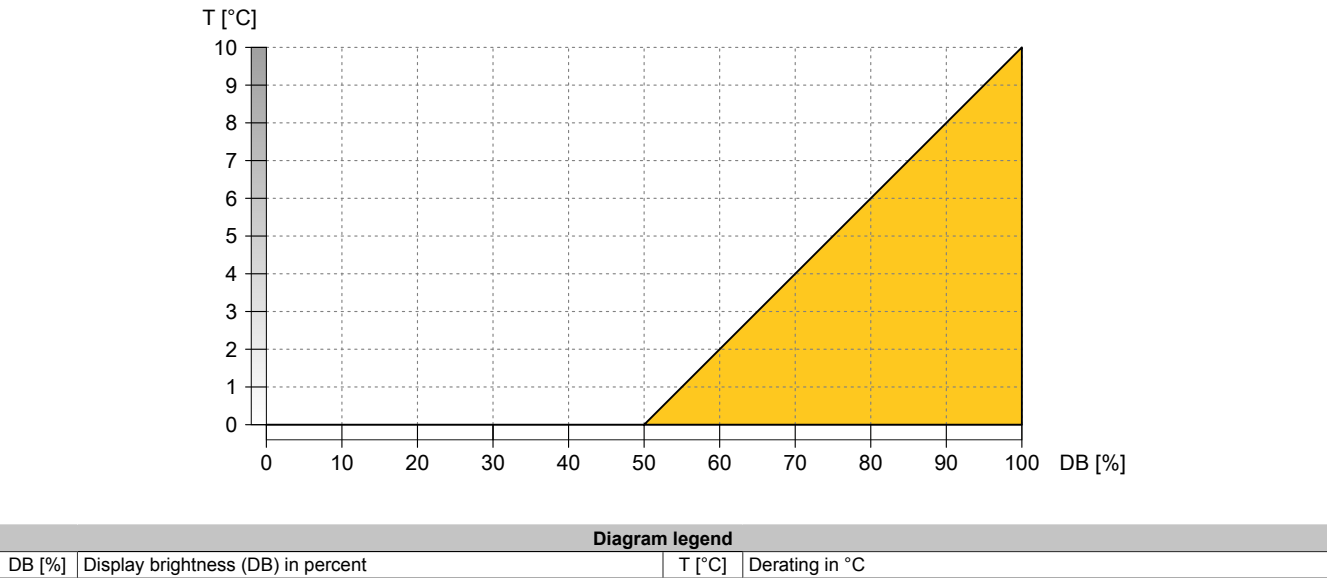

Information:

The display brightness can be derated in two ways:

- 1) Reducing the display brightness according to the max. ambient temperature.
- 2) Observing the maximum permissible ambient temperature for the selected display brightness.

Examples illustrating the two derating possibilities

Reduction of the display brightness


Example 1: If the Power Panel is operated at the maximum permitted ambient temperature, the display brightness must be reduced to 50%.

Example 2: If the ambient temperature is kept 5°C below the maximum permissible ambient temperature using appropriate measures, the display brightness must be reduced to at least 75%.

Reduction of the maximum permissible ambient temperature

Example 3: If the Power Panel should be operated continuously with a display brightness of 100%, appropriate measures must be taken to keep the ambient temperature at least 10°C below the maximum permitted ambient temperature.

4.7.6 Dimensions

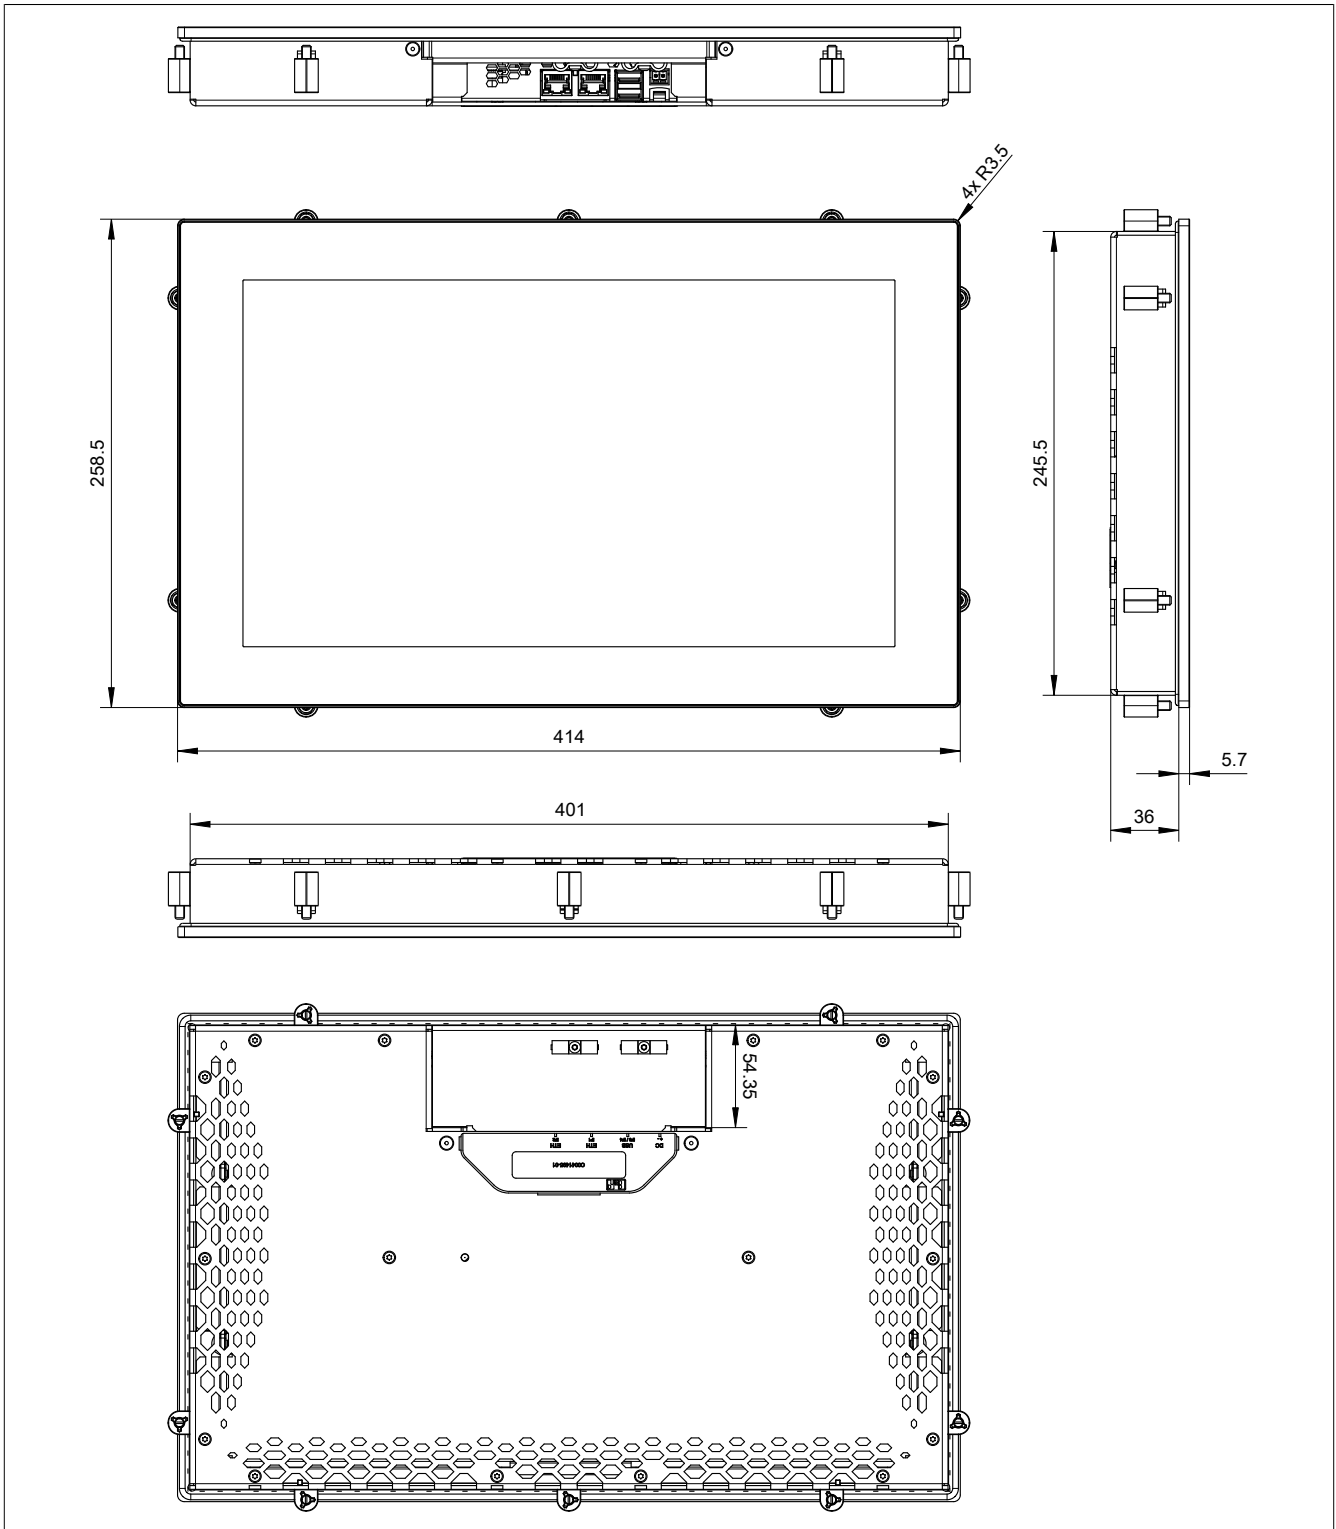


Device description

1	9x retaining clips with torque limiting
2	Anodized front plate E6/C8 (black)
3	Powder-coated cover, RAL 9005, fine structure, flat

Dimensions of the installation cutout for this Power Panel variant: 403 ±1 mm x 247.5 ±1 mm

See also "[Requirements for the installation cutout](#)" on page 46.

4.8 Connection elements

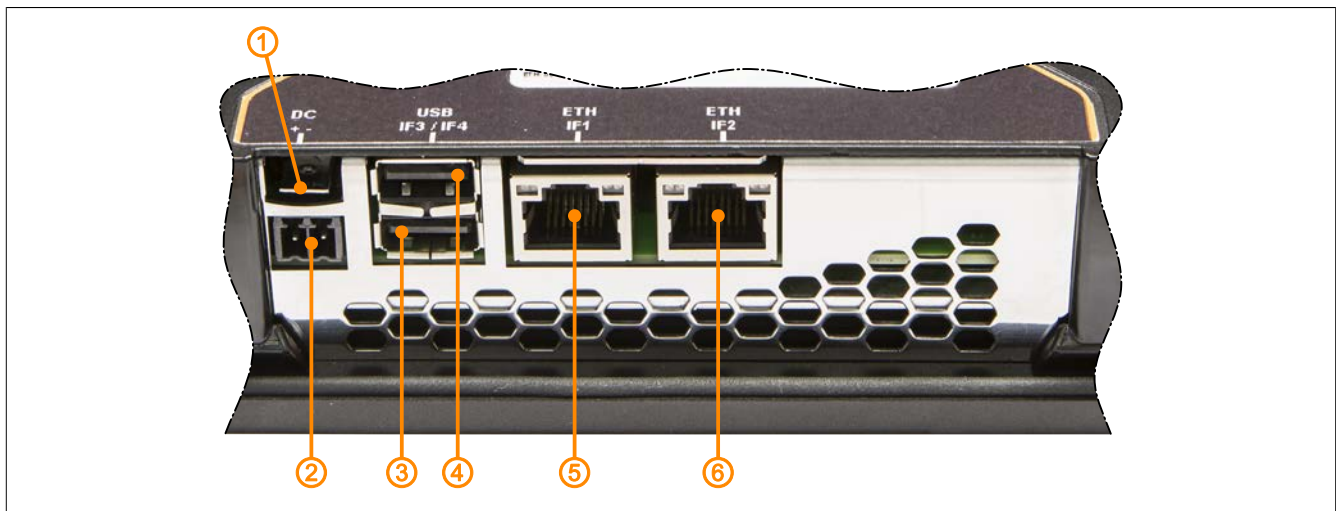

1	Grounding clip
2	Power supply
3	USB interface IF3
4	USB interface IF4
5	Ethernet interface IF1
6	Ethernet interface IF2 (depending on Power Panel variant)

4.8.1 Ethernet interface

Figure

Back

LNK/ACT

SPEED

Front (touch screen)

8 1

Shielded RJ45
(10BASE-T / 100BASE-TX / 1000BASE-T)

Pinout

Terminal	Ethernet		
1	D1+	Data 1+	
2	D1-	Data 1-	
3	D2+	Data 2+	
4	D3+	Data 3+	
5	D3-	Data 3-	
6	D2-	Data 2-	
7	D4+	Data 4+	
8	D4-	Data 4-	
Diagnostic LEDs			
LED	Color	Status	Description
SPEED	Transfer rate		
	Orange	On	1000 Mbit/s
	Green	On	100 Mbit/s
	Orange and green	Off	10 Mbit/s
LNK/ACT	Link/Activity		
	Green	On	Link established to an Ethernet network.
		Blinking	Link established to an Ethernet network and Ethernet activity taking place on the bus.
		Off	No link to an Ethernet network.


Danger!

External circuits connected to the device must be galvanically isolated from the low-voltage network or from life-threatening voltages by reinforced or double insulation and must meet the requirements of SELV/PELV circuits.

Information:

For all Ethernet connections, only connections within a building are permitted, taking into account maximum lengths.

4.8.2 USB interfaces

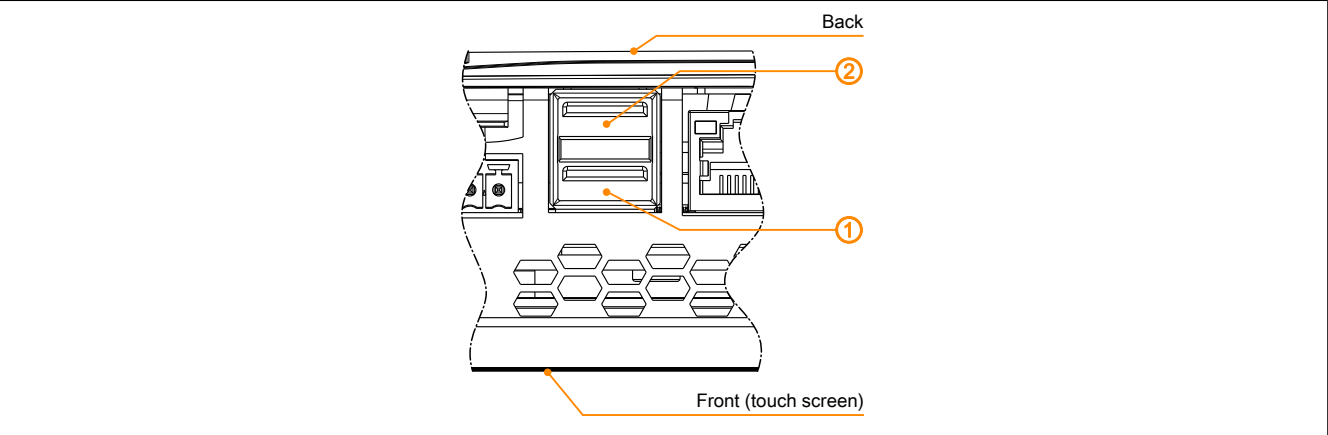

1	USB interface IF3
2	USB interface IF4

The Power Panel has a USB 2.0 host controller with 2 USB interfaces:

USB interface	
Transfer rate	Low speed (1.5 Mbit/s), full speed (12 Mbit/s) to high speed (480 Mbit/s)
Power supply	Max. 0.5 A per interface

Notice!

Possible damage to USB interfaces or USB devices!


- USB peripheral devices can be connected to the USB interfaces. Due to the variety of USB devices available on the market, B&R cannot guarantee their functionality. The functionality of USB devices available from B&R is ensured.
- Due to the general PC specification, these USB interfaces must be handled with the utmost care with regard to EMC, cable routing, etc.
- The device is only permitted to be operated with properly executed grounding (see "[Grounding \(functional ground\)](#)" on page 49).

4.8.3 Power supply

Danger!

The device is only permitted to be supplied with protective extra-low voltage (PELV).

Ground potential (grounding clip on the device) and the GND connection for the power supply are connected internally on the Power Panel.

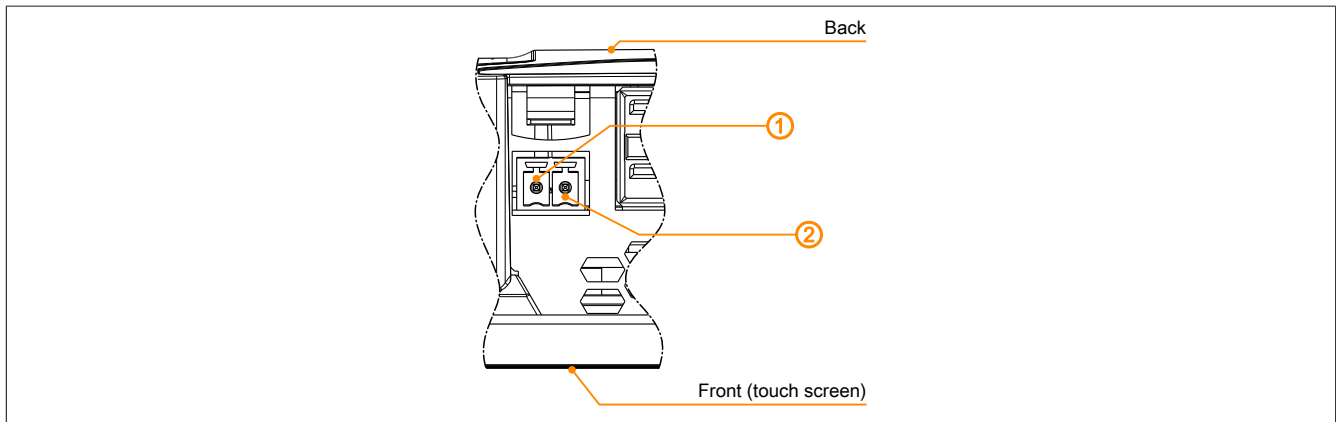

For the pinout of the power supply, see either the following table or the back of the Power Panel. The Power Panel is protected against incorrect connection of the supply voltage by reverse polarity protection, which prevents damage to the device.

Terminal	Pinout	Explanation
1	+	24 VDC
2	-	GND

Required accessories

0TB6102.2010-01	Accessory terminal block, 2-pin (3.81), screw clamp terminal block 1.5 mm ²
0TB6102.2110-01	Accessory terminal block, 2-pin (3.81), cage clamp terminal block 1.5 mm ²

The supply voltage is internally protected against supply voltage overload by a permanently soldered fuse (see technical data). The device must be sent to B&R for repairs if the fuse is destroyed in the event of error (fuse replacement).

5 Commissioning

5.1 Installation

Notice!

Possible damage to the device!

- Commissioning and maintenance work is only permitted to be carried out when the device is in a voltage-free state. To do this, disconnect the power cable from the power supply and from the device.
- Do not use excessive force! Handle all modules and components carefully.
- All covers and components, accessories, hardware and cables must be installed or secured before the device is connected to the power supply and switched on.
- Observe ESD instructions (see ["Protection against electrostatic discharge" on page 8](#)).

Important information about installation

- Observe climatic ambient conditions.
- Minimum distances for air circulation are not required. Cooling / Heat dissipation takes place in the device.
- Install the device on a flat, clean and burr-free surface.
- Observe the bend radius when connecting cables.
- Install the device so that it can be viewed optimally by the user (see viewing angle data in the technical data).

5.1.1 Requirements for the installation cutout

When installing the Power Panel, it is important to ensure that the surface and wall thickness meet the following conditions:

Installation cutout property	Value
Permissible deviation from evenness Note: This condition must also be observed when the device is installed.	≤0.5 mm
Permissible surface roughness in the area of the gasket	≤120 µm (Rz 120)
Min. wall thickness	2 mm
Max. wall thickness	6 mm

Notice!

The degree of protection provided by the device (see technical data) can only be maintained if it is installed in an appropriate housing that has at least the same degree of protection and in accordance with the above requirements.

Notice!

The device must ultimately be installed in a protective housing with sufficient rigidity (per UL 61010-1 and UL 61010-2-201).

5.1.2 Installing with retaining clips



Figure: Retaining clips (symbolic)

The retaining clips are designed for a certain thickness of the material to be clamped (max. 6 mm, min. 2 mm).

A large flat-blade screwdriver is needed to tighten and loosen the screw.

The device must be installed on a flat, clean and burr-free surface since tightening screws on an uneven area can result in damage to the display or the ingress of dust and water.

Procedure

1. Insert the device into the front of the prepared, burr-free and flat installation cutout. For the dimensions of the installation cutout, see section "Dimensions" for the individual devices.
2. Install the retaining clips on the device. To do this, insert the clips into the openings on the sides of the device (indicated by the orange circles). The number of openings may vary depending on the size of the device.

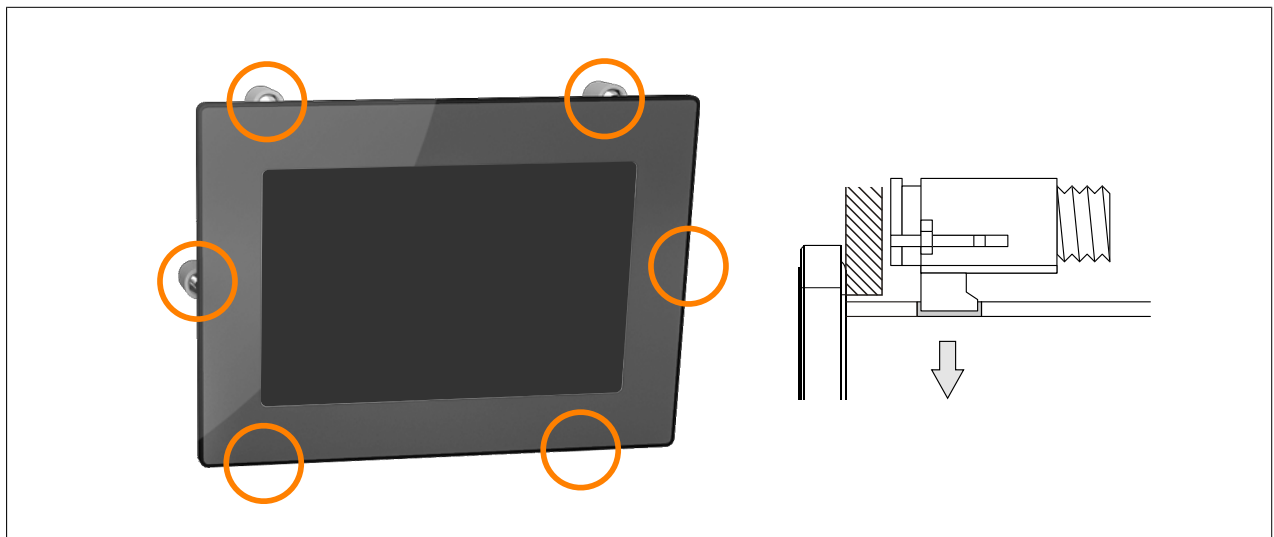


Figure: Inserting the retaining clips

3. Slide the retaining clips all the way to the back of the openings.

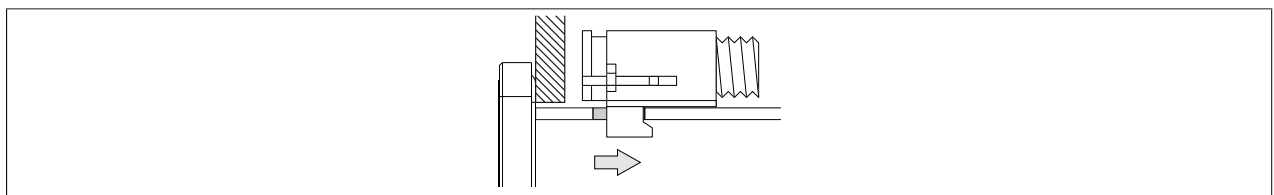


Figure: Sliding the retaining clips back

4. Secure the retaining clips to the wall or control cabinet panel by tightening the mounting screws with a flat-blade screwdriver.

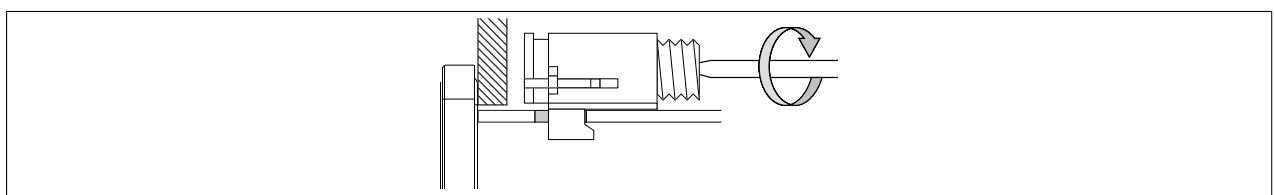


Figure: Securing the retaining clips

Torque limiting is built into the retaining clips.

- ✓ The retaining clip is secured correctly if the following conditions apply:
- As soon as torque limiting takes effect, the blade of the screwdriver is pushed out of the screw drive.
 - The screwdriver can no longer grip and further tightening is no longer possible.

Tightening torque of first device generation

Retaining clips without torque limiting are used in the first device generation. These must be secured with a max. tightening torque of 0.4 Nm.

Order number	6PPT50.0502-xxx	6PPT50.0702-xxx	6PPT50.101E-xxx	6PPT50.121E-xxx	6PPT50.156B-xxx
Panel size	5.0"	7.0"	10.1"	12.1"	15.6"
1. Device generation	<C0	<D0	<D0	<C0	<C0
2. Device generation	≥C0	≥D0	≥D0	≥C0	≥C0


5.1.3 Mounting orientations

Notice!

Possible damage to the device!

- Excessively high ambient temperature can result in damage to the device or malfunctions.
- For the maximum permissible ambient temperature, see the technical data for the respective device.

Vertical or tilted mounting orientation

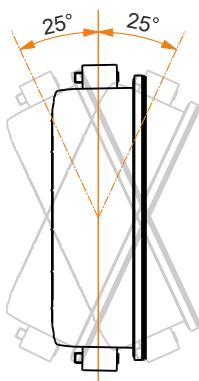

The device can be operated without derating (see ambient conditions in the technical data).

Other mounting orientations (horizontal, inclined, etc.)

The device can be operated in all other mounting orientations if derating up to the maximum operating temperature (see ambient conditions in the technical data) minus 5°C is maintained or the internal housing temperature is monitored by the application (see ["Temperature monitoring" on page 95](#)).

5.1.4 Grounding (functional ground)

Interference is effectively dissipated via a grounding clip. For additional information about electromagnetic compatibility, see the **INSTALLATIONS / EMC GUIDE** user's manual (MAEMV-ENG on the B&R website www.br-automation.com).

Notice!

Possible malfunction of interfaces and touch screen!

If functional ground is not present, faults in interface communication and touch screen functionality can occur.

The device is only permitted to be operated if properly grounded.

Grounding in the control cabinet

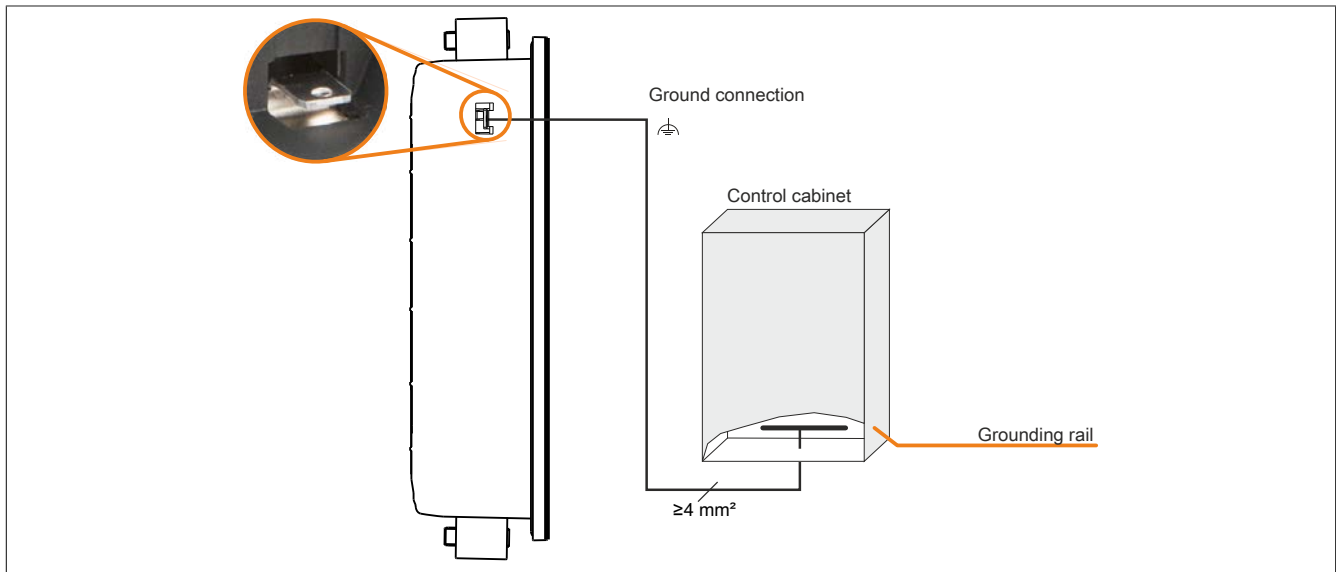


Figure: Grounding in the control cabinet

Notice!


The ground connection of the device must be low impedance and connected to ground (e.g. grounding rail in the control cabinet) using a short path.

5.1.5 Securing the connecting cables

Display size 15.6"

On Power Panel variants with 15.6" display size, cables can be relieved of tensile stress using the cable clamps provided on the back of the device.

For all other Power Panel variants, an appropriate method for securing the connecting cables in the vicinity of the device (control cabinet, machine, etc.) must be provided.

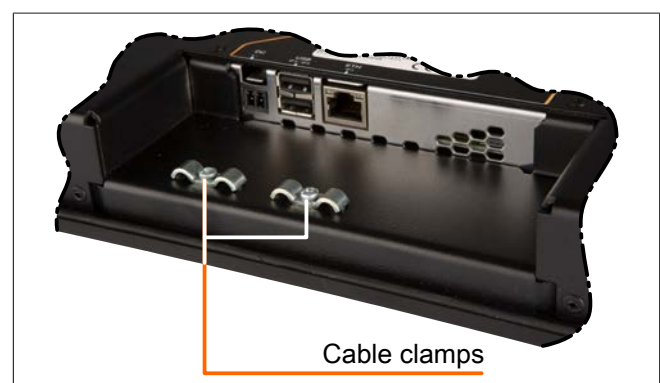

5.1.6 Requirements for the cables used

Notice!

To meet the UL certification requirements, copper cables must be used that are designed for an operating temperature $>70^{\circ}\text{C}$.

5.2 Operating the Power Panel

The following input methods can be used individually or together to operate the Power Panel:

- Touch screen
- USB keyboard
- USB mouse

5.2.1 Keyboard

Text can be entered using a USB keyboard or virtual keyboard.

The virtual keyboard is displayed as soon as a text input field (blinking text input cursor "|") has the focus.

q	w	e	r	t	y	u	i	o	p
a	s	d	f	g	h	j	k	l	↵
↑	z	x	c	v	b	n	m	⇐	
▼	.					,	?123	⇐	→

The [?123], [ABC], [1/2] and [2/2] keys can be used to open additional keyboard layouts:

1	2	3	4	5	6	7	8	9	0
*	#	+	-	=	()	"	~	↵
1/2	@	&	/	\	'	:	;	⇐	
▼	.					,	ABC	⇐	→

€	£	\$	¥	μ	§	<	>	[]
°	^		_	{	}	!	?	`	↵
2/2	'	%	‰	Σ	∅	·	±	⇐	
▼	.					,	ABC	⇐	→

5.2.2 Mouse

The mouse cursor automatically appears if a USB mouse is connected to the Power Panel.

If the left and right mouse buttons are pressed simultaneously for more than 2 seconds, the Power Panel navigates to the service pages.

6 Configuration

The Power Panel can be configured in the following ways:


- Via the service page of the Power Panel (see ["Service pages" on page 51](#))
- Via OPC UA (OPC UA server must be enabled beforehand)
- Via update:
 - ⇒ [Updating with Automation Studio and USB flash drive](#)
 - ⇒ [Updating with a downloaded from the website and USB flash drive](#)
 - ⇒ [Duplicating an existing setup using a USB flash drive](#)

6.1 Service pages

T-Series Power Panels can be configured via the integrated service page. This service page can be opened in various ways:

Opening the service page with a gesture

The service page can be opened with a [Gesture](#) if this is configured accordingly (see ["Configuring the gesture" on page 64](#)):

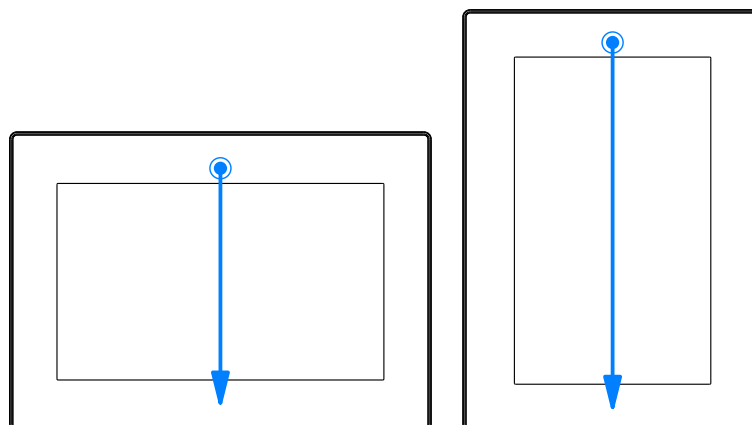

Gesture for opening the service page: Use a finger to swipe from the middle of the top edge of the touch screen down over the entire touch screen area.

The setting for *Screen rotation* on service page [Screen](#) is decisive for the swiping direction.


Other ways to open the service page

The following options are also available to open the service page:

- By pressing the left and right buttons of a connected USB mouse simultaneously for at least 2 seconds.
- Opened automatically after restarting the Power Panel if the corresponding *Start mode* is configured on service page *Startup* (see service page ["Startup" on page 56](#))

Entering the service password

If a service password has been configured in the settings (see ["Service page Security" on page 81](#)), then this password must be entered each time the service pages are opened before the service page is displayed.

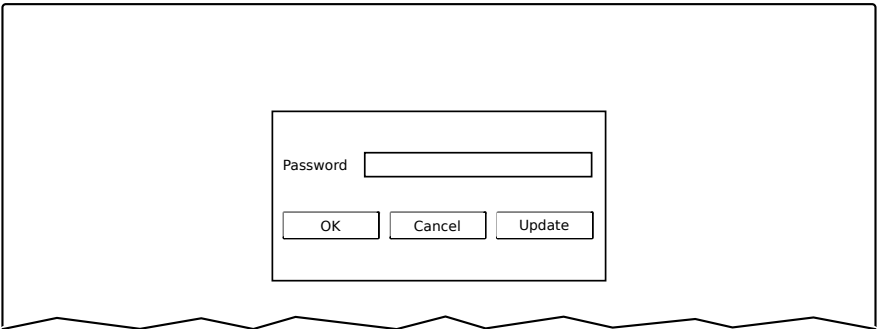

The service password must be entered in the corresponding text input field.

Button	Description
[OK]	Confirms password entry
[Cancel]	Cancels password entry
[Update]	When button "Update" is pressed, the Power Panel attempts to perform an update. This executes function <i>Update settings / boot logo / system</i> , which can also be opened on service page <i>Update</i> (see "Service page Update" on page 75). If an update is found (on a USB flash drive or on the network), it will be loaded and installed. In the next step, the Power Panel will be started in the configured mode (see "Service page Startup" on page 56) regardless of whether an update is found.

Representation of service pages in this documentation

In this documentation, service pages are not represented as original screenshots. For better readability, the service pages are displayed as black text on a white background:

Original screenshot of the Power Panel	Representation in this documentation
<div><div>Startup</div><div>Network</div><div>Time</div><div>Screen</div><div>Audio</div><div>Gesture</div><div>VNC</div><div>Web</div><div>Storage</div><div>Update</div><div>Backup & Reset</div><div>Security</div><div>Save & Exit</div><div>About & Info</div></div> <div><div>Hostname</div><div>Specify the name of the device on the network</div><div>DHCP</div><div>Use automatic network configuration</div><div>Activate DNS</div><div>Activate DNS service</div><div>DNS suffix</div><div>Get DNS from DHCP server</div></div> <div><div><div>✓</div></div><div><div>✓</div></div><div><div>✓</div></div></div>	<div><div>Startup</div><div>Network</div><div>Time</div><div>Screen</div><div>Audio</div><div>Gesture</div><div>VNC</div><div>Web</div><div>Storage</div><div>Update</div><div>Backup & Reset</div><div>Security</div><div>OPC UA</div><div>Save & Exit</div><div>About & Info</div></div> <div><div>Hostname</div><div>Specify the name of the device on the network</div><div>DHCP</div><div>Use automatic network configuration</div><div>Activate DNS</div><div>Activate DNS service</div><div>DNS suffix</div><div>Get DNS from DHCP server</div></div> <div><div><div>✓</div></div><div><div>✓</div></div><div><div>✓</div></div></div>

Language of the service pages

As can be seen in the previous service page example, all of the content on the service pages for the Power Panel is **generally in English**.

Saving the settings

Any settings changed on the service pages are not saved permanently while settings are still being edited. Saving only takes place permanently when one of the following commands is launched from service page [Save & Exit](#):

- *Save changes & exit*
- *Save changes*

See "[Service page Save & Exit](#)" on page 86.

Information:

Changes only become active after saving and exiting the service pages (command *Save changes & exit*).

Information:

All settings on the service pages are saved on the Power Panel in XML file `PPT50Config.xml`. When backing up or restoring the panel settings, a file with this name is created or expected to be on the storage medium (see "[Service page Backup & Reset](#)" on page 80 and "[Service page Update](#)" on page 75).

Input elements on the service pages

The screenshot displays a configuration menu on the left with items: Startup, Network, Time, Screen, Audio, Gesture, VNC, Web (highlighted), Storage, Update, Backup & Reset, Security, Save & Exit, and About & Info. To the right, the 'Web' service page is active, showing settings for Option 1, Option C, Audio (checkbox), Gesture (checkbox), VNC (checkbox), and Web (UpDown input field with value 50). Below these are text fields for 'Enter text here', 'Hostname', and a password field (masked with dots). At the bottom are two buttons, 'Button A' and 'Button B', and up/down navigation arrows.

1	Menu for selecting individual service pages "Startup", "Network", "About & Info", etc.
2	The active or selected service page is marked in the menu using a different background color.
3	The selection list indicates the selected option. Pressing the up/down arrows moves between the available options.
4	Checkbox not activated.
5	Checkbox activated.
6	UpDown input field for entering values within a certain range. The value can be increased/decreased using the "-" or "+" symbols. The value can also be changed directly using the keyboard.
7	Text field where text can be entered with the keyboard.
8	Text field where text can be entered with the keyboard. The "+" symbol can be used to add the entered text to a text list.
9	Text field for entering a password. The password will be displayed as plain text or wildcard characters (••••••) depending on the setting.
10	Button that can be used to trigger a specific function. Under the short title, a more detailed description of the function is displayed as gray text.
11	If the service page contains more elements than fit on the display, it is possible to scroll through the content using the up/down buttons.

To simplify operation, some text fields are enlarged during input (increased readability). The descriptive text to the left of the text field is hidden during this (covered up by the text field).

6.1.1 Overview

The following service pages are available:

Menu for the service pages	Menu option (English)	Description
Startup	Startup	Settings that take effect when the Power Panel is restarted
Network	Network	Settings for the Ethernet network
Time	Time	Time settings (time server, daylight savings time)
Screen	Screen	Screen settings (screensaver, rotation, etc.)
Audio	Audio	Buzzer settings
Gesture	Gesture	Enables/Disables a <i>gesture</i> for opening the service page
VNC	VNC	Settings for the VNC client on Power Panel
Web	Web	Settings for the web browser
Storage	Storage	Settings for accessing memory (USB flash drives, user memory)
Update	Update	Updates the Power Panel (manual)
Backup & Reset	Backup & Reset	Backs up Power Panel settings or resets the Power Panel to factory settings
Security	Security	Security settings (password query when opening the service page)
OPC UA	OPC UA	Settings for the OPC UA server of the Power Panel
Remote Access	Remote access	Enables/Disables and configures remote access
Save & Exit	Save & Exit	Saves the Power Panel settings and closes/exits the service page
About & Info	About & Info	Information about the Power Panel (PPT system version, licenses for the software being used)

6.1.2 Service page *Startup*

Startup	Start mode	Service page <input checked="" type="checkbox"/> <input type="checkbox"/>
Network	Specify the startup application	
Time		

The start mode is configured on service page *Startup* and determines how the Power Panel behaves after being switched on. The Power Panel is started in one of the following modes (*Start mode*) in accordance with this setting:

- *Service page* (default setting)
- *VNC*
- *Web*

Start mode *Service page* (default setting)

This setting is typically used during the development phase of an application because the service page is opened immediately after every Power Panel restart.

Start mode *VNC*

In this start mode, the Power Panel is started as a VNC client in order to display an HMI application made available on a VNC server.

In start mode *VNC*, option *Show boot logo* additionally configures whether the boot logo and boot animation of the system should be displayed while establishing the connection to the VNC server:

Startup	Start mode	VNC <input checked="" type="checkbox"/> <input type="checkbox"/>
Network	Specify the startup application	
Time	Show boot logo	<input type="checkbox"/>
Screen	Use boot logo / animation as VNC load screen	

Start mode *Web*

In start mode *Web*, a web browser that displays web server content is started immediately after restarting the Power Panel.

In start mode *Web*, option *Show boot logo* additionally configures whether the boot logo and boot animation of the system should be displayed while establishing the connection to the web server:

Startup	Start mode	Web <input checked="" type="checkbox"/> <input type="checkbox"/>
Network	Specify the startup application	
Time	Show boot logo	<input type="checkbox"/>
Screen	Use boot logo / animation as web load screen	

Boot logo or boot animation

For requirements and information about the boot logo and boot animation, see the following sections:

- ["Boot logo" on page 93](#)
- ["Boot animation" on page 94](#)

6.1.3 Service page *Network*

The default settings for service *Network* appear as follows:

Startup		
Network	Hostname Specify the name of the device on the network <input type="text"/>	
Time		
Screen	DHCP Use automatic network configuration <input checked="" type="checkbox"/>	
Audio		
Gesture	Activate DNS Activate DNS service <input checked="" type="checkbox"/>	
VNC		
Web	DNS suffix <input type="text"/>	
Storage	Get DNS from DHCP server <input checked="" type="checkbox"/>	
Update		

Information:

Network configuration changes do not require the Power Panel to be rebooted and are applied by the system and processed immediately after saving the settings and exiting the service pages (see ["Service page Save & Exit" on page 86](#)).

Hostname

Default setting: EMPTY (no hostname defined)

The Power Panel is identified in the network using its IP address or hostname. If a hostname is entered here, the Power Panel can be identified in the network using this name, which allows it to be accessed (e.g. by Automation Studio).

Important information:

- The hostname must be **unique** in the network.
- The name can have a maximum length of 64 characters.

Information:

If no hostname is defined (input field is empty), **6PPT50** is automatically used as the hostname.

DHCP

Default setting: Enabled

When the Dynamic Host Configuration Protocol (DHCP) is enabled, the network configuration is automatically obtained from the DHCP server and assigned to the Power Panel; otherwise, it must be entered manually (e.g. IP address of the device, IP address of the gateway, etc.).

For information about manual network configuration, see ["Network configuration without DHCP" on page 59](#).

Activate DNS²⁾

Default setting: Enabled

DNS usage of the device (DNS client) can be enabled or disabled with this option.

If a hostname is entered in [VNC](#) or [web](#) mode, this option must be enabled so the hostname of the VNC or web server can be resolved and the associated IP address can be obtained from the DNS server.

²⁾ In order to use DNS functionality, appropriate infrastructure must be available within the network.

For more information, please contact your network administrator.

If this option is disabled, the device can only be accessed using an IP address assigned by the DHCP. Options *DNS suffix* and *Get DNS from DHCP server* are not available in this case and will be hidden:

Startup	Hostname	Specify the name of the device on the network	_____
Network	DHCP	Use automatic network configuration	<input checked="" type="checkbox"/>
Time	Activate DNS	Activate DNS service	<input type="checkbox"/>
Screen			
Audio			
Gesture			

DNS suffix

Default setting: EMPTY

A DNS suffix is usually entered when a hostname is defined. The DNS suffix is specific to the network in which the device is being operated. Information about this must be obtained from the network administrator.

The hostname and the DNS suffix make up the full domain name (FQDN: fully qualified domain name) for the device:

```
hostname.dns-suffix
```

The full domain name could look like this, for example:

Hostname:	ppt-visualization-machine-01
DNS suffix:	network-domain.com
Fully qualified hostname (FQDN):	ppt-visualization-machine-01.network-domain.com

Get DNS from DHCP server

Default setting: Enabled

By default, the IP addresses for the DNS server are automatically obtained from the DHCP server.

If it is necessary to manually enter the IP addresses for the DNS server (without generally disabling DHCP), this can be done by disabling the option *Get DNS from DHCP server*.

Startup	Hostname	Specify the name of the device on the network	_____
Network	DHCP	Use automatic network configuration	<input checked="" type="checkbox"/>
Time	Activate DNS	Activate DNS service	<input checked="" type="checkbox"/>
Screen			
Audio			
Gesture			
VNC	DNS suffix		_____
Web	Get DNS from DHCP server		<input type="checkbox"/>
Storage	Primary DNS server		_____
Update	Secondary DNS server		_____
Backup & Reset	Tertiary DNS server		_____
Security			
OPC UA			
Remote Access			
Save & Exit			

Primary DNS server / Secondary DNS server / Tertiary DNS server

Default setting: EMPTY

The IP addresses for the DNS server.

This input option for the DNS server is only displayed if option *Activate DNS* is enabled.

6.1.3.1 Network configuration without *DHCP*

The entire network configuration can be completed manually by disabling option *DHCP*:

Startup	Hostname	Specify the name of the device on the network	_____
Network	DHCP	Use automatic network configuration	<input type="checkbox"/>
Time	Activate DNS	Activate DNS service	<input checked="" type="checkbox"/>
Screen	DNS suffix		_____
Audio	IP address		_____
Gesture	Subnet mask		_____
VNC	Default gateway		_____
Web	Primary DNS server		_____
Storage	Secondary DNS server		_____
Update	Tertiary DNS server		_____
Backup & Reset			
Security			
OPC UA			
Remote Access			
Save & Exit			
About & Info			

Information:

The data required for manual network configuration can be obtained from the network or system administrator.

Information:

IP addresses are checked for validity when they are entered. Only characters that build a valid IP address can be entered.

If the IP address entered is incomplete or the network configuration is incorrect, error messages will be output when starting up the device.

Hostname / DHCP / Activate DNS / DNS suffix

For a description of these options, see service page ["Network" on page 57](#).

IP address

Default setting: EMPTY

The IP address of the Power Panel within the network must be entered here.

Subnet mask / Default gateway

Default setting: EMPTY

Subnet mask and IP address of the default gateway.

Primary DNS server / Secondary DNS server / Tertiary DNS server

Default setting: EMPTY

The IP addresses for the DNS server.

This input option for the DNS server is only displayed if option *Activate DNS* is enabled.

6.1.4 Service page *Time*

Various settings for the time server and daylight saving time can be configured on this service page.

Startup	NTP client	<input type="checkbox"/>
Network		
Time	Adjust clock for daylight saving	<input type="checkbox"/>
Screen		
Audio	Time synchronization (GMT) Dublin, Edinburgh, Lisbon, London	
Gesture		

Information: The date and time can be set by the user using OPC UA method [SetTime](#).

NTP client

Default setting: Disabled

With this option, an NTP client can be enabled on the Power Panel that synchronizes the time on the Power Panel with a time server (NTP server).

After enabling the option, one to four NTP servers can be entered:

Startup	Activate ntp client	<input checked="" type="checkbox"/>
Network		
Time	NTP server 1	
Screen		
Audio	NTP server 2	
Gesture		
VNC	NTP server 3	
Web	NTP server 4	
Storage		

Synchronization takes place cyclically. The interval between synchronizations is increased as soon as a certain accuracy of the system time has been achieved.

Adjust clock for daylight saving

Default setting: Disabled

If this option is enabled, time changes related to daylight savings time take place automatically.

Time synchronization

Default setting: (GMT) Dublin, Edinburgh, Lisbon, London

When making a selection (via touch or mouse click), a list of all time zones is displayed and the appropriate one can be selected.

6.1.5 Service page Screen

On this service page, some settings for the display can be changed. The following graphic shows the default settings:

Startup	Display brightness	50	-	+
Network	0 to 100%			
Time	Screensaver			
Screen				
Audio	Screen rotation	0°	✓	^
Gesture	Specify the screen rotation angle			
VNC	Boot animation left pos	0	-	+
Web	Animation offset from left side in pixels			
Storage	Boot animation top pos	0	-	+
Update	Animation offset from top in pixels			
Backup & Reset	Boot animation delay	0	-	+
	Boot animation delay in ms			

Display brightness

Default setting: 50


Input range: 0 to 100

Unit: %

Here, the current brightness of the display and the basic setting for the display are set after restarting the device:

- Each change to a value on the service page directly and immediately affects the brightness of the display.
- The currently set value is only stored as the default setting for the device when saved (see ["Service page Save & Exit" on page 86](#)).

Setting 0% on the service page corresponds to a residual brightness of 20%:

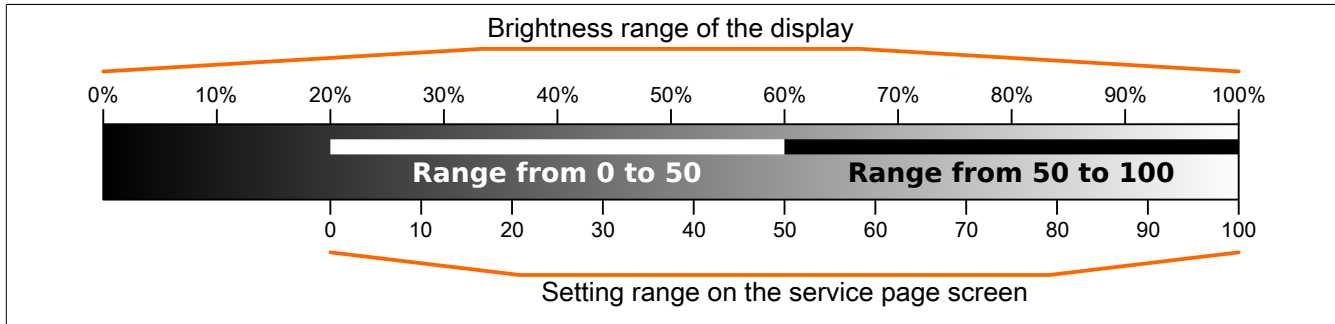

The brightness can also be controlled by the application (see ["Adjusting display brightness" on page 96](#)).

Screensaver

Default setting: Disabled

Options for the enabled screensaver are described in section ["Screensaver settings" on page 62](#).

Screen rotation

Default setting: 0°

Input range: 0°, 90°, 180°, 270° (in 90° steps)

The angle of rotation of the display is set here. This setting affects how screen content is output. After selection, the display content is rotated clockwise according to the specified angle.

Settings for the boot animation

These settings are used to configure the position and time delay for the boot animation:

Boot animation left pos							
Default setting	0						
Input range	0 to 2048 ¹⁾						
Unit	Pixels						
Function	Defines the distance from an existing boot animation to the left edge of the display.						
Boot animation top pos							
Default setting	0						
Input range	0 to 2048 ¹⁾						
Unit	Pixels						
Function	Defines the distance from an existing boot animation to the top edge of the display.						
Boot animation delay							
Default setting	0						
Input range	0 to 1000						
Unit	ms (milliseconds)						
Function	Delay in milliseconds between individual images in the GIF animation. The individual values have the following effect: <table border="1"> <thead> <tr> <th>Value [ms]</th><th>Description</th></tr> </thead> <tbody> <tr> <td>0</td><td>In this case, the delay defined in the GIF file will be used. If no delay is defined in the GIF file, 100 ms is used.</td></tr> <tr> <td>>0</td><td>Applies the set delay time.</td></tr> </tbody> </table> <p>It may not be possible to achieve small values due to the power limits of the device. In this case, the animation is displayed slower than the value specified.</p>	Value [ms]	Description	0	In this case, the delay defined in the GIF file will be used. If no delay is defined in the GIF file, 100 ms is used.	>0	Applies the set delay time.
Value [ms]	Description						
0	In this case, the delay defined in the GIF file will be used. If no delay is defined in the GIF file, 100 ms is used.						
>0	Applies the set delay time.						
Boot animation requirements/information							
See: " Boot animation " on page 94							

1) Reasonable values range from 0 to the width/height of the screen. The screen width/height depends on the used device and the configured *Screen rotation*.

6.1.5.1 Screensaver settings

If option *Screensaver* is enabled, additional options are displayed:

Startup	Display brightness	50	– +
Network	0 to 100%		
Time	Screensaver		✓
Screen			
Audio	Start screensaver after	15	– +
Gesture	1 to 60 minutes		
VNC	Screensaver type	Backlight off	✓ ^
W-L			

Start screensaver after

Default setting: 15

Input range: 1 to 60

Unit: Minutes

If there is no touch screen activity for the specified duration, the screensaver is started. Touching the screen exits the screensaver and the last active screen contents are shown.

Screensaver type

Default setting: Backlight off

If the screensaver is started after a period of inactivity, the display goes into the selected mode:

Black	The display is dark. The backlight remains on.
Backlight off	The display is dark. The backlight is switched off (result: lower power consumption).

6.1.6 Service page *Audio*

On this service page, an audio signal can be configured to be output when a touch operation occurs or controlled by an application.

Startup	Buzzer	<input type="checkbox"/>
Network		
Time		
Screen		
Audio		

Buzzer

Default setting: Enabled

If this option is disabled, an audio signal is not output when a touch operation occurs on the Power Panel.

The following settings can be made when *Buzzer* is enabled:

Startup	Buzzer	<input checked="" type="checkbox"/>
Network		
Time	Buzzer source	Touch <input checked="" type="checkbox"/> <input type="checkbox"/>
Screen		
Audio	Buzzer frequency 40 to 15000 Hz	500 <input type="button" value="-"/> <input type="button" value="+"/>
Gesture		
VNC	Buzzer duration 10 to 500 ms	25 <input type="button" value="-"/> <input type="button" value="+"/>
Web		
Storage	<div>Test buzzer Press to test</div>	

Buzzer source

Default setting: Touch

The following options are available for triggering a buzzer:

Touch	In VNC and web mode , an audio signal is output for each touch operation. This takes place independently of the application controlled by the Power Panel operating system.
App	The RFB extension and corresponding library can be used to allow the application to trigger the audio signal. See: "Outputting an audio signal" on page 96

Buzzer frequency

Default setting: 500

Input range: 40 to 15000

Unit: Hz

This setting is used to configure the frequency of the generated audio signal.

Buzzer duration

Default setting: 25

Input range: 10 to 500

Unit: ms (milliseconds)

This setting is used to configure the duration of the generated audio signal.

Test buzzer (button)

Function: Triggers the buzzer for testing purposes (sound is generated).

6.1.7 Service page *Gesture*

The settings on this service page configure the gesture for opening the service page:

Startup	Open service page <input checked="" type="checkbox"/>
Network	
Time	
Screen	
Audio	
Gesture	
VNC	
Web	

Information:

If this function is disabled, the service page can only be opened with a USB mouse or via an OPC UA method and restarting the panel!

Opens the service page with a gesture if option *Open service page* is enabled:

- See ["Opening the service page with a gesture" on page 51](#)

Open service page

Default setting: Enabled

Enabled	In VNC/web mode, the service page can be opened using this gesture.
Disabled	In VNC/web mode, the service page cannot be opened using this gesture. <div><p>Information:</p><p>A mouse must be connected in order to open the service page in VNC/web mode (see "Mouse" on page 50).</p></div>

6.1.8 Service page VNC

In order to use the Power Panel as a VNC client, some settings are necessary:

Server

Default setting: EMPTY (no server entered or selected)

In order to use the Power Panel as a VNC client, a hostname or IP address for the VNC server must be specified.

It is possible here to enter multiple servers in a list. Entering the hostname or IP address and then clicking on the [+] icon adds the specified server in the list at the end of this services page (see "vncserver1" and "vncserver2" in the previous image).

To use a specific VNC server from this list, it must be selected in the server list (via touch screen or mouse click). The currently selected VNC server is displayed in input field *Server*.

By default, port 5900 is used to establish a connection.

If the VNC-based HMI application is available on a different port, the port number must be specified explicitly together with the IP address or hostname:

Syntax	Example	Description
IP address:Port	10.23.19.48:5907	A VNC connection to IP address 10.23.19.48 is established on port 5907.
Hostname:Port	vncserver1:5908	A VNC connection to host vncserver1 is established on port 5908.

Information:

If the entered IP address is incomplete or no VNC server exists for the IP address or entered hostname, a corresponding message will be output if a connection attempt fails in VNC mode.

The error message is only output if display of the boot logo is disabled in start mode VNC.

Password

Default setting: EMPTY (no password entered)

Input range: Max. 100 characters

Note: Only one password can be entered, which is only used for the currently selected VNC server.

If a password has been entered, then the VNC client (Power Panel) is connected to the VNC server without an additional password query.

If no password has been entered, then the password will be queried on the Power Panel each time a connection to the VNC server is established.

The password is stored on the device in configuration file PPT50Config.xml .

Show password

Default setting: Disabled

Enabled	The password is displayed in the input field as plain text.
Disabled	The password is hidden in the input field by placeholder characters (●●●●●●).

Note: This option only switches the display of the password between plain text and wildcard characters. This option is not saved. This option is always disabled after restart.

Encrypt password

Default setting: Disabled

Enabled	The password is stored on the device in encrypted form.
Disabled	The password is stored on the device as plain text.

Use RFB extension

Default setting: Disabled

With the RFB extension enabled, a B&R VNC server (VNC-based HMI application) can query data from the VNC client and execute a variety of functions.

See: ["RFB extension" on page 95](#)

Enable connection monitor

Default setting: Disabled

Limitation: Enabling this option disables option *Use RFB extension*.

Enabled	Enables monitoring of the connection to the VNC server.
Disabled	Disables monitoring of connection to the VNC server.

See section ["VNC connection monitoring" on page 67](#).

Enable local window scaling

Default setting: Disabled

Enabled	Scales the VNC application to the display size of the Power Panel.
Disabled	Displays the VNC application in its original size on the Power Panel display.

Information:

Enabling this option results in a reduction in the performance of the Power Panel due to increased computing power.

Background color

Default setting: EMPTY

This setting can be used to set the background color of the VNC client on this Power Panel. If the VNC-based HMI application is smaller than the size of the Power Panel display, the background of the display (border around the HMI application) is shown with the defined background color.

Value	Background color
RGB color value ¹⁾	The RGB color value is noted as a three-digit (#rgb) or six-digit (#rrggbb) hexadecimal number, with the value preceded by the # character. The color value is composed of the red, green and blue values.
HTML/CSS color name ¹⁾	The color name corresponds to a specific RGB color value.
EMPTY	Light gray.
Invalid values	Black.

1) For the syntax of the RGB color value and valid HTML/CSS color names, see the HTML/CSS standard.

Examples of color values and color names:

#rrggbb	#rgb	HTML/CSS color name	Color display
#ffffff	#fff	white	
#ff0000	#f00	red	
#00ff00	#0f0	lime	
#008000	-	green	
#ffff00	#ff0	yellow	
#ff8800	#f80	-	
#0000ff	#00f	blue	
#000000	#000	black	

6.1.8.1 VNC connection monitoring

If the Power Panel is configured as a VNC client, the connection to the VNC server can be monitored. If the connection to the VNC server is lost, a loading screen is displayed with a message that the Power Panel is trying to reconnect.

Enabling VNC connection monitoring of a VNC client

VNC connection monitoring of a VNC client is enabled with one of the following two options:

Option	Description
<i>Use RFB extension</i>	Enabling the RFB extension developed by B&R for the VNC client also enables connection monitoring. The RFB extension can only be used together with a B&R VNC server. For additional information about installation, see section "RFB extension" on page 95.
<i>Enable connection monitor</i>	Without the RFB extension, this option can be enabled to enable VNC monitoring for the VNC client. This option also works with third-party VNC servers.

If several VNC clients are operated on one B&R VNC server, option *Use RFB extension* is only permitted to be enabled on one VNC client.

6.1.9 Service page *Web*

The Power Panel can be configured as a web client on this service page. In this case, a web browser is operated in full screen mode and an HMI application or other application running on a web server (e.g. mapp View) is displayed in the browser.

The following features are not supported:

- Java
- Flash

The web browser provides full JavaScript support!

The following figure shows service page *Web* with the default settings:

Startup	Server	webserverX	+
Network	IP address or hostname		
Time	Virtual keyboard		✓
Screen	Show virtual keyboard in web		
Audio	Disable pinch gesture		
Gesture	Disable zooming via pinch gesture		
VNC	Developer tools		
	Enable developer tools in browser (volatile setting)		
Web	Ignore server certificate errors		
Storage	No server certificate error warnings will be shown		
Update	Add client certificate	Press to add a client certificate from a USB flash drive	
Backup & Reset	Remove client certificate	Press to remove the client certificate from the system	
Security	Set/Override viewport settings		
OPC UA	Set or override viewport settings of loaded HTML page		
Remote Access	Enable Screen Capture		
Save & Exit	Enables the Screen Capture API of the browser		
About & Info			
	webserver1		-
	webserver2		-

Server

Default setting: EMPTY (no server entered or selected)

In order to use the Power Panel as a web client, a hostname or IP address for the web server must be specified.

It is possible here to enter multiple servers in a list. Entering the hostname or IP address and then clicking on the [+] icon) adds the specified server in the list at the end of this services page (see "webserver1" and "webserver2" in the previous image).

To use a specific web server from this list, it must be selected in the server list (via touch screen or mouse click). The currently selected web server is displayed in input field *Server*.

If a port number is not specified together with the server, port 80 is used by default.

If the web server is available on a different port, the port must be specified explicitly together with the IP address or hostname:

Syntax	Example	Description
IP address:Port	10.23.20.17:8080	A connection to IP address 10.23.20.17 is established on port 8080.
Hostname:Port	webserver1:8081	A connection to host webserver1 is established on port 8081.

Information:

If the entered IP address is incomplete or no web server exists for the IP address or entered hostname, then only the boot logo (if enabled) or standard animation of the web browser will be displayed when connecting to the web server.

Virtual keyboard

Default setting: Enabled

Enabled	The virtual keyboard is automatically displayed on the screen if a text input field in the web browser has the focus (see "Keyboard" on page 50).
Disabled	The virtual keyboard for the web page is automatically displayed if a text input field in the web browser has the focus. This functionality must be made available by the web server.

Input can also be made at any time using a connected USB keyboard.

Information:

The virtual keyboard is generated by the Power Panel system. If the web application (e.g. mapp View) contains its own on-screen keyboard, the virtual keyboard of the Power Panel should be disabled.

Disable pinch gesture

Default setting: Disabled

Enabled	The two-finger gesture for zooming the browser content is disabled. Zooming the entire HMI application is prevented. However, zoom is supported in some mapp View widgets (e.g. LineChart).
Disabled	The browser recognizes the well-known two-finger gesture (pinch-to-zoom) and allows zooming of the browser content.

Developer tools

Default setting: Disabled

Enabled	The next time the web browser is started (see setting <i>Start mode</i> on service page Startup), the developer tools are enabled. See " Using the developer tools " on page 72. Note: This setting is not permanently saved in the system settings and only valid until the next restart of the web browser.
Disabled	Developer tools are disabled.

Information:

Safety notice!

This option is for development purposes only while creating an HTML-based HMI application.

When using this option, it should be noted that the functions enabled in this way can be misused; it is therefore recommended to handle the developer tools with appropriate care.

It is possible to change the port used after enabling option *Developer tools*:

Gesture		
VNC	Developer tools Enable developer tools in browser (volatile setting)	<input checked="" type="checkbox"/>
Web	Developer tools port	9222 <input type="button" value="-"/> <input type="button" value="+"/>
Storage		

Developer tools port

Default setting: 9222

This setting defines the port used for the developer tools (see "[Using the developer tools](#)").

Ignore server certificate errors

Default setting: Disabled

If the web browser detects an error in the server certificate when establishing the connection to the web server, then the web browser displays a corresponding warning message that the user must acknowledge. If this option is enabled, such warning messages will be suppressed.

Use case:

If a self-signed server certificate is used during testing or development, it may be helpful to enable this option.

Add client certificate (button)

This function allows a client certificate to be stored on the device to authenticate the web browser on the server.

Saving the client certificate on the device:

1. Create a client certificate and copy it to a USB storage medium.
 2. Connect the USB storage medium to the device.
 3. Press button *Add client certificate*.
 4. Select the corresponding USB drive in the following dialog box.
 5. A list of all client certificates in the PKCS #12 standard (file extension ".p12") is displayed.
 6. After the desired client certificate is selected, the password must be entered.
If the client certificate was created without a password, the input field must remain empty.
- ✓ If all data is entered correctly, the certificate on the device is stored in the certificate store of the web browser.

Information:

If a client certificate already exists on the device, it is replaced by the new one.

Remove client certificate (button)

This function can be used to delete a client certificate stored on the device.

Deleting a client certificate from the device:

1. Press button *Remove client certificate*.
 2. A confirmation prompt appears querying whether the client certificate should be completely deleted from the device.
- ✓ After the confirmation prompt is confirmed, the client certificate is deleted from the device.

Set/Override viewport settings

Default setting: Disabled

This option is used to enable setting or overwriting the viewport settings. If this option is enabled, additional input field *Viewport settings* appears.

Information:

This setting is not needed for the majority of use cases. When using mapp View HMI applications, viewport settings are already set correctly and using this option is not necessary.

For HMI applications from third-party providers over which the user has no influence, it may be useful to enable this option and make the appropriate settings.

If option *Set/Override viewport settings* is active, a viewport meta tag provided with the HTML page is overwritten.

Viewport settings

Default setting: width=device-width, initial-scale=1.0

OPC UA	
Remote Access	Set/Override viewport settings Set or override viewport settings of loaded HTML page <input checked="" type="checkbox"/>
Save & Exit	
About & Info	Viewport settings Enter viewport settings for this device <input type="text" value="width=device-width, initial-scale=1.0"/> (content attribute of viewport meta tag)

The value of attribute content in the viewport meta tag is entered in the input field.

Example of a viewport meta tag as it may be contained in an HTML page:

```
<meta name="viewport" content="width=device-width, initial-scale=1.0">
```

This viewport meta tag is set if the following is entered in input field *Viewport settings*:

```
width=device-width, initial-scale=1.0
```

Note: The user must ensure that the syntax is correct. For detailed information about viewport settings and valid syntax, see relevant HTML documentation regarding responsive design.

Enable Screen Capture

Default setting: Disabled

This option enables the screen capture API of the built-in browser.

If this option is enabled, the HTML application can use the browser's screen capture API to create screen captures of the HMI application. Both individual and video recordings are possible.

If this option is enabled, option *Suppress Screen Capture security warning* is displayed:

Save & Exit	
About & Info	Enable Screen Capture Enables the Screen Capture API of the browser <input checked="" type="checkbox"/>
	Suppress Screen Capture security warning Hides the security warning for Screen Capture request <input type="checkbox"/>

Suppress Screen Capture security warning

Default setting: Disabled

By default, the browser displays a security warning when the HTML application starts a screen capture using the screen capture API. The user is prompted to permit or deny the screen capture.

This option can be used to disable this security warning.

6.1.9.1 Using the developer tools

The developer tools make it possible to access the browser from any remote computer over the network. Developer tools can help to edit pages on the fly and quickly diagnose problems.

Information:

To be able to use the developer tools, either [Google Chrome](#) or the [Chromium](#) is required.

Information about the functionality and use of the developer tools: [Chrome DevTools](#)

Enabling remote developer tools:

1. On service page [Startup](#), select start mode *Web*.
 2. Enable option *Developer tools* on service page [Web](#).
 3. Set a valid free port (*Developer tools port*).
 4. On service page [Save & Exit](#), save the settings and leave the service page with *Save changes & exit*.
- ✓ The web browser is started with the corresponding settings and enabled developer tools.

To use the remote developer tools, the following conditions must additionally be met:

- The Power Panel is accessible via the Ethernet network.
- The network and the computer used permit communication.
- A browser that supports the developer tools is required on the remote computer.

Launching the developer tools

If the developer tools are enabled and the web browser is started, the remote computer can launch the developer tools for the Power Panel browser with the following URL:

⇒ With the IP address of the Power Panel: `http://IP address:Port`

IP address	The IP address of the Power Panel is listed on service page About & Info .
Port	The port was defined on service page Web when enabling option <i>Developer tools</i> (default setting: 9222).

Additional functions

If the web browser on the Power Panel is running with developer tools enabled, the following additional features are enabled:

- ⇒ When using a USB mouse, a shortcut menu is opened with the right mouse button.
- ⇒ When using a USB keyboard, the following keys are also enabled:

[F5]	Refresh: Reloads the current browser window.
[Alt]+[Left]	One page back: Opens the previous page in the browser history.
[Alt]+[Right]	One page forward: Opens the next page in the browser history.

6.1.10 Service page *Storage*

On this service page, Power Panel memory can be shared to allow access from the network. The following memory areas can be shared for network access:

- Connected USB storage media
- Internal user memory

Sharing takes place using the **Common Internet File System (CIFS)** protocol. In this case, the Power Panel functions as a server and makes resources (a memory area) available to a client in the network using an access mechanism. CIFS uses a user, password and memory for authentication.

The client will require the following information to access the memory area shared on the Power Panel:

CIFS user	The CIFS user cannot be configured. "ppts50-user" must always be used as the CIFS user. Note: The username is device-specific. This is important to note if a device is replaced by a Power Panel from another family(e.g. T50 ► T80).	
CIFS password	The password configured on this service page is used.	
CIFS memory location	The following names can be used to specify the memory location:	
	Name	Description
	usbshare	USB storage medium connected to USB interface IF3.
	usbshare2	USB storage medium connected to USB interface IF4.
	usershare	Internal user memory (flash) on the Power Panel.

The USB storage medium must be formatted using the FAT32 file system.

The following figure shows the default settings for service page *Storage*:

Startup	Allow access to USB memory via network	<input type="checkbox"/>
Network		
Time	Allow access to user memory via network	<input type="checkbox"/>
Screen		
Audio	Password for network access Max. 100 characters	●●●●●●●●
Gesture	Show password	<input type="checkbox"/>
VNC		
Web	Encrypt password Save storage password in encrypted form	<input type="checkbox"/>
Storage		
Update		
Backup & Reset		

Allow access to USB memory via network

Default setting: Disabled

If this option is enabled, access to the connected USB storage medium will be shared on the network.

Allow access to user memory via network

Default setting: Disabled

If this option is enabled, access to the internal user memory will be shared on the network.

Password for network access

Default setting: EMPTY (no password entered)

Input range: Max. 100 characters

The CIFS password for network sharing is configured here. This password applies both for sharing the USB storage medium as well as internal user memory.

The password is stored on the device in configuration file PPT50Config.xml .

Show password

Default setting: Disabled

Enabled	The password is displayed in the input field as plain text.
Disabled	The password is hidden in the input field by placeholder characters (●●●●●●).

Note: This option only switches the display of the password between plain text and wildcard characters. This option is not saved. This option is always disabled after restart.

Encrypt password

Default setting: Disabled

Enabled	The password is stored on the device in encrypted form.
Disabled	The password is stored on the device as plain text.

6.1.11 Service page *Update*

Various parts of the system can be updated from a range of different sources on this service page.

Startup	Update settings / boot logo / system Press to update settings, boot logo, system
Network	
Time	Load settings from USB Press to load settings from a USB flash drive
Screen	
Audio	Load configuration from PLC Press to load configuration from a PLC
Gesture	
VNC	Load boot logo / animation Press to load boot logo / animation from a USB flash drive
Web	Update server type Specify the update server type
Storage	TFTP <input checked="" type="checkbox"/> <input type="checkbox"/>
Update	Get update server from DHCP server <input checked="" type="checkbox"/>
Backup & Reset	
Security	

Update settings / boot logo / system (button)

The Power Panel system is restarted with an update system. During the restart, the update files are searched for at the following sources in the specified order:

- 1) The USB storage medium connected to the Power Panel
For the update process, only 1 USB flash drive is permitted to be connected to the Power Panel.
- 2) On the configured update server (see ["Configuring the update server" on page 77](#))

The following update files are searched for:

File type	Filename
PPT image	PPT50Image.img.gz, PPT50Image.md5, PPT50Image.img.gz.sig (see "PPT image" on page 93)
System settings	PPT50Config.xml (see "System settings" on page 93)
Boot logo	PPTLogo.bmp.gz (see "Boot logo" on page 93)
Boot animation	PPTLogoA.gif (see "Boot animation" on page 94)

If valid update files are found during this search, they are loaded on the Power Panel and the system is restarted.

With this function, it is also possible to carry out a partial update if only a portion of the above-mentioned update files are on the USB flash drive.

Information:

If the current settings of the Power Panel should be retained, XML file PPT50Config.xml is not permitted to exist on the source medium.

Information:

It is generally only possible to install signed images on the Power Panel. If it is necessary to install an unsigned image, this must be explicitly allowed beforehand on service page [Security](#).

Load settings from USB (button)

If no USB storage medium is connected, an appropriate message is displayed.

If at least one USB storage medium is connected, then a dialog box with USB interfaces IF3 and IF4 is displayed. The name of the USB storage medium is also displayed to aid in selection. After the interface is selected, the settings are loaded from XML file PPT50Config.xml .

They can be checked and modified on the service pages if necessary after loading and before saving the settings. Data is stored using functions on service page [Save & Exit](#) (see ["Service page Save & Exit" on page 86](#)).

Load configuration from PLC (button)


This function searches for controllers in the network that have a valid configuration for a Power Panel. After the search is complete (a few seconds), the discovered controllers are listed:

Startup	Server 1	IP 10.0.0.1 MAC: 00 60 65 10 12 01
Network		
Time	Server 2	IP 10.0.0.2 MAC: 00 60 65 10 12 02
Screen		
Audio	Server 3	IP 10.0.0.3 MAC: 00 60 65 10 12 03
Gesture		
VNC	Server 4	IP 10.0.0.4 MAC: 00 60 65 10 12 04
Web		
Storage	Server 5	IP 10.0.0.5 MAC: 00 60 65 10 12 05
Update		

When selecting an entry, a list with the configurations of all Power Panels for the selected controller is displayed:

Startup	Server 1	IP 10.0.0.1 MAC: 00 60 65 10 12 01
Network		
Time	Config1	
Screen		
Audio		
Gesture		
VNC	Server 2	IP 10.0.0.2 MAC: 00 60 65 10 12 02
Web		

The names of the listed configurations match the names of the configurations in Automation Studio:

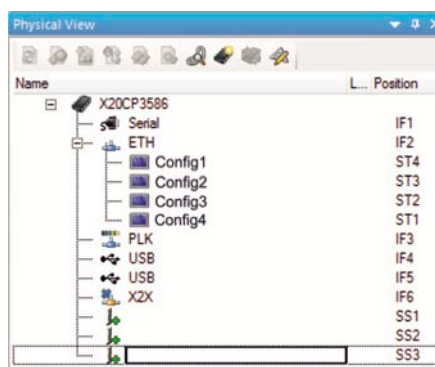

If a configuration entry is selected, a dialog box appears prompting to confirm the loading of the selected configuration. After the data is loaded, the application switches to service page **Save & Exit**. The loaded configuration can now be saved with a corresponding command (see section ["Service page Save & Exit" on page 86](#)). Alternatively, the user can check the loaded settings on all service pages before saving and change them if necessary.

Information:

In order for Power Panel configurations to be found on and loaded from controllers, the following requirements apply to these controllers:

- **SNMP is enabled (Ethernet interface configuration on the controller).**
- **TFTP is enabled (controller configuration).**

Load boot logo / animation (button)

If no USB storage medium is connected, an appropriate message is displayed.

If at least one USB storage medium is connected, then a dialog box with USB interfaces IF3 and IF4 is displayed. The name of the USB storage medium is also displayed to aid in selection. After the interface is selected, the boot logo and/or the boot animation are loaded and stored on the Power Panel.

The following syntax must be used for filenames:

File type	Filename
Boot logo	PPTLogo.bmp.gz (see "Boot logo" on page 93)
Boot animation	PPTLogoA.gif (see "Boot animation" on page 94)

If a boot logo and/or boot animation are already on the Power Panel, they will be overwritten.

6.1.11.1 Configuring the update server

The following figure shows the default settings for the configuration of the update server on service page *Update*:

Update server type

Default setting: *TFTP*

The following settings are possible:

TFTP	<i>TFTP</i> (Trivial File Transfer Protocol) is a very simple data transfer protocol.
FTP	<i>FTP</i> (File Transfer Protocol) offers more possibilities than <i>TFTP</i> .

Get update server from DHCP server

Default setting: Enabled

All information required by the update server for the configured type is requested from the DHCP server. This corresponds to the information that must be entered manually when the option is disabled (see the following two sections "Configuration of an update server of the type *TFTP* and *FTP*").

If this option is disabled, one or more additional input fields are displayed depending on the selected update server type. They are described in the following two sections:

6.1.11.1.1 Configuring an update server of type *TFTP*

If option *Get update server from DHCP server* is disabled and update server type *TFTP* is selected, input field *Hostname / IP address* is displayed:

The screenshot shows the configuration interface for the Power Panel T50. On the left is a sidebar with menu items: VNC, Web, Storage, Update (highlighted), Backup & Reset, Security, and OPC UA. The main content area is titled 'Press to load boot logo / animation from a USB flash drive'. It contains the following settings:

- Update server type:** Specify the update server type. The value is 'TFTP', with up and down arrow buttons next to it.
- Get update server from DHCP server:** A checkbox that is currently unchecked.
- Hostname / IP address:** An input field is present at the bottom of the configuration area.

Hostname / IP address

Default setting: EMPTY (no update server entered)

To update a Power Panel from a TFTP server, a hostname or IP address for the TFTP server must be specified.

By default, port 69 is used for the connection to the TFTP server.

If the TFTP server makes its services available on a different port, the port must be specified explicitly together with the IP address or hostname:

Syntax	Example	Description
IP address:Port	10.23.20.38:1069	A connection to IP address 10.23.20.38 is established on port 1069.
Hostname:Port	tftp-server:1169	A connection to the host tftp-server is established on port 1169.

Information:

If the entered IP address is incomplete or no TFTP server exists for the IP address or entered hostname, a message will be output that no network connection could be established if a connection attempt fails during the update process.

6.1.11.1.2 Configuring an update server of type *FTP*

If option *Get update server from DHCP server* is disabled and update server type *FTP* is selected, the following additional input fields are displayed:

FTP user

Default setting: EMPTY (no username entered)

To access an update server of type *FTP*, an FTP username must be entered here.

FTP password

Default setting: EMPTY (no password entered)

Input range: Max. 100 characters

To access an update server of type *FTP*, an FTP password must be entered here.

The FTP password is stored on the device in configuration file PPT50Config.xml .

Show password

Default setting: Disabled

Enabled	The password is displayed in the input field as plain text.
Disabled	The password is hidden in the input field by placeholder characters (••••••).

Note: This option only switches the display of the password between plain text and wildcard characters. This option is not saved. This option is always disabled after restart.

Encrypt password

Default setting: Disabled

Enabled	The password is stored on the device in encrypted form.
Disabled	The password is stored on the device as plain text.

Hostname / IP address

Default setting: EMPTY (no update server entered)

To update a Power Panel from an FTP server, a hostname or IP address for the FTP server must be specified.

The FTP connection is generally established via standard port 21 on the FTP server.

It is not possible to enter other ports!

Information:

If the entered IP address is incomplete or no FTP server exists for the IP address or entered hostname, a message will be output that no network connection could be established if a connection attempt fails during the update process.

6.1.12 Service page *Backup & Reset*

On this service page, individual parts or the entire system can be backed up or restored. A factory reset is also possible:

Startup	Back up settings Press to back up settings to a USB flash drive
Network	
Time	Back up boot logo / animation Press to back up boot logo / animation to a USB flash drive
Screen	
Audio	Back up system Press to back up system to a USB flash drive
Gesture	
VNC	Full backup Press to back up settings, boot logo / animation and system to a USB flash drive
Web	
Storage	Reset to factory defaults Press to restore factory defaults
Update	
Backup & Reset	Reset boot logo / animation Press to restore factory boot logo / animation

Information:

Only settings that have already been saved with a function of service page *Save & Exit* are taken into account and backed up when a backup is created. Unsaved service page settings are not backed up.

Back up settings (button)

Accessing this function creates a backup of the settings and stores it on the USB storage medium.

Back up boot logo / animation (button)

Accessing this function creates a backup of the boot logo and stores it on the USB storage medium.

Back up system (button)

When this function is executed, a backup of the PPT system is created and stored on the USB storage device as a PPT image (without signature) .

Information:

Creating a backup can take several minutes.

Full backup (button)

Accessing this function creates a full backup of the system, its settings and boot logo and stores it on the USB storage medium.

Information:

Creating a backup can take several minutes.

Reset to factory defaults (button)

Accessing this function loads the factory default settings. The device is thus reset to a defined state:

- User settings (server names and hostnames, passwords, etc.) are deleted.
- Boot logos are deleted.
- The client certificate of the web browser is deleted.

Information:

The current settings made on the service pages are not saved and will be lost.

Reset boot logo / animation (button)

Accessing this function resets the boot logo and the boot animation to the factory default settings (summary screen).

6.1.13 Service page *Security*

Startup	Service password	●●●●●●●●
Network	Password for setup changes	
Time	Max. 100 characters	
Screen	Show password	<input type="checkbox"/>
Audio	Encrypt password	<input type="checkbox"/>
Gesture	Save security password in encrypted form	
VNC	Allow untrusted images	<input type="checkbox"/>
Web	Enable installation of unsigned images (volatile setting)!	
Storage		
Update		
Backup & Reset		
Security		
OPC UA		
Remote Access		

Service password

Default setting: EMPTY (no password entered)

Input range: Max. 100 characters

The service password is used to secure access to the service pages (see ["Entering the service password" on page 52](#)).

The password is stored on the device in configuration file PPT50Config.xml .

Show password

Default setting: Disabled

Enabled	The password is displayed in the input field as plain text.
Disabled	The password is hidden in the input field by placeholder characters (●●●●●●).

Note: This option only switches the display of the password between plain text and wildcard characters. This option is not saved. This option is always disabled after restart.

Encrypt password

Default setting: Disabled

Enabled	The password is stored on the device in encrypted form.
Disabled	The password is stored on the device as plain text.

Allow untrusted images

Default setting: Disabled

Disabled	Only signed images can be installed on the device.
Enabled	If this option is enabled, an unsigned image can be installed (see service page "Update" on page 75). This option is not saved in the system settings and immediately disabled after exiting the service pages.

This function is necessary to install a system backup created earlier on the device, for example (backups are generally saved without a signature).

6.1.14 Service page *OPC UA*

The OPC UA server can be enabled/disabled on this service page:

Startup

Network

Time

Screen

Audio

Gesture

VNC

Web

Storage

Update

Backup & Reset

Security

OPC UA

Remote Access

Save & Exit

OPC UA server

OPC UA server port

Identify token

Choose the identify token type

4840

Anonymous

☒

-

+

✓

^

OPC UA server

Default setting: Disabled

If this setting is enabled, options *Port* and *Identify token* are available.

Either the hostname specified on service page *Network* or the IP address entered there must be used as the address for the OPC UA server.

Notice!

The OPC UA server is stopped while the Power Panel service page is active.

Port

Default setting: 4840

The port number used to reach the OPC UA server of the Power Panel is specified here.

Identify token

Default setting: *Anonymous*

The following selections are available for option *Identify token*:

Anonymous	The OPC UA server can be reached within the network without authentication.
Username	The OPC UA server can only be accessed within the network by specifying a username and password.

Additional input fields are displayed if option *Username* is selected:

Screen

Audio

Gesture

VNC

Web

Storage

Update

Backup & Reset

Save & Exit

Identify token

Choose the identify token type

User

Password

OPC UA server password

Max. 100 characters

Show password

Username

✓

^

●

●

●

●

●

●

●

●

●

●

☐

User

Default setting: EMPTY (no username entered)

For access with authentication, a username must be entered here.

Password

Default setting: EMPTY (no password entered)

Input range: Max. 100 characters

For access with authentication, a password must be entered here.

The password is stored on the device in configuration file PPT50Config.xml .

Show password

Default setting: Disabled

Enabled	The password is displayed in the input field as plain text.
Disabled	The password is hidden in the input field by placeholder characters (●●●●●●).

Note: This option only switches the display of the password between plain text and wildcard characters. This option is not saved. This option is always disabled after restart.

6.1.15 Service page *Remote Access*

This service page is used to enable/disable and configure remote access for the Power Panel:

Startup	Remote access	<input checked="" type="checkbox"/>
Network		
Time	Back end	WebGL <input checked="" type="checkbox"/> <input type="checkbox"/>
Screen	Choose the remote access back end	
Audio	Back end port	8080 <input type="button" value="-"/> <input type="button" value="+"/> <input type="button" value="0"/>
Gesture		
VNC	Back end WebSocket port	8081 <input type="button" value="-"/> <input type="button" value="+"/> <input type="button" value="0"/>
Web	User	user
Storage		
Update	Password	
Backup & Reset	Remote access user password	
	Max. 100 characters	
Security	Show password	<input type="checkbox"/>
OPC UA		
Remote Access	Encrypt password	<input type="checkbox"/>
Save & Exit	Save remote access password in encrypted form	
About & Info	Mode	View <input checked="" type="checkbox"/> <input type="checkbox"/>
	Choose the remote access mode	

The following options are available when remote access is enabled:

- Displaying the display content of the Power Panel on a remote client.
- Operating the Power Panel from a remote client with mouse and keyboard.

Information:

Remote access within the network where the Power Panel is located takes place using an unencrypted and non-secure protocol.

The network must be secured accordingly, and corresponding security measures (e.g. VPN access to the network) are strongly recommended for external access.

Remote access

Default setting: Disabled

Enabled	Remote access to the Power Panel is enabled.
Disabled	Remote access to the Power Panel is disabled.

The following remote access settings can be changed regardless of whether this option is enabled or disabled.

Back end

Default setting: *WebGL*

The following choices are available for option *Back end*:

WebGL	Enables remote access via web browser. The Web Graphics Library (WebGL) interface is used for this.
VNC	Allow remote access via VNC client.

Back end port

Default setting: See the following table.

This defines the port number used by the remote client to access the Power Panel.

Port number	Back end = WebGL	Back end = VNC
1024 - 65,535	Default port: 8080	Default port: 5900
	Valid range for entering the port number. Inputs outside this range are not possible.	

Back end WebSocket port (if Back end = WebGL)

Default setting: See the following table.

This defines the port number used by the remote client to establish WebSocket communication between the web browser and Power Panel.

Port number	Back end = WebGL
1024 - 65,535	Default port: 8081
	Valid range for entering the port number. Inputs outside this range are not possible.

User

Default setting: user

A username must be entered at this point for access with authentication.

Password

Default setting: EMPTY (no password entered)

Input range: Max. 100 characters

A password must be entered at this point for access with authentication.

The password is stored on the device in configuration file PPT50Config.xml .

Show password

Default setting: Disabled

Enabled	The password is displayed in the input field as plain text.
Disabled	The password is hidden in the input field by placeholder characters (●●●●●●).

Note: This option only switches the display of the password between plain text and wildcard characters. This option is not saved. This option is always disabled after restart.

Encrypt password

Default setting: Disabled

Enabled	The password is stored on the device in encrypted form.
Disabled	The password is stored on the device as plain text.

Mode

Selects the remote access operating mode:

	Display of content	Operation with mouse and keyboard
View	Yes	No
Control	Yes	Yes

6.1.16 Service page **Save & Exit**

On this page, the settings currently made or modified on service pages can be saved using *Save*. *Exit* leaves the service pages, and the Power Panel starts in the configured start mode (see "[Service page Startup](#)" on page 56).

Startup	Save changes & exit Press to save changes and exit
Network	
Time	Save changes Press to save changes
Screen	
Audio	Exit without saving Press to exit without saving changes
Gesture	
VNC	
Web	
Storage	
Update	
Backup & Reset	
Security	
OPC UA	
Remote Access	
Save & Exit	
About & Info	

Save changes & exit (button)

All changes that have been made are saved and the Power Panel is started with the specified settings (see "[Service page Startup](#)" on page 56)

Save changes (button)

All changes made are saved. The service pages are not exited, and other settings can be made.

Exit without saving (button)

Changes made are not saved and will be lost. The Power Panel starts as configured with the last settings that were saved (see "[Service page Startup](#)" on page 56).

6.1.17 Service page *About & Info*

Startup	System date 2022-11-21
Network	
Time	System time 16:00:00
Screen	
Audio	Temperature 0 46.000°C
Gesture	
VNC	Model number 6PPT50.101E-16B
Web	
Storage	Serial number F0123456789
Update	Hardware revision C0
Backup & Reset	
Security	MAC address 01:23:45:67:89:ab
OPC UA	
Remote Access	IP address 123.45.67.89
Save & Exit	
About & Info	Image version 1.6.0
Signed image Yes	
Bootloader version gf850fad	
<div>Show license Press to show license</div>	

The following information about the Power Panel is displayed on this service page:

System date	Current date						
System time	Current time						
Temperature 0	CPU core temperature (SoC temperature)						
Model number	Device number / model number / order number						
Serial number	Serial number of the device						
Hardware revision	Hardware revision						
MAC address	MAC address of the network interface						
IP address	IP address currently being used in the network						
Image version	Version number of the PPT system (PPT image)						
Signed image	Information about whether a signed or unsigned image is installed on the Power Panel: <table border="1"> <tr> <td>Yes</td><td>A signed image is installed.</td></tr> <tr> <td>No</td><td>An unsigned image is installed.</td></tr> <tr> <td>Not supported</td><td>The Power Panel does not support signed images. This means that the signature is not checked.</td></tr> </table>	Yes	A signed image is installed.	No	An unsigned image is installed.	Not supported	The Power Panel does not support signed images. This means that the signature is not checked.
Yes	A signed image is installed.						
No	An unsigned image is installed.						
Not supported	The Power Panel does not support signed images. This means that the signature is not checked.						
Bootloader version	Version number of the bootloader						

SoC) SoC ... System on a chip


Show license (button)

Accessing this function displays the licenses of the software components used on the Power Panel.

6.2 Update

When updating the Power Panel with a USB flash drive, it is important to note that the drive must have a capacity of at least 256 MB. In addition, an industrial-grade USB flash drive must be used (see "Storage media" on page 142).

6.2.1 Updating with Automation Studio and USB flash drive

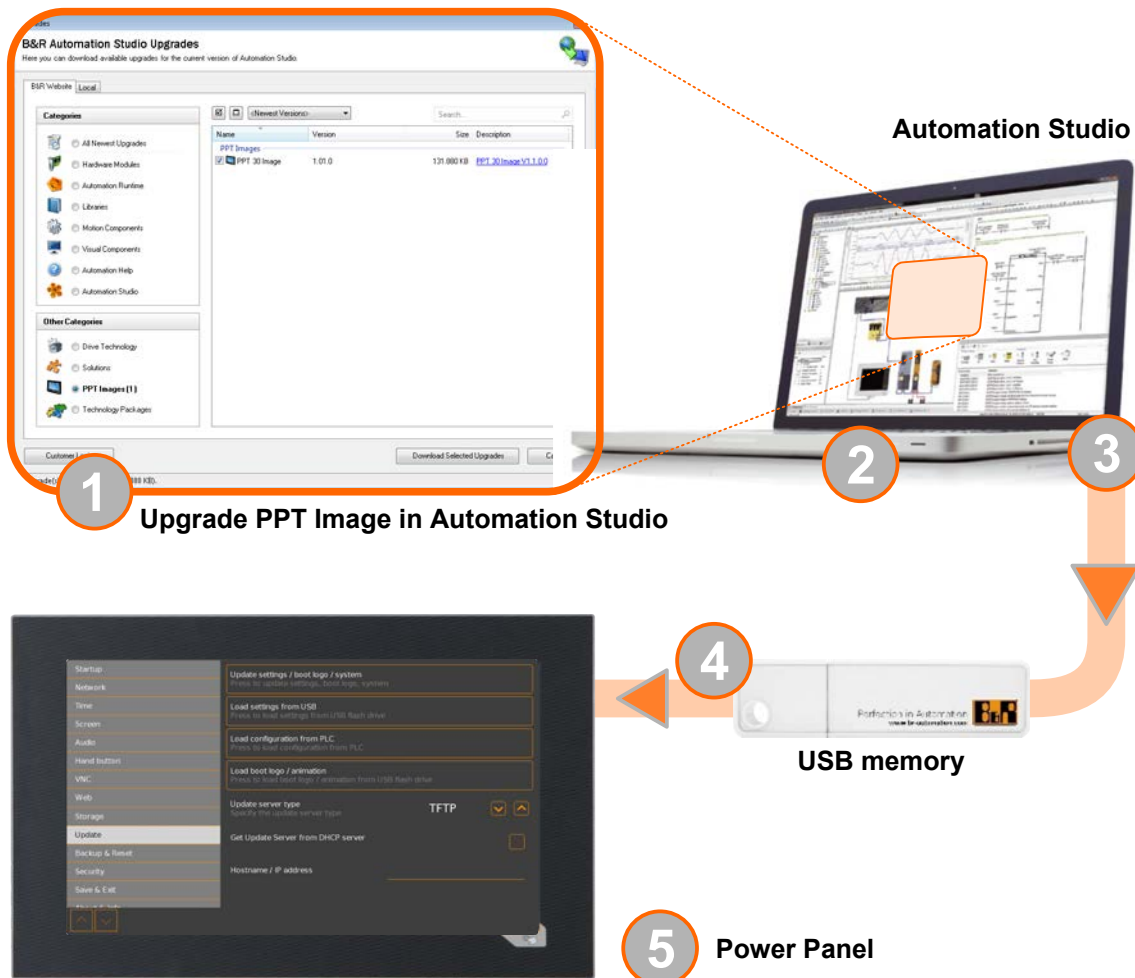

1. Update the PPT image for the Power Panel in Automation Studio (upgrade).
2. Configure the Power Panel in Automation Studio according to requirements.
3. Connect a USB flash drive to the computer and select the following menu command in Automation Studio:
 - **Project / Project installation / Generate project installation package**

The corresponding device (Power Panel) must be selected in the following selection dialog box. After confirming the selection, the target medium (connected USB flash drive) is selected and the process is started using button [Download to application memory].

The USB flash drive is reformatted and the following data is copied to the root directory:

PPT system	Configuration	Boot logo/animation
<ul style="list-style-type: none"> • PPT50Image.img.gz • PPT50Image.md5 • PPT50Image.img.gz.sig 	<ul style="list-style-type: none"> • PPT50Config.xml 	<ul style="list-style-type: none"> • PPTLogo.bmp.gz • PPTLogoA.gif

Depending on the configuration, files PPTLogo.bmp.gz and PPTLogoA.gif may not be included.

4. Connect the USB flash drive to the Power Panel.

5. Select one of the following functions on service page *Update* depending on what should be updated (see section "[Service page Update](#)" on page 75):
 - *Update settings / boot logo / system*
 - *Load settings from USB*
 - *Load boot logo / animation*

6.2.2 Updating with a downloaded from the website and USB flash drive

Updated versions of the PPT system are made available on the B&R website in the form of an upgrade package that includes a PPT image. To update the PPT system using an upgrade package from the B&R website, the following steps must be carried out.

1. Download the Power Panel T-Series upgrade package from the B&R website (www.br-automation.com). This upgrade package is available in various places on the website:
 - Directly on the product page (it is possible to search for the model number) in section "PPT upgrades" under tab "Downloads".
 - On the download page under *Software > Automation Studio > Automation Studio 4.3* (or higher) in category "Linux images".

Download the upgrade package in **ZIP format** (not EXE format)!

2. Unzip the ZIP file with the corresponding contents directly into the root directory of a USB flash drive:
 - PPT50Image.img.gz
 - PPT50Image.md5
 - PPT50Image.img.gz.sig
 - Readme.txt
3. Connect the USB flash drive to the Power Panel.
4. Select function *Update settings / boot logo / system* on service page *Update* (see section "[Service page Update](#)" on page 75).

6.2.3 Duplicating an existing setup using a USB flash drive

It is possible to save the system, system settings, boot logo and boot animation from one Power Panel to a USB flash drive and apply all or part of the setup to another Power Panel.

Perform the following steps to do so:

1. Connect a USB flash drive to the Power Panel whose configuration should be copied.
2. On service page *Backup & Reset*, the functions can be used to back up the entire system or just portions of it (configuration, boot logo, boot animation) on a USB flash drive (see "[Service page Backup & Reset](#)" on page 80).
3. Then connect the USB flash drive to another Power Panel.
4. On service page *Update*, use a corresponding function to update the Power Panel with the backed up system (or portions of it) (see section "[Service page Update](#)" on page 75).

Note the following when updating a Power Panel with a backup created on another device:

Restore from:	Note
PPT system	The backup of a PPT system (PPT image) can be used to update any Power Panel in the same family (T30, T50, etc.).
Configuration	The backup of a configuration (system settings) can be used to update any Power Panel in the same family (T30, T50, etc.). Note that certain settings may have to be adapted to the specific device, however (e.g. position of the boot animation).
Boot logo, boot animation	A boot logo and/or boot animation can only be used on devices with the same display size.

7 Software

This chapter provides software-specific information (RFB extension, image formats) that has been referenced multiple times in other chapters.

- [License information about the PPT System](#)
- [Notes about the PPT system](#)
- [Web browser information](#)
- [File formats](#)
- [Access to shared memory areas](#)
- [RFB extension](#)
- [OPC UA server](#)

7.1 License information about the PPT System

Display licenses on the service page *About & Info*

The licenses of the software components used on the Power Panel can be displayed directly on the service page *About & Info* (see "[Show license \(button\)](#)" on page 87).

License information in ZIP archive *license.zip*

ZIP archive *license.zip* contains file *license.manifest*, which contains an overview of software components being used with name, version and license information. In addition, the ZIP archive also contains detailed version information for each individual software component.

Information: When unpacking the ZIP archive, note that for technical reasons files with the same name may be included.

ZIP archive *license.zip* is included in the following image packages:

Type of PPT image ¹⁾	Description
Automation Studio upgrade	Executable file for installation in Automation Studio ²⁾ Location of <i>license.zip</i> after installation: <ul style="list-style-type: none"> • Typically in the local installation directory for Automation Studio: C:\BrAutomation\AS\[PanelSeries]\[PanelVariant]\V[ImageVersion] • [PanelSeries]: e.g. PPC, PPT, PMT or PFT • [PanelVariant]: e.g. 30, 50 or 80 • [ImageVersion]: Linux image version³⁾
ZIP archive	ZIP archive that, in addition to the Linux image, also contains file <i>license.zip</i> .

1) The [PPT image](#) is a Linux image. This image is an image of the Power Panel operating system (see "[PPT image](#)" on page 93) that is required to installation or update it.

Install/Update Linux image on Power Panel: see "[Update](#)" on page 88

2) See Automation Help for information about the download and installation in Automation Studio.

3) The Linux image version is not identical to the version from the Power Panel hardware upgrade.

Information:

The license information in *license.zip* always refers to a specific image version.

7.2 Notes about the PPT system

This section contains notes about specific versions of the [PPT system](#).

7.2.1 PPT image 1.0.1

Incompatibilities

Notice!

Incompatibilities occur in combination with a [PPT image](#) with a version $\leq 1.0.1$ and certain hardware revisions of the Power Panel T50. This results in the following problem:

- The touch screen does not work.

This problem occurs if a PPT image with a version $\leq 1.0.1$ is used on 2nd generation devices.

Order number	6PPT50.0502-xxx	6PPT50.0702-xxx	6PPT50.101E-xxx	6PPT50.121E-xxx	6PPT50.156B-xxx
Panel size	5.0"	7.0"	10.1"	12.1"	15.6"
1. Device generation	<C0	<D0	<D0	<C0	<C0
2. Device generation	$\geq C0$	$\geq D0$	$\geq D0$	$\geq C0$	$\geq C0$

Correcting the problem

If the problem occurs (touch screen does not work), updating the PPT system with a more recent PPT image restores touch functionality.

Updating the PPT system:

1. Connect the USB mouse to the affected device.
 2. Install a more recent PPT image version ($\geq 1.0.2$, see ["Update" on page 88](#)).
- ✓ After updating the PPT system, touch functionality is available again.

7.3 Web browser information

The implemented web browser of the terminal offers full JavaScript support!

The following features are not supported, however:

- Java
- Flash

7.3.1 Installing certificates in the browser

If user-defined certificates are required for the browser running on the Power Panel, they can be provided as follows:

- Set up network sharing for internal user memory "usershare".
See also: ["Service page Storage" on page 73](#)
- Create a directory called "cert" in the internal user memory.
- Copy user-defined certificates into directory `cert`.
Permissible file extensions for certificates: ".cer" or ".crt"

Each time the browser is started, all certificates are imported from directory `cert`.

7.3.2 Supported fonts

System fonts

Fonts are installed in the PPT system that are used by the browser to display HTML-based HMI applications (mapp View):

Font	Installed starting with PPT system	
	1.0.0	1.0.2
Arial	✓	
Arial Unicode	✓	
DejaVu Sans	✓	
DejaVu Sans Mono		✓
Verdana	✓	

Substitute fonts (font mapping)

If the HTML-based HMI application (mapp View) contains fonts that do not exist on the PPT system, the following system fonts are used as replacements instead:

Font	Substitute font starting with PPT system	
	1.0.0	1.0.2
serif	Arial, Regular	
sans-serif	DejaVu Sans, Book	
monospace	Arial, Regular	DejaVu Sans Mono, Book
Arial	Arial, Regular	
Helvetica	Arial, Regular	
Verdana	Verdana, Regular	
Times New Roman	Arial, Regular	
Courier New	Arial, Regular	DejaVu Sans Mono, Book

*) "serif", "sans-serif" and "monospace" are "generic" fonts.

16 px is set as the default font size.

7.3.3 Supported video formats

Videos can be displayed in web mode (see ["Configuring web mode" on page 68](#)). The following container formats are supported when embedding videos into a web-based HMI application:

- WebM
- MP4 (H.264)

7.3.4 User agent

For identification purposes, each web browser transmits various information (e.g. browser name, version, operating system) to the web server providing the HTML page.

As part of the HTTP header, a web browser identifies itself as a user agent. With PPT image version 1.3.0 and later, the web browser on the Power Panel transmits additional information.

Example:	User-Agent: Mozilla/5.0 ... BRPanel/1.0 (PPT50;landscape;1280x800;6PPT50.101E-16B;)
-----------------	--

Description of the Power Panel information:

Identification := BRPanel/<Version> (<Type>;<Orientation>;<Resolution>;<OrderId>)	
BRPanel	Identification as B&R panel.
<Version>	Version number of the comment (expression in parentheses), which is primarily used to evaluate the information within the parentheses correctly. Format of <Version>: <Number>.<Number>
<Type>	Name of device family: PPT50, PPC50, etc.
<Orientation>	The orientation of the screen display contains one of the following two values:
	landscape Landscape
	portrait Portrait
<Resolution>	Resolution of the device in the format "WIDTHxHEIGHT". Format of <Resolution>: WIDTHxHEIGHT
	WIDTH Width of the display in pixels.
	HEIGHT Height of the display in pixels.
	The width and height of the display are output according to the orientation:
	<ul style="list-style-type: none"> • Example for landscape format: 1280x800 • Example for portrait format: 800x1280
<OrderId>	Model number of the Power Panel.

7.4 File formats

7.4.1 PPT image

The PPT image is a compressed image of the PPT system (Power Panel T-Series operating system). The PPT image is a package and consists of the following files:

File	Description
PPT50Image.img.gz	Compressed image of the PPT system.
PPT50Image.img.gz.sig	Signature of the image.
PPT50Image.md5	MD5 checksum of the image.

Information:

This Power Panel supports signed images. During an update, the Power Panel uses the supplied signature to determine whether the image comes from a trusted source.

During an update, the MD5 checksum determines if the image is free of errors.

7.4.2 System settings

Filename: PPT50Config.xml

The system settings that can be defined by the user on the [service pages](#) are saved on the Power Panel in XML file PPT50Config.xml .

When backing up and restoring (see the two service pages [Backup & Reset](#) and [Update](#)) the system settings, the data for the settings is exchanged via an XML file with this name.

7.4.3 Boot logo

Filename: PPTLogo.bmp.gz

The boot logo is displayed during the startup phase of the Power Panel.

If configured on service page [Startup](#), the boot logo is also displayed in web/VNC mode while establishing the connection.

The boot logo must meet the following requirements:

File format	Only file format BMP (Windows bitmap) is permitted for the boot logo.
Size	The size of the graphic must correspond to the size of the display in full screen mode. To determine the size of the display on the Power Panel being used, see section "Technical data".
Name	PPTLogo.bmp.gz The boot logo must be compressed in GZ format (GNU ZIP file). If the boot logo (any name possible) is added in Automation Studio and then the data for the USB flash drive is generated, then Automation Studio will compress the boot logo into the GZ format and name the file accordingly. The user only has to make sure that the boot logo is compressed into the GZ format and the file is named accordingly if Automation Studio is not being used.
Color depth	The color depth is limited to 24-bit.

7.4.4 Boot animation

Filename: PPTLogoA.gif

If configured on service page [Startup](#), the boot animation is displayed in web or VNC mode while establishing the connection.

The boot animation must meet the following requirements:

File format	Only file format GIF (Graphics Interchange Format) is permitted for the boot animation.
Size	The size of the boot animation is not permitted to exceed the size of the used display in full screen mode.
Name	PPTLogoA.gif If the boot animation (any name possible) is added in Automation Studio and then the data for the USB flash drive is generated, then Automation Studio will name the file accordingly. The user only has to make sure that the boot animation is named accordingly if Automation Studio is not being used. It is important to ensure that capitalization matches the name specified above!
Position	When specifying the position of the boot animation (see service page "Screen" on page 61) it is important to ensure that the entire boot animation can still be shown on the display.
Application	The boot animation is superimposed over an existing static boot logo. The boot animation is only displayed when starting web or VNC mode. It is not displayed while the device is booting.

7.5 Access to shared memory areas

The FileIO library (description see Automation Help) can be used to access shared memory areas (USB memory or internal memory).

7.6 RFB extension

In addition to transferring screen content, the RFB protocol (remote frame buffer protocol) is also used to transfer data between a VNC client and the VNC server. This makes it possible to control VNC-based HMI applications. These extensions can be configured in Automation Studio using library *AsRfbExt*.

Library *AsRfbExt* provides additional options for controlling VNC-based HMI applications and evaluating any input devices connected to the client (B&R device). B&R's VNC Viewer must be used on the client with the RFB extension enabled.

RFB extensions offer the following basic functions:

- Evaluating additional control devices on the Power Panel.
- Querying the temperature of the VNC client.
- Starting a process on the VNC client to carry out certain functions.
- Determining and limiting the number of connected VNC clients.
- Disconnecting VNC clients from the VNC server (Power Panel is not turned off, configurations remain).
- Reading the controller's operating hours.

Information:

For more information about RFB extensions and programming with library *AsRfbExt*, see the documentation in Automation Help.

Information:

Only one Power Panel with enabled RFB extension can be operated per B&R VNC server.

The following functions are described in this section:

- [Temperature monitoring](#)
- [Adjusting display brightness](#)
- [Outputting an audio signal](#)

7.6.1 Temperature monitoring

Monitoring by the application

Necessary function of library *AsRfbExt*: *RfbExtTemperatureValue()*

Function *RfbExtTemperatureValue()* reads out the value of a temperature sensor in the device using a sensor index:

Sensor index	Description
0	Temperature of the CPU housing (TemperatureCPUCase).
1	Inner temperature of the Power Panel (TemperatureEnvironmental).

Use case

Under certain circumstances (e.g. if the device is operated near the maximum permissible ambient temperature), it makes sense for the application to monitor the temperature of the CPU component housing. The application can take appropriate measures if a certain temperature is exceeded.

Notice!

The temperature of the CPU housing is not permitted to exceed 105°C. The service life of the processor may be reduced at continuously high temperatures.

7.6.2 Adjusting display brightness

Necessary function of library *AsRfbExt*: *RfbExtStartProcess()*

Function *RfbExtStartProcess()* is used to adjust the display brightness process *dim*. Here, parameter *pcmdLine* is used to call the command line process as follows:

Call syntax	<code>dim brightness</code>
Parameter	<code>brightness</code> ... Brightness of the display in percent [%]: Valid range: 0 - 100
Example	<code>pcmdLine: dim 75</code> The display brightness is set to 75%.
Implementation	In the VNC-based HMI application, a button is assigned a corresponding function that calls <i>RfbExtStartProcess()</i> with the corresponding parameters. The application can take the display brightness from an input field that has also been defined in the HMI application.

The display brightness set with *dim* changes the current display setting but does not change the default setting used after restarting the device.

The default display brightness setting is configured on service page *Screen* or in Automation Studio (see section "[Configuration](#)" on page 51).

In contrast to the setting option on service page *Screen*, *dim* can be used to set the entire brightness range of the display from 0 to 100% (see "[Service page Screen](#)" on page 61).

7.6.3 Outputting an audio signal

Necessary function of library *AsRfbExt*: *RfbExtStartProcess()*

Function *RfbExtStartProcess()* is used to start the *beep* process and output an audio signal on the Power Panel. Here, parameter *pcmdLine* is used to call the command line process as follows:

Call syntax	<code>beep [frequency] [duration]</code>
Parameter	<code>frequency</code> ... Frequency of the audio signal in hertz [Hz]. Valid range: 10 - 15000 <code>duration</code> ... Duration of the audio signal in milliseconds [ms]. Valid range: 10 - 500 If a value is not specified, the default setting is used.
Example	<code>pcmdLine: beep 880 400</code> An audio signal with 880 Hz and duration of 400 ms is output.
Implementation	The VNC-based HMI application can output an audio signal using function <i>RfbExtStartProcess()</i> in order to clearly illustrate certain states or actions.

Calling *beep* with specific parameters does not change the default setting for the device.

The default audio signal setting is configured on service page *Audio* or in Automation Studio (see section "[Configuration](#)" on page 51).

Information:

Emitting an audible tone with *beep* is always done independently of the setting on service page *Audio* (see "[Service page Audio](#)" on page 63).

7.7 OPC UA server

The Power Panel can be configured as an OPC UA server (see "Service page OPC UA" on page 82). The OPC UA server on the Power Panel provides the following functionalities:

- Configuration of the Power Panel as is also possible via the "service pages" on page 51.
- Reading status information (temperature, version information, etc.).
- Querying touch screen keys.
- Calling functions/methods (setting brightness, triggering signal tone, etc.)

Notice!

The OPC UA server is stopped while the Power Panel service page is active.

General information about OPC UA

Corresponding knowledge of "OPC Unified Architecture" (OPC UA) is required to communicate with the OPC UA server on the Power Panel. Corresponding information is available e.g. on the OPC Foundation website (opcfoundation.org).

Communication via library AsOpcUac

Library AsOpcUac can be used to create an OPC UA client on B&R systems that communicates with the OPC UA server of the Power Panel.

Working groups of the OPC Foundation and PLCopen collaborated to develop the function blocks for OPC UA client functionality contained in the library.

Information:

Additional information about OPC UA and programming with library *AsOpcUac* is available in Automation Help.

Graphical OPC UA clients

During development, it is helpful to use a graphical OPC UA client to determine attributes and node IDs of nodes and methods.

OPC UA client *UaExpert* from Unified Automation GmbH (www.unified-automation.com) is very common.

7.7.1 Information model

General information

In addition to the base model of the OPC UA specification and OPC UA companion specification for device integration (DI = device integration), the OPC UA information model of the Power Panel provides both properties as well as methods for operating the Power Panel in its own address space (namespace).

7.7.1.1 Namespaces

Namespaces are used by OPC UA to generate unique identifiers. Attributes *NodeId* and *BrowseName* are identifiers that identify a node within the entire information model. A node in the OPC UA address space is uniquely identified with attribute *NodeId*. Attribute *BrowseName* alone cannot be used to unambiguously and uniquely identify a node. Different nodes can use the same *BrowseName*. BrowseNames can be combined into a path (Browse path), which makes it possible to locate a certain node in the OPC UA address space and to determine attribute *NodeId*.

Node identifiers are either specified in the OPC UA specification or by B&R itself. A namespace therefore specifies which institution defined the node (naming authority) and is specified in the form of a namespace URI.

The following namespaces are used in the OPC UA server of the Power Panel:

ns	Namespace URI	Description
0	http://opcfoundation.org/UA/	Address space for types and objects defined in the OPC UA specification.
	Namespace index	0
1	urn:[hostname]/BR/UA/EmbeddedServer	This namespace URI is the address space of device on which the OPC UA server is running.
	[hostname]	Hostname of the OPC UA server. Corresponds to the hostname that was specified in the network settings of the device. If no hostname was specified in the network settings, name "6PPT50" is used automatically.
	Namespace index	1
2	http://opcfoundation.org/UA/DI/	Address space for types and objects defined in the OPC UA companion specification for device integration (DI).
3	http://br-automation.com/OpcUa/BrTypes/	Address space for general types and objects defined by B&R.
4	http://br-automation.com/OpcUa/HMI/Terminal/	Address space for types and objects of the device defined by B&R.

ns Namespace index

Information:

Namespace URIs are case-sensitive; this must be taken into account.

Only namespace indexes 0 and 1 are defined according to the OPC UA specification. The other namespace indexes in this documentation may differ from the indices generated on the device.

The recommended procedure here is to dynamically determine the namespace indexes and use a namespace cache.

Notice!

Attribute *NodeId* of each node can change with a new version of the [PPT image](#).

The explicit (fixed) use of *NodeIds* results in problems in this case. *NodeIds* should therefore always be determined dynamically and managed in a node cache during communication with the OPC UA server.

Syntax for namespaces and nodes

This documentation describes a node in the information model using the namespace and *BrowseName*. The following syntax is used for this:








Path:	
ns:BrowseName	
ns	Namespace index of the node.
BrowseName	BrowseName of the node.

A complete path to a node would look like this:

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Startup/4:StartMode

7.7.1.2 Symbols for object types

Depending on the object type of the nodes of the information model, the following symbols are used in some places:

Symbol	Object type	Note
	Folder	Contains additional objects/nodes.
	BaseObject	Contains additional objects/nodes.
	FunctionalGroup	Contains additional objects/nodes.
	Method	These nodes provide methods for executing functions on the device.
	Variable	These nodes provide variables/parameters for configuring the device or for reading information from the device.
	Variable	These nodes provide variables/parameters for reading information from the device.
	Property	Specific properties for identifying the device are read out via these nodes.

7.7.1.3 ParameterSet

All readable and writable parameter nodes of the Power Panel are accessible under the following path:

Path:		
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet		
ns	Path to ParameterSet	Description
0	Root	Root directory.
0	Objects	Object directory.
2	DeviceSet	Device directory.
4	PowerPanelT50	Node for the Power Panel.
2	ParameterSet	Node containing all available parameters of the device.

Information:

Any changes made to the system settings using the parameters listed are only saved after method **SaveConfiguration** is called.

All parameter nodes are available under `ParameterSet` as well as under an alternative path. The parameters are structured in the following tables according to these alternative paths (function groups).

Legend for tables

This legend applies to all of the following tables in this section:

- ns Namespace index (see "Namespaces" on page 97)
- B The cross-references in column "BrowseName of the parameter" refer to the description of the nodes.
- S Column "Service page" contains cross-references to the service page where the parameter can also be changed.
- R Value attribute of the node can be read.
- W Value attribute of the node can be changed.

Configuration/Audio

Alternative path (function group):

/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Audio

ns	BrowseName of the parameter	Description	Service page	R	W
4	EnableBuzzer	Enables/Disables the buzzer.	Audio	+	+
	BuzzerSource	Selects the trigger for the buzzer.		+	+
	BuzzerFrequency	Frequency of the buzzer.		+	+
	BuzzerDuration	Duration of the buzzer.		+	+

Configuration/Gesture

Alternative path (function group):

/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Gesture

ns	BrowseName of the parameter	Description	Service page	R	W
4	OpenServicePage	Configures opening the service page with a gesture.	Gesture	+	+

Configuration/Network

Alternative path (function group):

/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Network

ns	BrowseName of the parameter	Description	Service page	R	W
4	Hostname	Hostname of the Power Panel.	Network	+	+
	NetworkMode	Network mode: DHCPClient or StaticIP. Setting corresponds to option <i>DHCP</i> on service page <i>Network</i> .		+	+
	ActivateDNS	Enables DNS usage.		+	+
	DNSSuffix	DNS suffix for the fully qualified domain name (FQDN).		+	+
	GetDNSFromDHCP	Enables/Disables obtaining IP addresses of the DNS servers from DHCP.		+	+
	PrimaryDNS	Address of the first DNS server.		+	+
	SecondaryDNS	Address of the second DNS server.		+	+
	TertiaryDNS	Address of the third DNS server.		+	+
	IpAddress	Static IP address of the Power Panel.		+	+
	SubnetMask	Subnet mask.		+	+
	DefaultGateway	IP address of the default gateway.		+	+

Configuration/RemoteAccess

Alternative path (function group):

/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:RemoteAccess

ns	BrowseName of the parameter	Description	Service page	R	W
4	EnableRemoteAccess	Enables/Disables remote access.	Remote access	+	+
	RemoteAccessBackEnd	Selects which technology is used for remote access.		+	+
	RemoteAccessModeWebGL	Selects the WebGL remote access operating mode.		+	+
	RemoteAccessPortWebGL	Network port for WebGL remote access.		+	+
	RemoteAccessWSPortWebGL	Network port for WebSocket communication with WebGL remote access.		+	+
	RemoteAccessModeVNC	Selects the VNC remote access operating mode.		+	+
	RemoteAccessPortVNC	Network port for VNC remote access.		+	+

Configuration/Screen

Alternative path (function group):

/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Screen

ns	BrowseName of the parameter	Description	Service page	R	W
4	DisplayBrightness	Screen brightness.	Screen	+	+
	ScreenRotation	Angle of rotation of the display.		+	+
	EnableScreensaver	Enables/Disables the screensaver.		+	+
	ScreensaverIdleTime	Time without touch activity after which the screensaver is displayed.		+	+
	ScreensaverType	Screensaver mode.		+	+
	BootAnimationDelay	Delay in milliseconds between frames of the GIF animation.		+	+
	BootAnimationLeftPos	Defines the distance of an existing boot animation to the left edge of the display.		+	+
	BootAnimationTopPos	Defines the distance of an existing boot animation to the right edge of the display.		+	+
				+	+

Configuration/Startup

Alternative path (function group):

/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Startup

ns	BrowseName of the parameter	Description	Service page	R	W
4	StartMode	Power Panel start mode: ServicePage, VNC Or Web.	Startup	+	+
	ShowBootLogoVNC	Enables/Disables the boot logo or boot animation of the system while connecting to the VNC server.		+	+
	ShowBootLogoWeb	Enables/Disables the boot logo or boot animation of the system while connecting to the web server.		+	+

Configuration/Storage

Alternative path (function group):

/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Storage

ns	BrowseName of the parameter	Description	Service page	R	W
4	USBMemoryShare	Enables/Disables network sharing to the connected USB storage medium.	Storage	+	+
	UserMemoryShare	Enables/Disables network sharing to internal user memory.		+	+

Configuration/Time

Alternative path (function group):

/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Time

ns	BrowseName of the parameter	Description	Service page	R	W
4	EnableNTPClient	Enables/Disables the NTP client for time synchronization.	Time	+	+
	NTPServer1	Address of an NTP server.		+	+

Configuration/Vnc

Alternative path (function group):

/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Vnc

ns	BrowseName of the parameter	Description	Service page	R	W
4	VNCServer	Address of the VNC server.	VNC	+	+
	UseRfbExtension	Enables/Disables the RFB extension in VNC mode.		+	+
	VNCConnectionMonitor	Enables/Disables monitoring of the connection to the VNC server.		+	+
	VNCLocalWindowScaling	Enables/Disables automatic scaling of the HMI application in VNC mode.		+	+
	VNCBackgroundColor	Changes the background color of the VNC client.		+	+

Configuration/Web

Alternative path (function group):

/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Web

ns	BrowseName of the parameter	Description	Service page	R	W
4	WebServer	Address of the web server.	Web	+	+
	VirtualKeyboardWeb	Enables/Disables the on-screen keyboard in web mode.		+	+
	DisablePinchGesture	The two-finger gesture (pinch-to-zoom) for zooming the browser content is disabled. Zooming the entire HMI application is prevented.		+	+
	SetOverrideViewport	Enables/Disables viewport settings.		+	+
	ViewportSettings	Viewport settings.		+	+
	IgnoreServerCertificateErrors	Enables/Disables warnings regarding server certificates.		+	+
	EnableScreenCapture	Enables/Disables the screen capture API.		+	+
	SuppressScrnCaptSecWarn	Enables/Disables the security warning when the screen capture is started.		+	+

Control/ConnectionWatchdog

Alternative path (function group):

/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Control/4:ConnectionWatchdog

ns	BrowseName of the method	Description	R	W
4	ConnectionWatchdogTimeout	This parameter defines the period for the watchdog timeout or disables the watchdog function.	+	+
	ConnectionWatchdogTrigger	This parameter is used firstly to enable the watchdog and secondly to trigger it.	+	+

Diagnostics

Alternative path (function group):

/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Diagnostics

ns	BrowseName of the information	Description	R	W
4	CPUCore0Usage	CPU utilization of core 0 (percent).	+	
4	CPUCore1Usage	CPU utilization of core 1 (percent).	+	
4	CPUUsage	CPU utilization of all cores (percent).	+	
4	MemoryAvailable	Available RAM in MB.	+	
4	MemoryTotal	Entire RAM of system in MB.	+	

Status

Alternative path (function group):

/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Status

ns	BrowseName of the parameter	Description	Service page	R	W
4	Temperature0	Temperature of the CPU housing: See Temperature monitoring .	About & Info	+	
	USBFlashDrive0	Indicates whether a USB flash drive is connected to IF3.		+	
	USBFlashDrive1	Indicates whether a USB flash drive is connected to IF4.		+	

7.7.1.4 MethodSet

All methods of the Power Panel are accessible under the following path:

Path:					
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:MethodSet					
ns	Path/Node	Description			
0	Root	Root directory			
0	Objects	Object directory			
2	DeviceSet	Device directory			
4	PowerPanelT50	Node for the "Power Panel T50" device			
2	MethodSet	Node containing all methods of the device			
ns	BrowseName of the method	Description			
4	AwakePanel	"Wakes up" the Power Panel if the screensaver is running.			
	BuzzerDefault	Plays the signal tone with the system settings.			
	BuzzerWithPara	Plays the buzzer with the specified parameters.			
	LoadConfiguration	The Power Panel loads the last saved settings and restarts. Any changes made to the parameters are not saved and will be lost.			
	SaveConfiguration	Saves changes made to the parameters . Method LoadConfiguration must be used in order for these saved settings to be enabled on the Power Panel.			
	SetBrightness	Changes screen brightness in the range from 20% to 100%.			
	SetBrightnessUnlimited	Changes screen brightness in the range from 0% to 100%.			
	SetTime	Sets the date and/or time of the device.			
	StartUpdate	Reboots the Power Panel and starts the update process.			
	StartRemoteAccess	Enables remote access with immediate effect.			
	StopRemoteAccess	Disables remote access with immediate effect.			

7.7.1.5 Device properties

Device properties (product-specific information) of the Power Panel are located under the following path:

Path:		
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50		
ns	Path/Node	Description
0	Root	Root directory
0	Objects	Object directory
2	DeviceSet	Device directory
4	PowerPanelT50	Nodes for the Power Panel
ns	BrowseName of the information	Description
3	CompatibilityId	ID to indicate compatibility.
2	DeviceManual	Link to the website: The user's manual is available in the Downloads section.
2	DeviceRevision	
2	HardwareRevision	
2	Manufacturer	Manufacturer of the device: B&R Industrial Automation GmbH
2	Model	Order number of the device, e.g. 6PPT50.101E-16B.
3	ProductCode	B&R ID code (see technical data of the device).
2	RevisionCounter	Value: -1 (reserved, not in use)
2	SerialNumber	Serial number of the device (see label on the back of the device).
2	SoftwareRevision	Software version of the PPT system: e.g. 1.2.0
3	VendorId	Vendor code, for customized models.

7.7.2 Description of the nodes of the information model

7.7.2.1 Alternative paths of nodes

The nodes listed in previous section "Information model" are also available via other paths. This alternative structure organizes the nodes in sections "ParameterSet", "MethodSet" and "Device properties" into logical function groups. The detailed description of the nodes in this section is organized according to this logical structure.

7.7.2.2 Configuration

All parameters for configuring the device are located under node *Configuration*.

Path to the object dictionary:

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration

7.7.2.2.1 Audio

Path to the object dictionary:

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Audio

ns	BrowseName of the parameter	Description	Service page	R	W
4	EnableBuzzer	Enables/Disables the buzzer.	Audio	+	+
	BuzzerSource	Selects the trigger for the buzzer.		+	+
	BuzzerFrequency	Frequency of the buzzer.		+	+
	BuzzerDuration	Duration of the buzzer.		+	+

7.7.2.2.1.1 EnableBuzzer

Function identical to: [Service page Audio](#) → "Buzzer" on page 63

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:EnableBuzzer
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Audio/4:EnableBuzzer

Node attributes

NodeClass	Variable
Data Type	Boolean
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.1.2 BuzzerSource

Function identical to: [Service page Audio](#) → "Buzzer source" on page 63

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:BuzzerSource
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Audio/4:BuzzerSource

Node attributes

NodeClass	Variable
Data Type	BrBuzzerSource (Enumeration)
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

Data type *BrBuzzerSource* (enumeration)

Value	String
0	App
1	Touch

7.7.2.2.1.3 BuzzerFrequency

Function identical to: [Service page Audio](#) → "Buzzer frequency" on page 63

Path to the node (BrowsePath)

Path:	
	/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:BuzzerFrequency
Alternative path (function group):	
	/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Audio/4:BuzzerFrequency

Node attributes

NodeClass	Variable
DataType	UInt16
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.1.4 BuzzerDuration

Function identical to: [Service page Audio](#) → "Buzzer duration" on page 63

Path to the node (BrowsePath)

Path:	
	/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:BuzzerDuration
Alternative path (function group):	
	/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Audio/4:BuzzerDuration

Node attributes

NodeClass	Variable
DataType	UInt16
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.2 Gesture

Path to the object dictionary:

Path:					
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Gesture					
ns	BrowseName of the parameter	Description	Service page	R	W
4	OpenServicePage	Configures opening the service page with a gesture.	Gesture	+	+

7.7.2.2.2.1 OpenServicePage

Description

Function identical to: [Service page Gesture](#) → "Open service page" on page 64

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:OpenServicePage	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Gesture/4:OpenServicePage	

Node attributes

NodeClass	Variable
DataType	Boolean
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.3 Network

Path to the object dictionary:

Path:					
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Network					
ns	BrowseName of the parameter	Description	Service page	R	W
4	Hostname	Hostname of the Power Panel.	Network	+	+
	NetworkMode	Network mode: DHCPClient or StaticIP. Setting corresponds to option <i>DHCP</i> on service page <i>Network</i> .		+	+
	ActivateDNS	Enables DNS usage.		+	+
	DNSSuffix	DNS suffix for the fully qualified domain name (FQDN).		+	+
	GetDNSFromDHCP	Enables/Disables obtaining IP addresses of the DNS servers from DHCP.		+	+
	PrimaryDNS	Address of the first DNS server.		+	+
	SecondaryDNS	Address of the second DNS server.		+	+
	TertiaryDNS	Address of the third DNS server.		+	+
	IPAddress	Static IP address of the Power Panel.		+	+
	SubnetMask	Subnet mask.		+	+
	DefaultGateway	IP address of the default gateway.		+	+

7.7.2.2.3.1 Hostname

Function identical to: [Service page Network](#) → "Hostname" on page 57

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:Hostname	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Network/4:Hostname	

Node attributes

NodeClass	Variable
DataType	String
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.3.2 NetworkMode

Function identical to: [Service page Network](#) → "DHCP" on page 57

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:NetworkMode	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Network/4:NetworkMode	

Node attributes

NodeClass	Variable
DataType	BrNetMode (Enumeration)
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

Data type *BrNetMode* (enumeration)

Value	String
0	DHCPClient
1	StaticIP

7.7.2.2.3.3 ActivateDNS

Function identical to: [Service page Network](#) → [Activate DNS](#)

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:ActivateDNS
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Network/4:ActivateDNS

Node attributes

NodeClass	Variable
DataType	Boolean
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.3.4 DNSSuffix

Function identical to: [Service page Network](#) → "DNS suffix" on page 58

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:DNSSuffix
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Network/4:DNSSuffix

Node attributes

NodeClass	Variable
DataType	String
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.3.5 GetDNSFromDHCP

Function identical to: [Service page Network](#) → "Get DNS from DHCP server" on page 58

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:GetDNSFromDHCP
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Network/4:GetDNSFromDHCP

Node attributes

NodeClass	Variable
DataType	Boolean
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.3.6 PrimaryDNS / SecondaryDNS / TertiaryDNS

Function identical to:

[Service page Network](#) → "Primary DNS server / Secondary DNS server / Tertiary DNS server" on page 58

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:PrimaryDNS
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:SecondaryDNS
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:TertiaryDNS
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Network/4:PrimaryDNS
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Network/4:SecondaryDNS
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Network/4:TertiaryDNS

Node attributes

NodeClass	Variable
DataType	String
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.3.7 IPAddress

Function identical to: [Service page Network](#) → "IP address" on page 59

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:IPAddress
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Network/4:IPAddress

Node attributes

NodeClass	Variable
DataType	String
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.3.8 SubnetMask

Function identical to: [Service page Network](#) → "Subnet mask / Default gateway" on page 59

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:SubnetMask
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Network/4:SubnetMask

Node attributes

NodeClass	Variable
DataType	String
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.3.9 DefaultGateway

Function identical to: [Service page Network](#) → "Subnet mask / Default gateway" on page 59

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:DefaultGateway
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Network/4:DefaultGateway

Node attributes

NodeClass	Variable
DataType	String
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.4 RemoteAccess

Path to the object dictionary:

Path:					
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:RemoteAccess					
ns	BrowseName of the parameter	Description	Service page	R	W
4	EnableRemoteAccess	Enables/Disables remote access.	Remote access	+	+
	RemoteAccessBackEnd	Selects which technology is used for remote access.		+	+
	RemoteAccessModeWebGL	Selects the WebGL remote access operating mode.		+	+
	RemoteAccessPortWebGL	Network port for WebGL remote access.		+	+
	RemoteAccessWSPortWebGL	Network port for WebSocket communication with WebGL remote access.		+	+
	RemoteAccessModeVNC	Selects the VNC remote access operating mode.		+	+
	RemoteAccessPortVNC	Network port for VNC remote access.		+	+

Changed parameter names starting with PPT system version 1.6.0

The mode and port settings for VNC and WebGL can be set separately starting with this PPT system version:

Parameter name	PPT system version	
	<1.6.0	≥1.6.0
RemoteAccessMode	x	
RemoteAccessModeWebGL		x
RemoteAccessModeVNC		x
RemoteAccessPort	x	
RemoteAccessPortWebGL		x
RemoteAccessWSPortWebGL		x
RemoteAccessPortVNC		x

7.7.2.2.4.1 EnableRemoteAccess

Function identical to: [Service page Remote Access](#) → "Remote access" on page 84

Setting EnableRemoteAccess only has an effect after the configuration is loaded with [LoadConfiguration](#). In contrast, StartRemoteAccess and StopRemoteAccess can be used to enable or disable remote access immediately.

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:EnableRemoteAccess
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:RemoteAccess/4:EnableRemoteAccess

Node attributes

NodeClass	Variable
Data Type	Boolean
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.4.2 RemoteAccessBackEnd

Function identical to: [Service page Remote Access](#) → "Back end" on page 84

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:RemoteAccessBackEnd
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:RemoteAccess/4:RemoteAccessBackEnd

Node attributes

NodeClass	Variable
Data Type	BrRemoteAccessBackEnd (Enumeration)
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

Data type *BrRemoteAccessBackEnd* (enumeration)

Value	String
0	WebGL
1	VNC

7.7.2.2.4.3 RemoteAccessModeWebGL

Function identical to: [Service page Remote Access](#) → "Mode" on page 85

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:RemoteAccessModeWebGL
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:RemoteAccess/4:RemoteAccessModeWebGL

Node attributes

NodeClass	Variable
DataType	BrRemoteAccessMode (Enumeration)
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

Data type *BrRemoteAccessMode* (enumeration)

Value	String
0	View
1	Control

7.7.2.2.4.4 RemoteAccessPortWebGL

Function identical to: [Service page Remote Access](#) → "Back end port" on page 84

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:RemoteAccessPortWebGL
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:RemoteAccess/4:RemoteAccessPortWebGL

Node attributes

NodeClass	Variable
DataType	UInt16
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.4.5 RemoteAccessWSPortWebGL

Function identical to: [Service page Remote Access](#) → "Back end WebSocket port" on page 85

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:RemoteAccessWSPortWebGL
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:RemoteAccess/4:RemoteAccessWSPortWebGL

Node attributes

NodeClass	Variable
DataType	UInt16
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.4.6 RemoteAccessModeVNC

Function identical to: [Service page Remote Access](#) → "Mode" on page 85

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:RemoteAccessModeVNC
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:RemoteAccess/4:RemoteAccessModeVNC

Node attributes

NodeClass	Variable
DataType	BrRemoteAccessMode (Enumeration)
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

Data type *BrRemoteAccessMode* (enumeration)

Value	String
0	View
1	Control

7.7.2.2.4.7 RemoteAccessPortVNC

Function identical to: [Service page Remote Access](#) → "Back end port" on page 84

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:RemoteAccessPortVNC
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:RemoteAccess/4:RemoteAccessPortVNC

Node attributes

NodeClass	Variable
DataType	UInt16
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.5 Screen

Path to the object dictionary:

Path:					
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Screen					
ns	BrowseName of the parameter	Description	Service page	R	W
4	DisplayBrightness	Screen brightness.	Screen	+	+
	ScreenRotation	Angle of rotation of the display.		+	+
	EnableScreensaver	Enables/Disables the screensaver.		+	+
	ScreensaverIdleTime	Time without touch activity after which the screensaver is displayed.		+	+
	ScreensaverType	Screensaver mode.		+	+
	BootAnimationDelay	Delay in milliseconds between frames of the GIF animation.		+	+
	BootAnimationLeftPos	Defines the distance of an existing boot animation to the left edge of the display.		+	+
	BootAnimationTopPos	Defines the distance of an existing boot animation to the right edge of the display.		+	+

7.7.2.2.5.1 DisplayBrightness

Function identical to: [Service page Screen](#) → "Display brightness" on page 61

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:DisplayBrightness	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Screen/4:DisplayBrightness	

Node attributes

NodeClass	Variable
DataType	Byte
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.5.2 ScreenRotation

Function identical to: [Service page Screen](#) → "Screen rotation" on page 61

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:ScreenRotation	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Screen/4:ScreenRotation	

Node attributes

NodeClass	Variable
DataType	BrRotation (Enumeration)
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

Data type *BrRotation* (enumeration)

Value	String
0	0
1	90
2	180
3	270

7.7.2.2.5.3 EnableScreensaver

Function identical to: [Service page Screen](#) → "Screensaver" on page 61

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:EnableScreensaver	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Screen/4:EnableScreensaver	

Node attributes

NodeClass	Variable
DataType	Boolean
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.5.4 ScreensaverIdleTime

Function identical to: [Service page Screen](#) → "Start screensaver after" on page 62

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:ScreensaverIdleTime
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Screen/4:ScreensaverIdleTime

Node attributes

NodeClass	Variable
DataType	UInt16
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.5.5 ScreensaverType

Function identical to: [Service page Screen](#) → "Screensaver type" on page 62

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:ScreensaverType
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Screen/4:ScreensaverType

Node attributes

NodeClass	Variable
DataType	BrScreensaver (Enumeration)
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

Data type *BrScreensaver* (enumeration)

Value	String
0	Black
1	BacklightOff

7.7.2.2.5.6 BootAnimationDelay

Function identical to: [Service page Screen](#) → "Settings for the boot animation" on page 62

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:BootAnimationDelay
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Screen/4:BootAnimationDelay

Node attributes

NodeClass	Variable
DataType	UInt16
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.5.7 BootAnimationLeftPos

Function identical to: [Service page Screen](#) → "Settings for the boot animation" on page 62

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:BootAnimationLeftPos
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Screen/4:BootAnimationLeftPos

Node attributes

NodeClass	Variable
DataType	UInt16
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.5.8 BootAnimationTopPos

Function identical to: [Service page Screen](#) → "Settings for the boot animation" on page 62

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:BootAnimationTopPos
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Screen/4:BootAnimationTopPos

Node attributes

NodeClass	Variable
DataType	UInt16
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.6 Startup

Path to the object dictionary:

Path:					
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Startup					
ns	BrowseName of the parameter	Description	Service page	R	W
4	StartMode	Power Panel start mode: ServicePage, VNC or Web.	Startup	+	+
	ShowBootLogoVNC	Enables/Disables the boot logo or boot animation of the system while connecting to the VNC server.		+	+
	ShowBootLogoWeb	Enables/Disables the boot logo or boot animation of the system while connecting to the web server.		+	+

7.7.2.2.6.1 StartMode

Function identical to: [Service page Startup](#) → "Start mode" on page 56

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:StartMode	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Startup/4:StartMode	

Node attributes

NodeClass	Variable
Data Type	BrStartMode (Enumeration)
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

Data type *BrStartMode* (enumeration)

Value	String
0	ServicePage
1	VNC
2	Web

7.7.2.2.6.2 ShowBootLogoVNC / ShowBootLogoWeb

Function identical to: [Service page Startup](#) → "Boot logo or boot animation" on page 56

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:ShowBootLogoVNC	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:ShowBootLogoWeb	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Startup/4:ShowBootLogoVNC	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Startup/4:ShowBootLogoWeb	

Node attributes

NodeClass	Variable
Data Type	Boolean
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.7 Storage

Path to the object dictionary:

Path:				
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Storage				
ns	BrowseName of the parameter	Description	Service page	R W
4	USBMemoryShare	Enables/Disables network sharing to the connected USB storage medium.	Storage	+ +
	UserMemoryShare	Enables/Disables network sharing to internal user memory.		+ +

7.7.2.2.7.1 USBMemoryShare / UserMemoryShare

Function identical to: Options on "Service page Storage" on page 73

- USBMemoryShare → Option *Allow access to USB memory via network*
- UserMemoryShare → Option *Allow access to user memory via network*

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:USBMemoryShare	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:UserMemoryShare	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Storage/4:USBMemoryShare	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Storage/4:UserMemoryShare	

Node attributes

NodeClass	Variable
DataType	Boolean
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.8 Time

Path to the object dictionary:

Path:					
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Time					
ns	BrowseName of the parameter	Description	Service page	R	W
4	EnableNTPClient	Enables/Disables the NTP client for time synchronization.	Time	+	+
	NTPServer1	Address of an NTP server.		+	+

7.7.2.2.8.1 EnableNTPClient

Function identical to: [Service page Time](#) → "NTP client" on page 60

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:EnableNTPClient	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Time/4:EnableNTPClient	

Node attributes

NodeClass	Variable
DataType	Boolean
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.8.2 NTPServer1

Function identical to: [Service page Time](#) → NTPServer1

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:NTPServer1	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Time/4:NTPServer1	

Node attributes

NodeClass	Variable
DataType	String
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.9 Vnc

Path to the object dictionary:

Path:					
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Vnc					
ns	BrowseName of the parameter	Description	Service page	R	W
4	VNCServer	Address of the VNC server.	VNC	+	+
	UseRfbExtension	Enables/Disables the RFB extension in VNC mode.		+	+
	VNCConnectionMonitor	Enables/Disables monitoring of the connection to the VNC server.		+	+
	VNCLocalWindowScaling	Enables/Disables automatic scaling of the HMI application in VNC mode.		+	+
	VNCBackgroundColor	Changes the background color of the VNC client.		+	+

7.7.2.2.9.1 VNCServer

Function identical to: [Service page VNC](#) → "Server" on page 65

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:VNCServer	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Vnc/4:VNCServer	

Node attributes

NodeClass	Variable
DataType	String
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.9.2 UseRfbExtension

Function identical to: [Service page VNC](#) → "Use RFB extension" on page 66

Note: The system will not accept options [UseRfbExtension](#) and [VNCConnectionMonitor](#) both simultaneously set to *true*. After the changes are saved with method [SaveConfiguration](#), option [VNCConnectionMonitor](#) will be automatically set to *false* in such a case.

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:UseRfbExtension	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Vnc/4:UseRfbExtension	

Node attributes

NodeClass	Variable
DataType	Boolean
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.9.3 VNCConnectionMonitor

Function identical to: [Service page VNC](#) → "Enable connection monitor" on page 66

Note: The system will not accept options [UseRfbExtension](#) and [VNCConnectionMonitor](#) both simultaneously set to *true*. After the changes are saved with method [SaveConfiguration](#), option [VNCConnectionMonitor](#) will be automatically set to *false* in such a case.

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:VNCConnectionMonitor	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Vnc/4:VNCConnectionMonitor	

Node attributes

NodeClass	Variable
DataType	Boolean
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.9.4 VNCLocalWindowScaling

Function identical to: [Service page VNC](#) → "Enable local window scaling" on page 66

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:VNCLocalWindowScaling
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Vnc/4:VNCLocalWindowScaling

Node attributes

NodeClass	Variable
DataType	Boolean
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.9.5 VNCBackgroundColor

Function identical to: [Service page VNC](#) → "Background color" on page 67

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:VNCBackgroundColor
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Vnc/4:VNCBackgroundColor

Node attributes

NodeClass	Variable
DataType	String
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.10 Web

Path to the object dictionary:

Path:					
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Web					
ns	BrowseName of the parameter	Description	Service page	R	W
4	WebServer	Address of the web server.	Web	+	+
	VirtualKeyboardWeb	Enables/Disables the on-screen keyboard in web mode.		+	+
	DisablePinchGesture	The two-finger gesture (pinch-to-zoom) for zooming the browser content is disabled. Zooming the entire HMI application is prevented.		+	+
	SetOverrideViewport	Enables/Disables viewport settings.		+	+
	ViewportSettings	Viewport settings.		+	+
	IgnoreServerCertificateErrors	Enables/Disables warnings regarding server certificates.		+	+
	EnableScreenCapture	Enables/Disables the screen capture API.		+	+
	SuppressScrnCaptSecWarn	Enables/Disables the security warning when the screen capture is started.		+	+

7.7.2.2.10.1 WebServer

Function identical to: [Service page Web](#) → "Server" on page 69

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:WebServer	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Web/4:WebServer	

Node attributes

NodeClass	Variable
DataType	String
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.10.2 VirtualKeyboardWeb

Function identical to: [Service page Web](#) → "Virtual keyboard" on page 69

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:VirtualKeyboardWeb	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Web/4:VirtualKeyboardWeb	

Node attributes

NodeClass	Variable
DataType	Boolean
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.10.3 DisablePinchGesture

Function identical to: [Service page Web](#) → "Disable pinch gesture" on page 69

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:DisablePinchGesture	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Web/4:DisablePinchGesture	

Node attributes

NodeClass	Variable
DataType	Boolean
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.10.4 SetOverrideViewport

Function identical to: [Service page Web](#) → "Set/Override viewport settings" on page 71

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:SetOverrideViewport
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Web/4:SetOverrideViewport

Node attributes

NodeClass	Variable
DataType	Boolean
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.10.5 ViewportSettings

Function identical to: [Service page Web](#) → "Viewport settings" on page 71

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:ViewportSettings
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Web/4:ViewportSettings

Node attributes

NodeClass	Variable
DataType	String
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.10.6 IgnoreServerCertificateErrors

Function identical to: [Service page Web](#) → "Ignore server certificate errors" on page 70

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:IgnoreServerCertificateErrors
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Web/4:IgnoreServerCertificateErrors

Node attributes

NodeClass	Variable
DataType	Boolean
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.10.7 EnableScreenCapture

Function identical to: [Service page Web](#) → "Enable Screen Capture" on page 71

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:EnableScreenCapture
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Web/4:EnableScreenCapture

Node attributes

NodeClass	Variable
DataType	Boolean
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.2.10.8 SuppressScrnCaptSecWarn

Function identical to: [Service page Web](#) → "Suppress Screen Capture security warning" on page 71

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:SuppressScrnCaptSecWarn
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Configuration/4:Web/4:SuppressScrnCaptSecWarn

Node attributes

NodeClass	Variable
DataType	Boolean
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.3 Control

Path to the object dictionary:

Path:		
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Control		
ns	BrowseName of the method	Description
4	AwakePanel	"Wakes up" the Power Panel if the screensaver is running.
	BuzzerDefault	Plays the signal tone with the system settings.
	BuzzerWithPara	Plays the buzzer with the specified parameters.
	LoadConfiguration	The Power Panel loads the last saved settings and restarts. Any changes made to the parameters are not saved and will be lost.
	SaveConfiguration	Saves changes made to the parameters . Method LoadConfiguration must be used in order for these saved settings to be enabled on the Power Panel.
	SetBrightness	Changes screen brightness in the range from 20% to 100%.
	SetBrightnessUnlimited	Changes screen brightness in the range from 0% to 100%.
	SetTime	Sets the date and/or time of the device.
	StartUpdate	Reboots the Power Panel and starts the update process.
	StartRemoteAccess	Enables remote access with immediate effect.
	StopRemoteAccess	Disables remote access with immediate effect.

7.7.2.3.1 AwakePanel

"Wakes up" the Power Panel if the screensaver is running.

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:MethodSet/4:AwakePanel	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Control/4:AwakePanel	

Arguments for a method call

Arguments	-
-----------	---

7.7.2.3.2 BuzzerDefault

Plays the signal tone with the system settings.

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:MethodSet/4:BuzzerDefault	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Control/4:BuzzerDefault	

Arguments for a method call

Arguments	-
-----------	---

7.7.2.3.3 BuzzerWithPara

Plays the buzzer with the specified parameters.

See arguments for the method call.

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:MethodSet/4:BuzzerWithPara	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Control/4:BuzzerWithPara	

Arguments for a method call

Argument	Data type	Name	Description
0	UInt32	Frequency	Frequency of the buzzer in hertz [Hz].
1	UInt32	Duration	Duration of the buzzer in milliseconds [ms].

7.7.2.3.4 LoadConfiguration

The Power Panel loads the last saved settings and restarts. Any changes made to the [parameters](#) are not saved and will be lost.

Function identical to: [Service page Save & Exit](#) → [Exit without saving \(button\)](#)

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:MethodSet/4:LoadConfiguration
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Control/4:LoadConfiguration

Arguments for a method call

Arguments	-
------------------	---

7.7.2.3.5 SaveConfiguration

Saves changes made to the [parameters](#). Method [LoadConfiguration](#) must be used in order for these saved settings to be enabled on the Power Panel.

Function identical to: [Service page Save & Exit](#) → [Save changes \(button\)](#)

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:MethodSet/4:SaveConfiguration
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Control/4:SaveConfiguration

Arguments for a method call

Arguments	-
------------------	---

7.7.2.3.6 SetBrightness

Changes screen brightness in the range from 20% to 100%.

See arguments for the method call.

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:MethodSet/4:SetBrightness
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Control/4:SetBrightness

Arguments for a method call

Argument	Data type	Name	Description
0	UInt32	Brightness	Brightness in percent [%].
			Range of values: 0 - 100
			Scaling 0 → 20% to 100 → 100%

7.7.2.3.7 SetBrightnessUnlimited

Changes screen brightness in the range from 0% to 100%.

See arguments for the method call.

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:MethodSet/4:SetBrightnessUnlimited
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Control/4:SetBrightnessUnlimited

Arguments for a method call

Argument	Data type	Name	Description
0	UInt32	BrightnessUnlimited	Brightness in percent [%]. Values >100 are limited to 100.
			Range of values 0 - 100
			Scaling No scaling: 0 → 0% to 100 → 100%

7.7.2.3.8 SetTime

Sets the date and/or time of the device.

See arguments for the method call.

Information:

This method only works if automatic NTP time synchronization is disabled (see ["Service page Time" on page 60](#)).

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:MethodSet/4:SetTime
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Control/4:SetTime

Arguments for a method call

Argument	Data type	Name	Description
0	String	Time	Date and/or time for setting the internal clock. The following string formats are allowed:
		Valid formats	Description
		2018-10-19 15:45	Sets the date and time. Seconds are set to 0.
		2018-10-19	Sets the date. The time remains unchanged.
		15:45	Sets the time. Seconds are set to 0. The date remains unchanged.

7.7.2.3.9 StartUpdate

Reboots the Power Panel and starts the update process.

Function identical to: [Service page Update](#) → [Update settings](#) / [boot logo](#) / [system](#) (button)

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:MethodSet/4:StartUpdate
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Control/4:StartUpdate

Arguments for a method call

Arguments	-
------------------	---

7.7.2.3.10 StartRemoteAccess

Enables remote access with immediate effect.

This method is independent of setting [EnableRemoteAccess](#).

Additional information about remote access: [Service page Remote Access](#) → [Remote access](#)

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:MethodSet/4:StartRemoteAccess
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Control/4:StartRemoteAccess

Arguments for a method call

Arguments	-
------------------	---

7.7.2.3.11 StopRemoteAccess

Disables remote access with immediate effect.

This method is independent of setting [EnableRemoteAccess](#).

Additional information about remote access: [Service page Remote Access](#) → [Remote access](#)

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:MethodSet/4:StopRemoteAccess
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Control/4:StopRemoteAccess

Arguments for a method call

Arguments	-
------------------	---

7.7.2.4 Control/ConnectionWatchdog

Information:


The watchdog function is part of the OPC UA implementation of the Power Panel and only used on customized Power Panel variants.

Path to the object dictionary:

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Control/4:ConnectionWatchdog

ns	BrowseName of the method	Description	R	W
4	ConnectionWatchdogTimeout	This parameter defines the period for the watchdog timeout or disables the watchdog function.	+	+
	ConnectionWatchdogTrigger	This parameter is used firstly to enable the watchdog and secondly to trigger it.	+	+

7.7.2.4.1 ConnectionWatchdog - Function description

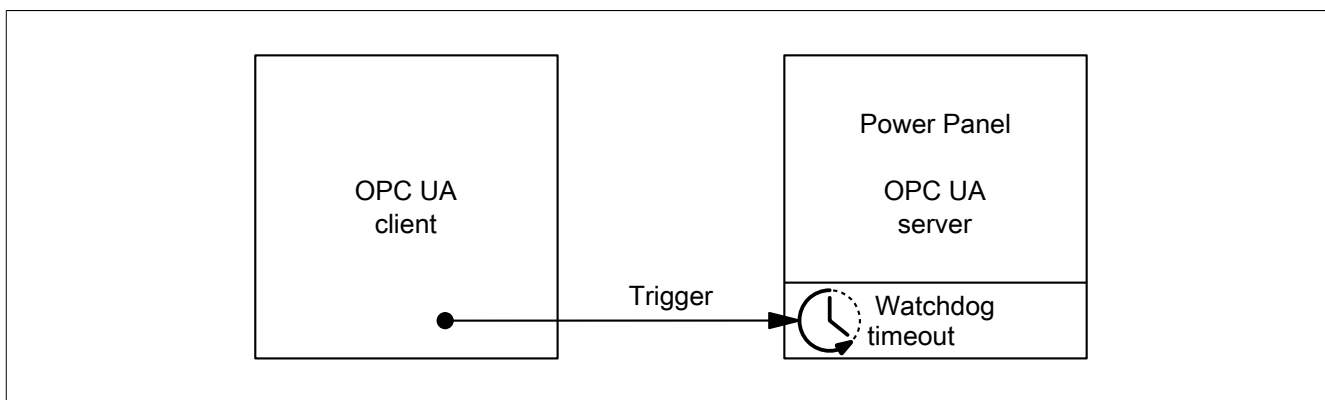

When ConnectionWatchdog is active, the OPC UA client must send a trigger signal to the Power Panel within the timeout period. If the Power Panel does not receive a trigger signal within the defined timeout period, all LEDs on the Power Panel are disabled.

7.7.2.4.2 ConnectionWatchdogTimeout

This parameter defines the period for the watchdog timeout or disables the watchdog function.

The following values are valid for ConnectionWatchdogTimeout:

Value [ms]	Description
0	This value immediately disables the watchdog.
500 to 10000	Timeout period in milliseconds. The client must set parameter ConnectionWatchdogTrigger to value "true" within the time defined here if the watchdog is active.

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:ConnectionWatchdogTimeout
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Control/4:ConnectionWatchdog/4:ConnectionWatchdogTimeout

Node attributes

NodeClass	Variable
DataType	UInt16
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.4.3 ConnectionWatchdogTrigger

This parameter is used firstly to enable the watchdog and secondly to trigger it.

The following values are valid for ConnectionWatchdogTrigger:

Value	Description
true	If the watchdog is not active, the watchdog is started with the value from ConnectionWatchdogTimeout. If the watchdog is active, the watchdog is restarted with the value from ConnectionWatchdogTimeout.
false	No function.

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:ConnectionWatchdogTrigger
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Control/4:ConnectionWatchdog/4:ConnectionWatchdogTrigger

Node attributes

NodeClass	Variable
DataType	Boolean
AccessLevel	CurrentRead, CurrentWrite
UserAccessLevel	CurrentRead, CurrentWrite

7.7.2.5 Diagnostics

Path to the object dictionary:

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Diagnostics

ns	BrowseName of the information	Description	R	W
4	CPUCore0Usage	CPU utilization of core 0 (percent).	+	
4	CPUCore1Usage	CPU utilization of core 1 (percent).	+	
4	CPUUsage	CPU utilization of all cores (percent).	+	
4	MemoryAvailable	Available RAM in MB.	+	
4	MemoryTotal	Entire RAM of system in MB.	+	

7.7.2.5.1 CPUCore0Usage

CPU utilization of core 0 (percent).

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:CPUCore0Usage
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Diagnostics/4:CPUCore0Usage

Node attributes

NodeClass	Variable
DataType	Byte
AccessLevel	CurrentRead
UserAccessLevel	CurrentRead

7.7.2.5.2 CPUCore1Usage

CPU utilization of core 1 (percent).

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:CPUCore1Usage
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Diagnostics/4:CPUCore1Usage

Node attributes

NodeClass	Variable
DataType	Byte
AccessLevel	CurrentRead
UserAccessLevel	CurrentRead

7.7.2.5.3 CPUUsage

CPU utilization of all cores (percent).

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:CPUUsage
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Diagnostics/4:CPUUsage

Node attributes

NodeClass	Variable
DataType	Byte
AccessLevel	CurrentRead
UserAccessLevel	CurrentRead

7.7.2.5.4 MemoryAvailable

Available RAM in MB.

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:MemoryAvailable
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Diagnostics/4:MemoryAvailable

Node attributes

NodeClass	Variable
DataType	UInt16
AccessLevel	CurrentRead
UserAccessLevel	CurrentRead

7.7.2.5.5 MemoryTotal

Entire RAM of system in MB.

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:MemoryTotal
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Diagnostics/4:MemoryTotal

Node attributes

NodeClass	Variable
DataType	UInt16
AccessLevel	CurrentRead
UserAccessLevel	CurrentRead

7.7.2.6 Status

Path to the object dictionary:

Path:					
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Status					
ns	BrowseName of the parameter	Description	Service page	R	W
4	Temperature0	Temperature of the CPU housing: See Temperature monitoring .	About & Info	+	
	USBFlashDrive0	Indicates whether a USB flash drive is connected to IF3.		+	
	USBFlashDrive1	Indicates whether a USB flash drive is connected to IF4.		+	

7.7.2.6.1 Temperature0

Temperature of the CPU housing: See [Temperature monitoring](#).

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:Temperature0	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Status/4:Temperature0	

Node attributes

NodeClass	Variable
DataType	Float
AccessLevel	CurrentRead
UserAccessLevel	CurrentRead

7.7.2.6.2 USBFlashDrive0

Indicates whether a USB flash drive is connected to IF3.

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:USBFlashDrive0	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Status/4:USBFlashDrive0	

Node attributes

NodeClass	Variable
DataType	BrUSBFlashDriveState (Enumeration)
AccessLevel	CurrentRead
UserAccessLevel	CurrentRead

Data type *BrUSBFlashDriveState* (enumeration)

Value	String
0	UNPLUGGED
1	PLUGGED

7.7.2.6.3 USBFlashDrive1

Indicates whether a USB flash drive is connected to IF4.

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:ParameterSet/4:USBFlashDrive1	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:Status/4:USBFlashDrive1	

Node attributes

NodeClass	Variable
DataType	BrUSBFlashDriveState (Enumeration)
AccessLevel	CurrentRead
UserAccessLevel	CurrentRead

Data type *BrUSBFlashDriveState* (enumeration)

Value	String
0	UNPLUGGED
1	PLUGGED

7.7.2.7 Identification

Path to the object dictionary:

Path:		
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:Identification		
ns	BrowseName of the information	Description
3	CompatibilityId	ID to indicate compatibility.
2	DeviceRevision	
2	HardwareRevision	
2	Manufacturer	
2	Model	Order number of the device, e.g. 6PPT50.101E-16B.
3	ProductCode	B&R ID code (see technical data of the device).
2	RevisionCounter	Value: -1 (reserved, not in use)
2	SerialNumber	Serial number of the device (see label on the back of the device).
2	SoftwareRevision	Software version of the PPT system: e.g. 1.2.0
3	VendorId	Vendor code, for customized models.

7.7.2.7.1 CompatibilityId

ID to indicate compatibility.

A future version of the device could be equipped with different technology. Although the module name and functionality of the device are identical to the previous version, the firmware may not be compatible, for example. In this case, the device reports a new *CompatibilityId*.

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:CompatibilityId	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:Identification/3:CompatibilityId	

Node attributes

NodeClass	Variable
DataType	UInt32
AccessLevel	CurrentRead
UserAccessLevel	CurrentRead

7.7.2.7.2 DeviceRevision

The value of *DeviceRevision* is identical to the value of *HardwareRevision*.

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:DeviceRevision	
Alternative path (function group):	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:Identification/2:DeviceRevision	

Node attributes

NodeClass	Variable
DataType	String
AccessLevel	CurrentRead
UserAccessLevel	CurrentRead

7.7.2.7.3 HardwareRevision

The value of *HardwareRevision* is identical to the value of *DeviceRevision*.

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:HardwareRevision
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:Identification/2:HardwareRevision

Node attributes

NodeClass	Variable
DataType	String
AccessLevel	CurrentRead
UserAccessLevel	CurrentRead

7.7.2.7.4 Manufacturer

Manufacturer of the device: B&R Industrial Automation GmbH

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:Manufacturer
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:Identification/2:Manufacturer

Node attributes

NodeClass	Variable
DataType	String
AccessLevel	CurrentRead
UserAccessLevel	CurrentRead

7.7.2.7.5 Model

Order number of the device, e.g. 6PPT50.101E-16B.

See also "[Model number key](#)" on page 13.

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:Model
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:Identification/2:Model

Node attributes

NodeClass	Variable
DataType	LocalizedText
AccessLevel	CurrentRead
UserAccessLevel	CurrentRead

7.7.2.7.6 ProductCode

B&R ID code (see technical data of the device).

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:ProductCode
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:Identification/3:ProductCode

Node attributes

NodeClass	Variable
DataType	UInt32
AccessLevel	CurrentRead
UserAccessLevel	CurrentRead

7.7.2.7.7 RevisionCounter

Value: -1 (reserved, not in use)

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:RevisionCounter
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:Identification/2:RevisionCounter

Node attributes

NodeClass	Variable
DataType	Int32
AccessLevel	CurrentRead
UserAccessLevel	CurrentRead

7.7.2.7.8 SerialNumber

Serial number of the device (see label on the back of the device).

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:SerialNumber
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:Identification/2:SerialNumber

Node attributes

NodeClass	Variable
DataType	String
AccessLevel	CurrentRead
UserAccessLevel	CurrentRead

7.7.2.7.9 SoftwareRevision

Software version of the PPT system: e.g. 1.2.0

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:SoftwareRevision
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:Identification/2:SoftwareRevision

Node attributes

NodeClass	Variable
DataType	String
AccessLevel	CurrentRead
UserAccessLevel	CurrentRead

7.7.2.7.10 VendorId

Vendor code, for customized models.

VendorId	Description
0	B&R
1	B&R
≥2	Customer ID

Path to the node (BrowsePath)

Path:
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/3:VendorId
Alternative path (function group):
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:Identification/3:VendorId

Node attributes

NodeClass	Variable
DataType	UInt32
AccessLevel	CurrentRead
UserAccessLevel	CurrentRead

7.7.2.8 Other device properties

The following device properties are not available within group *Identification*.

Path to the object dictionary:

Path:		
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50		
ns	BrowseName of the information	Description
2	DeviceManual	Link to the website: The user's manual is located in the Downloads section.

7.7.2.8.1 DeviceManual

Link to the website: The user's manual is available in the Downloads section.

Path to the node (BrowsePath)

Path:	
/0:Root/0:Objects/2:DeviceSet/4:PowerPanelT50/2:DeviceManual	

Device property *DeviceManual* is only available as a property of node `PowerPanelT50`.

Node attributes

NodeClass	Variable
DataType	String
AccessLevel	CurrentRead
UserAccessLevel	CurrentRead

8 Maintenance

8.1 Cleaning

Danger!

The Power Panel is only permitted to be cleaned while the device is switched off in order to prevent unintended functions from being triggered when handling the touch screen or pressing keys.

Power Panel devices should be cleaned with a moist cloth. Use only water with detergent, screen cleaner or alcohol (ethanol) to moisten the cloth. Apply the cleaning agent to the cloth first; do not spray it directly onto the Power Panel! Never use aggressive solvents, chemicals, abrasive cleaners, compressed air or steam cleaners.

Notice!

Cleaning the label on the back of the unit is only permitted with a dry cloth. This ensures readability of the thermal print during the service life of the device.

Information:

The display with the touch screen should be cleaned at regular intervals.

8.2 User tips for increasing the display's service life

Pixel errors

Information:

Displays can contain faulty pixels (pixel errors) due to the manufacturing process. They are not grounds for initiating a complaint or warranty claim.

8.2.1 Backlight

The service life of the backlight is specified by its "half-brightness time". An operating time of 50,000 hours would mean that the display brightness would still be 50% after this time.

8.2.1.1 Measures to maintain backlight service life

- The display brightness can be set to the lowest level that is comfortable for the user's eyes.
- Bright images should be avoided as far as possible.
- A 50% reduction in brightness can increase the half-brightness time by about 50%.

8.2.2 Screen burn-in

Image persistence refers to the "burning in" of a static image on a display after being displayed for a long time. It does not only occur with static images, however. Image persistence is also referred to in the technical literature as screen burn-in, image retention, memory effect, memory sticking or ghost image.

There are 2 different types:

- Area type: This type can be seen in a dark gray image. The effect disappears if the display is switched off for a long time.
- Line type: This can result in permanent damage.

What causes image persistence?

- Static images
- No screensaver
- Sharp transitions in contrast (e.g. black/white)
- High ambient temperatures
- Operation outside of specifications

How can image persistence be reduced?

- Switch continuously between static and dynamic images.
- Prevent excessive differences in brightness between foreground and background elements.
- Use colors with similar brightness.
- Use complementary colors for subsequent images.
- Use screensavers.

9 Accessories

9.1 Overview

Model number	Product ID	Page
Cage clamp terminal blocks for all Power Panel variants		
0TB6102.2110-01	Accessory terminal block, 2-pin (3.81), cage clamp terminal block 1.5 mm²	139
Screw clamp terminals		
0TB6102.2010-01	Accessory terminal block, 2-pin (3.81), screw clamp terminal block 1.5 mm²	139
USB accessories		
5MMUSB.2048-01	USB 2.0 flash drive, 2048 MB, B&R	142
5MMUSB.4096-01	USB 2.0 flash drive, 4096 MB, B&R	
Other accessories		
6ACCRPP2.0000-000	Installation kit for Power Panel T-Series variants: 8x retaining clips with torque limiting, 1x 2-pin cage clamp terminal block, 1x 2-pin screw clamp terminal block. See the accessories of the Power Panel variant in the corresponding data sheet or on the website.	140
6ACCRPP2.0001-000	Installation kit for Power Panel T-Series variants: 9x retaining clips with torque limiting, 1x 2-pin cage clamp terminal block, 1x 2-pin screw clamp terminal block. See the accessories of the Power Panel variant in the corresponding data sheet or on the website.	141

POWERLINK/Ethernet cables

Model number	POWERLINK/Ethernet cables ¹⁾²⁾	Page
POWERLINK/Ethernet cables, RJ45 to RJ45		
X20CA0E61.00020	POWERLINK/Ethernet connection cable, RJ45 to RJ45, 0.20 m	142
X20CA0E61.00025	POWERLINK/Ethernet connection cable, RJ45 to RJ45, 0.25 m	
X20CA0E61.00030	POWERLINK/Ethernet connection cable, RJ45 to RJ45, 0.30 m	
X20CA0E61.00035	POWERLINK/Ethernet connection cable, RJ45 to RJ45, 0.35 m	
X20CA0E61.00040	POWERLINK/Ethernet connection cable, RJ45 to RJ45, 0.40 m	
X20CA0E61.00050	POWERLINK/Ethernet connection cable, RJ45 to RJ45, 0.50 m	
X20CA0E61.00100	POWERLINK/Ethernet connection cable, RJ45 to RJ45, 1 m	
X20CA0E61.00150	POWERLINK/Ethernet connection cable, RJ45 to RJ45, 1.50 m	
X20CA0E61.00200	POWERLINK/Ethernet connection cable, RJ45 to RJ45, 2 m	
X20CA0E61.00300	POWERLINK/Ethernet connection cable, RJ45 to RJ45, 3 m	
X20CA0E61.00500	POWERLINK/Ethernet connection cable, RJ45 to RJ45, 5 m	
X20CA0E61.00800	POWERLINK/Ethernet connection cable, RJ45 to RJ45, 8 m	
X20CA0E61.01000	POWERLINK/Ethernet connection cable, RJ45 to RJ45, 10 m	
X20CA0E61.01200	POWERLINK/Ethernet connection cable, RJ45 to RJ45, 12 m	
X20CA0E61.01500	POWERLINK/Ethernet connection cable, RJ45 to RJ45, 15 m	
X20CA0E61.02000	POWERLINK/Ethernet connection cable, RJ45 to RJ45, 20 m	
X20CA0E61.03000	POWERLINK/Ethernet connection cable, RJ45 to RJ45, 30 m	
X20CA0E61.05000	POWERLINK/Ethernet connection cable, RJ45 to RJ45, 50 m	
X20CA0E61.06000	POWERLINK/Ethernet connection cable, RJ45 to RJ45, 60 m	
POWERLINK/Ethernet cables, RJ45 to RJ45, can be used in cable drag chains		
X20CA3E61.0100	POWERLINK/Ethernet connection cable, RJ45 to RJ45, can be used in cable drag chains, 10 m	142
X20CA3E61.0150	POWERLINK/Ethernet connection cable, RJ45 to RJ45, can be used in cable drag chains, 15 m	
X20CA3E61.0200	POWERLINK/Ethernet connection cable, RJ45 to RJ45, can be used in cable drag chains, 20 m	
POWERLINK/Ethernet cables, RJ45 to M12		
X67CA0E41.0010	POWERLINK/Ethernet attachment cable, RJ45 to M12, 1 m	142
X67CA0E41.0050	POWERLINK/Ethernet attachment cable, RJ45 to M12, 5 m	
X67CA0E41.0150	POWERLINK/Ethernet attachment cable, RJ45 to M12, 15 m	
X67CA0E41.0500	POWERLINK/Ethernet attachment cable, RJ45 to M12, 50 m	
POWERLINK/Ethernet cables, RJ45 to M12, can be used in cable drag chains		
X67CA3E41.0150	POWERLINK/Ethernet attachment cable, RJ45 to M12, can be used in cable drag chains, 15 m	142

1) POWERLINK cables from B&R can be used for Ethernet connections.

2) These cables are suitable for networks with transfer rates up to 100 Mbit/s and not for gigabit networks.

9.2 0TB6102 - 2-pin terminal block for power supply

This 1-row 2-pin terminal block is required for the power supply.

9.2.1 Order data


	
Order number	Short description
Terminal blocks	
0TB6102.2010-01	Accessory terminal block, 2-pin (3.81), screw clamp terminal block 1.5 mm ²
0TB6102.2110-01	Accessory terminal block, 2-pin (3.81), cage clamp terminal block 1.5 mm ²

Table 1: 0TB6102.2010-01, 0TB6102.2110-01 - Order data

9.2.2 Technical data

Information:

The following specified characteristic data, features and limit values are only valid for this accessory and may differ from those of the complete system. The data specified for the complete system applies to the complete system in which this accessory is installed, for example.

The technical data in this manual is current as of its creation/publication. Subject to change without notice.

Order number	0TB6102.2010-01	0TB6102.2110-01
Terminal block		
Number of pins	2 (female)	
Type of terminal block	Screw clamp terminal block variant	Cage clamp terminal block variant
Cable type	Only copper wires (no aluminum wires!)	
Pitch	3.81 mm	
Connection cross section		
AWG wire	28 to 16	
Wire end sleeves with plastic covering	0.25 to 0.5 mm ²	
With wire end sleeves	0.25 to 1.5 mm ²	
Flexible	0.14 to 1.5 mm ²	
Inflexible	0.14 to 1.5 mm ²	
Tightening torque	0.22 to 0.25 Nm	-
Electrical properties		
Nominal voltage	300 V	
Nominal current ¹⁾	8 A	

Table 2: 0TB6102.2010-01, 0TB6102.2110-01 - Technical data

1) The limit data for each Power Panel must be taken into account.

9.3 6ACCRPP2.0000-000

Installation kit for Power Panel T-Series

This installation kit contains the following replacement parts:

- 8 retaining clips with torque limiting
- 1x 2-pin cage clamp terminal block
- 1x 2-pin screw clamp terminal block

This installation kit is suitable for the following Power Panel devices:

- Power Panel T50 (5.0", 7.0" and 10.1")

9.3.1 Order data


Order number	Short description	Figure
	Other	
6ACCRPP2.0000-000	Installation kit for Power Panel T-Series variants: 8x retaining clips with torque limiting, 1x 2-pin cage clamp terminal block, 1x 2-pin screw clamp terminal block. See the accessories of the Power Panel variant in the corresponding data sheet or on the website.	

Table 3: 6ACCRPP2.0000-000 - Order data

9.3.2 Technical data

Order number	6ACCRPP2.0000-000
Short description	
Accessories	Installation kit for Power Panel T-Series: 8 retaining clips with torque limiting, 1x 2-pin cage clamp terminal block (0TB6102.2110-01), 1x 2-pin screw clamp terminal block (0TB6102.2010-01).
General information	
Note	Suitable for Power Panel T50 (5.0", 7.0" and 10.1").
Certifications	
CE	Yes

Table 4: 6ACCRPP2.0000-000 - Technical data

9.4 6ACCRPP2.0001-000

Installation kit for Power Panel T-Series

This installation kit contains the following replacement parts:

- 9 retaining clips with torque limiting
- 1x 2-pin cage clamp terminal block
- 1x 2-pin screw clamp terminal block

This installation kit is suitable for the following Power Panel devices:

- Power Panel T30
- Power Panel T50 (12.1" and 15.6")
- Power Panel T80

9.4.1 Order data


Order number	Short description	Figure
	Other	
6ACCRPP2.0001-000	Installation kit for Power Panel T-Series variants: 9x retaining clips with torque limiting, 1x 2-pin cage clamp terminal block, 1x 2-pin screw clamp terminal block. See the accessories of the Power Panel variant in the corresponding data sheet or on the website.	

Table 5: 6ACCRPP2.0001-000 - Order data

9.4.2 Technical data

Order number	6ACCRPP2.0001-000
Short description	
Accessories	Installation kit for Power Panel T-Series: 9 retaining clips with torque limiting, 1x 2-pin cage clamp terminal block (0TB6102.2110-01), 1x 2-pin screw clamp terminal block (0TB6102.2010-01).
General information	
Note	Suitable for Power Panel T30, T50 (12.1" and 15.6") and T80.
Certifications	
CE	Yes

Table 6: 6ACCRPP2.0001-000 - Technical data

9.5 Storage media

For technical data and additional information about storage media, see the corresponding documentation. This can be found under the purchase order number of the storage medium at www.br-automation.com and can be downloaded from there.

9.6 Cables

For technical data and additional information about the cable, see the corresponding documentation. This is located under the purchase order number of the cable on the B&R website (www.br-automation.com) and can be downloaded from there.

10 International and national certifications

Products and services from B&R comply with applicable regulations, directives and standards.

These are national, European and international regulations, mainly from organizations such as ISO, IEC and CEN-ELEC. We are committed to ensuring the reliability of our products in industrial environments.









Information:

Certifications applicable to the respective Power Panel are available at the following locations:

- B&R website (www.br-automation.com) > Product page > Technical data > General information > Certifications (The product page is found by searching for the order number.)
- User's manual: Chapter "Device description" > Technical data > General information > Certifications
- Product label on rear of housing

Changes and new certifications are available promptly in electronic form on the B&R website (www.br-automation.com).

10.1 Overview of certifications

Mark	Explanation	Certificate authority	Region
	CE marking	Notified bodies	Europe (EU)
	UK Conformity Assessed (UKCA)	Notified bodies	United Kingdom (UK)
	Underwriters Laboratories Inc. (UL) (certification for Canada and USA)	UL	Canada USA
	Det Norske Veritas (DNV)	DNV	Norway Germany
	Lloyd's Register (LR)	LR	Great Britain
	American Bureau of Shipping (ABS)	ABS	USA
	Bureau Veritas (BV)	BV	France
	Eurasian Conformity (EAC)	Federal agency on technical regulating and metrology	Eurasian Economic Union

10.2 EU directives and standards (CE)

CE marking



The respective product complies with all applicable EU directives and relevant harmonized standards.

Certification of these products is performed in cooperation with accredited testing laboratories.

EMC Directive 2014/30/EU

All products meet the requirements of the "Electromagnetic Compatibility" directive and are designed for typical industrial use.

Applicable standards from this directive:

EN 61131-2	Programmable controllers - Part 2: Equipment requirements and tests
EN 61000-6-2	Electromagnetic compatibility (EMC) - Part 6-2: Generic standards - Immunity standard for industrial environments
EN 61000-6-4	Electromagnetic compatibility (EMC) - Part 6-4: Generic standards - Emissions standard for industrial environments

For information about the versions of applicable standards, see the declaration of conformity. The declaration of conformity is available for download from the B&R website.



Declaration of conformity

Website > Downloads > Certificates > Declarations of conformity > Power Panel:
> [Declaration of conformity HMI_OI Power Panels](#)

UK Conformity Assessed (UKCA)



United Kingdom (UK)

All directives applicable to the respective product and their relevant standards are met.

Products with this marking are permitted to be imported into Great Britain (England, Wales, Scotland).

For information about the editions of applicable standards, see the "UK Declaration of Conformity". The "UK Declaration of Conformity" is available for download on the B&R website.



UK Declaration of Conformity

Website > Downloads > Certificates > Declarations of conformity > Power Panel:
> [UK Declaration HMI_OI Power Panels](#)

10.2.1 Overview of standards

Standard	Description
EN 55011 (CISPR 11)	Industrial, scientific and medical equipment - Radio frequency disturbance characteristics - Limits and methods of measurement
EN 55016-2-1 (CISPR 16-2-1)	Specification for radio disturbance and immunity measuring apparatus and methods - Part 2-1: Methods of measurement of disturbances and immunity - Conducted disturbance measurements
EN 55016-2-3 (CISPR 16-2-3)	Specification for radio disturbance and immunity measuring apparatus and methods - Part 2-3: Methods of measurement of disturbances and immunity - Radiated disturbance measurements
EN 55032 (CISPR 32)	Electromagnetic compatibility of multimedia equipment and devices - Emission requirements
EN 60068-2-6	Environmental testing - Part 2-6: Procedures - Test Fc: Vibration (sinusoidal)
EN 60068-2-27	Environmental testing - Part 2-27: Tests - Test Ea and guidance: Shock
EN 60068-2-31 ¹⁾	Environmental testing - Part 2-31: Tests - Test Ec: Rough handling shocks, primarily for equipment-type specimens
EN 60529	Degrees of protection provided by enclosures (IP code)
EN 60664-1	Insulation coordination for equipment within low-voltage systems - Part 1: Principles, requirements and tests
EN 60721-3-2	Classification of environmental conditions - Part 3: Classification of groups of environmental parameters and their severities - Section 2: Transport
EN 60721-3-3	Classification of environmental conditions - Part 3: Classification of groups of environmental parameters and their severities - Section 3: Stationary use at weather-protected locations
EN 61000-4-2	Electromagnetic compatibility (EMC) - Part 4-2: Testing and measurement techniques - Electrostatic discharge immunity test
EN 61000-4-3	Electromagnetic compatibility (EMC) - Part 4-3: Testing and measurement techniques - Radiated, radio-frequency, electromagnetic field immunity test
EN 61000-4-4	Electromagnetic compatibility (EMC) - Part 4-4: Testing and measurement techniques - Electrical fast transient/burst immunity test
EN 61000-4-5	Electromagnetic compatibility (EMC) - Part 4-5: Testing and measuring techniques - Surge immunity test
EN 61000-4-6	Electromagnetic compatibility (EMC) - Part 4-6: Testing and measurement techniques - Immunity to conducted disturbances, induced by radio-frequency fields
EN 61000-4-8	Electromagnetic compatibility (EMC) - Part 4-8: Testing and measuring techniques - Power frequency magnetic field immunity test
EN 61000-4-11	Electromagnetic compatibility (EMC) - Part 4-11: Testing and measurement techniques - Voltage dips, short interruptions and voltage variations immunity tests
EN 61000-4-29	Electromagnetic compatibility (EMC) - Part 4-29: Testing and measurement techniques - Voltage dips, short interruptions and voltage variations on DC input power port immunity tests
EN 61000-6-2	Electromagnetic compatibility (EMC) - Part 6-2: Generic standards - Immunity standard for industrial environments
EN 61000-6-4	Electromagnetic compatibility (EMC) - Part 6-4: Generic standards - Emission standard for industrial environments
EN 61131-2	Programmable logic controllers - Part 2: Equipment requirements and tests

1) Replacement for EN 60068-2-32

10.2.2 Requirements for immunity to disturbances

Test	Testing performed per standard:	Test values per standard:
Electrostatic discharge (ESD)	EN 61000-4-2	EN 61131-2: Product standard - Programmable controllers EN 61000-6-2: Generic standards - Immunity for industrial environments
Radiated high-frequency electromagnetic fields (RF radiated)	EN 61000-4-3	EN 61131-2: Product standard - Programmable controllers EN 61000-6-2: Generic standards - Immunity for industrial environments
High-speed transient electrical disturbances (Burst)	EN 61000-4-4	EN 61131-2: Product standard - Programmable controllers EN 61000-6-2: Generic standards - Immunity for industrial environments
Surge voltages (Surge)	EN 61000-4-5	EN 61131-2: Product standard - Programmable controllers EN 61000-6-2: Generic standards - Immunity for industrial environments
Conducted induced radio-frequency fields (RF-conducted)	EN 61000-4-6	EN 61131-2: Product standard - Programmable controllers EN 61000-6-2: Generic standards - Immunity for industrial environments
Power frequency magnetic fields (H field)	EN 61000-4-8	EN 61131-2: Product standard - Programmable controllers EN 61000-6-2: Generic standards - Immunity for industrial environments
Voltage dips (AC) Short-term interruptions (AC) Voltage fluctuations (AC)	EN 61000-4-11	EN 61131-2: Product standard - Programmable controllers EN 61000-6-2: Generic standards - Immunity for industrial environments
Short-term interruptions (DC) Voltage fluctuations (DC)	EN 61000-4-29	EN 61131-2: Product standard - Programmable controllers

Criteria to prove the performance of a PLC system against EMC disturbances

Criteria	During test	After test
A	The PLC system shall continue to operate as intended. No loss of function or performance.	The PLC system shall continue to operate as intended.
B	Degradation of performance accepted. The operating mode is not permitted to change. Irreversible loss of stored data is not permitted.	The PLC system shall continue to operate as intended. Temporary degradation of performance must be self-recoverable.
C	Loss of functions accepted, but no destruction of hardware or software (program or data).	The PLC system shall continue to operate as intended automatically, after manual restart or power off / power on.
D	Degradation or failure of functionality that can no longer be restored.	PLC system permanently damaged or destroyed.

Electrostatic discharge (ESD)

Testing performed per EN 61000-4-2	Test values per EN 61131-2 (Zone B)	Test values per EN 61000-6-2
Contact discharge (CD) On conductive accessible parts		±4 kV Criteria B
Air discharge (AD) On insulating accessible parts		±8 kV Criteria B

Radiated high-frequency electromagnetic fields (RF radiated)

Testing performed per EN 61000-4-3	Test values per EN 61131-2 (Zone B)	Test values per EN 61000-6-2
Housing, completely wired	80 MHz to 1 GHz, 10 V/m 1.4 to 2 GHz, 3 V/m 2 to 2.7 GHz, 1 V/m Criteria A	80 MHz to 1 GHz, 10 V/m 1.4 to 6 GHz, 3 V/m Criteria A

High-speed transient electrical disturbances (Burst)

Testing performed per EN 61000-4-4	Test values per EN 61131-2 (Zone B)	Test values per EN 61000-6-2
AC mains inputs >3 m	±2 kV / 5 kHz Criteria B	±2 kV / 5 kHz or 100 kHz Criteria B
AC mains outputs >3 m	±2 kV / 5 kHz Criteria B	±2 kV / 5 kHz or 100 kHz ¹⁾ Criteria B
Other AC inputs/outputs >3 m	±2 kV / 5 kHz Criteria B	-
DC mains inputs/outputs >3 m	±2 kV / 5 kHz Criteria B	±1 kV / 5 kHz or 100 kHz Criteria B
Other inputs/outputs and interfaces >3 m	±1 kV / 5 kHz Criteria B	±1 kV / 5 kHz or 100 kHz Criteria B

1) Without length limitation.

Surge voltages (Surge)

Testing performed per EN 61000-4-5	Test values per EN 61131-2 (Zone B)	Test values per EN 61000-6-2
AC mains inputs/outputs (line to line)	±1 kV Criteria B	±1 kV Criteria B
AC mains inputs/outputs (line to PE)	±2 kV Criteria B	±2 kV Criteria B
DC mains inputs/outputs >30 m (line to line)	±0.5 kV Criteria B	±0.5 kV ¹⁾ Criteria B
DC mains inputs/outputs >30 m (line to PE)	±0.5 kV Criteria B	±1 kV ¹⁾ Criteria B
Unshielded signal connections >30 m (line to PE)	±1 kV Criteria B	±1 kV Criteria B
All shielded lines >30 m (line to PE)	±1 kV Criteria B	-

1) Without length limitation.

Conducted induced radio-frequency fields (RF-conducted)

Testing performed per EN 61000-4-6	Test values per EN 61131-2 (Zone B)	Test values per EN 61000-6-2
AC mains inputs/outputs	10 V 150 kHz to 80 MHz 80% AM (1 kHz) Criteria A	
DC mains inputs/outputs	10 V 150 kHz to 80 MHz 80% AM (1 kHz) Criteria A	
Other inputs/outputs and interfaces	10 V ¹⁾ 150 kHz to 80 MHz 80% AM (1 kHz) Criteria A	

1) Only for connections with a permitted cable length greater than 3 m.

Power frequency magnetic fields (H field)

Testing performed per EN 61000-4-8	Test values per EN 61131-2 (Zone B)	Test values per EN 61000-6-2
Housing, completely wired	30 A/m 3 axes (x, y, z) 50/60 Hz ¹⁾ Criteria A	

1) Mains frequency per manufacturer data

Voltage dips

Testing performed per EN 61000-4-11	Test values per EN 61131-2 (Zone B)	Test values per EN 61000-6-2
AC power inputs	0% residual voltage 250/300 periods (50/60 Hz) ¹⁾ 20 attempts Criteria C	
	40% residual voltage 10/12 periods (50/60 Hz) ¹⁾ 20 attempts Criteria C	
	70% residual voltage 25/30 periods (50/60 Hz) ¹⁾ 20 attempts Criteria C	

1) Mains frequency per manufacturer data

Short-term interruptions

Testing performed per EN 61000-4-11 / EN 61000-4-29	Test values per EN 61131-2 (Zone B)	Test values per EN 61000-6-2
AC power inputs	0% residual voltage 0.5 periods (50/60 Hz) ¹⁾ 20 attempts Criteria A	0% residual voltage 1 period (50/60 Hz) ¹⁾ 3 attempts Criteria B
DC power inputs	0% residual voltage ≥10 ms (PS2) ²⁾ 20 attempts Criteria A	-

1) Mains frequency per manufacturer data

2) Use of a B&R power supply guarantees that these requirements are met.

Voltage fluctuations

Testing performed per EN 61000-4-11 / EN 61000-4-29	Test values per EN 61131-2 (Zone B)	Test values per EN 61000-6-2
AC power inputs	-15% / +10% Test duration per 30 minutes Criteria A	-
DC power inputs	-15% / +20% Test duration per 30 minutes Criteria A	-

10.2.3 Emission requirements

Test	Testing performed per standard:	Limit values per standard
Emissions related to lines	EN 55011 / EN 55032 EN 55016-2-1	EN 61131-2: Product standard - Programmable controllers EN 61000-6-4: Generic standards - Emission standard for industrial environments
Radiated emissions	EN 55011 / EN 55032 EN 55016-2-3	EN 61131-2: Product standard - Programmable controllers EN 61000-6-4: Generic standards - Emission standard for industrial environments

Emissions related to lines

Testing performed per EN 55011 / EN 55032 / EN 55016-2-1	Limit values per EN 61131-2 (Zone B)	Limit values per EN 61000-6-4
AC mains connection 150 kHz to 30 MHz	150 to 500 kHz 79 dB (μV) quasi-peak value 66 dB (μV) average value	
	500 kHz to 30 MHz 73 dB (μV) quasi-peak value 60 dB (μV) average value	
Telecommunications / network connection 150 kHz to 30 MHz	-	150 to 500 kHz 97 to 87 dB (μV) quasi-peak value 53 to 40 dB (μA) quasi-peak value 84 to 74 dB (μV) average value 40 to 30 dB (μA) average value
	-	500 kHz to 30 MHz 87 dB (μV) quasi-peak value 43 dB (μA) quasi-peak value 74 dB (μV) average value 30 dB (μA) average value

Radiated emissions

Testing performed per EN 55011 / EN 55032 / EN 55016-2-3	Limit values per EN 61131-2 (Zone B)	Limit values per EN 61000-6-4
Electric field / Measured from 10 m 30 MHz to 1 GHz	30 to 230 MHz 40 dB (μV/m) quasi-peak value	
	230 MHz to 1 GHz 47 dB (μV/m) quasi-peak value	
Electric field / Measured from 3 m 1 to 6 GHz ¹⁾	-	1 to 3 GHz 76 dB (μV/m) peak value 56 dB (μV/m) average value
	-	3 to 6 GHz 80 dB (μV/m) peak value 60 dB (μV/m) average value

1) Depends on the highest internal frequency

10.2.4 Mechanical conditions

Testing	Testing performed per standard:	Test values per standard:
Sinusoidal vibration / Operation	EN 60068-2-6	EN 61131-2: Product standard - Programmable controllers EN 60721-3-3 / Class 3M4
Shock / Operation	EN 60068-2-27	EN 61131-2: Product standard - Programmable controllers EN 60721-3-3 / Class 3M4
Sinusoidal vibration / Transport (packaged)	EN 60068-2-6	EN 60721-3-2 / Class 2M1 EN 60721-3-2 / Class 2M2 EN 60721-3-2 / Class 2M3
Shock / Transport (packaged)	EN 60068-2-27	EN 60721-3-2 / Class 2M1 EN 60721-3-2 / Class 2M2
Free fall / Transport (packaged)	EN 60068-2-31 ¹⁾	EN 61131-2: Product standard - Programmable controllers EN 60721-3-2 / Class 2M1
Toppling / Transport (packaged)	EN 60068-2-31	EN 60721-3-2 / Class 2M1 EN 60721-3-2 / Class 2M2 EN 60721-3-2 / Class 2M3

1) Replacement for EN 60068-2-32

Sinusoidal vibration / Operation

Testing performed per EN 60068-2-6	Test values per EN 61131-2		Test values per EN 60721-3-3 / Class 3M4	
Vibration (sinusoidal) ¹⁾ Operation	Frequency	Amplitude	Frequency	Amplitude
	5 to 8.4 Hz	Deflection 3.5 mm	2 to 9 Hz	Deflection 3 mm
	8.4 to 150 Hz	Acceleration 1 g ²⁾	9 to 200 Hz	Acceleration 1 g ²⁾
	20 sweeps for each axis ³⁾			

1) Uninterrupted duty with movable frequency in all 3 axes (x, y, z); 1 octave per minute

2) 1 g = 10 m/s²

3) 2 sweeps = 1 frequency cycle ($f_{\min} \rightarrow f_{\max} \rightarrow f_{\min}$)

Shock / Operation

Testing performed per EN 60068-2-27	Test values per EN 61131-2	Test values per EN 60721-3-3 / Class 3M4
Shock ¹⁾ Operation	Acceleration 15 g Duration 11 ms 18 shocks	Acceleration 10 g Duration 11 ms 18 shocks

1) Pulse (half-sine) stress in all 3 axes (x, y, z), 1 octave per minute

Sinusoidal vibration / Transport (packaged)

Testing performed per EN 60068-2-6	Test values per EN 60721-3-2 / Class 2M1		Test values per EN 60721-3-2 / Class 2M2		Test values per EN 60721-3-2 / Class 2M3	
Vibration (sinusoidal) ¹⁾ Transport (packaged)	Frequency	Amplitude	Frequency	Amplitude	Frequency	Amplitude
	2 to 9 Hz	Deflection 3.5 mm	2 to 9 Hz	Deflection 3.5 mm	2 to 8 Hz	Deflection 7.5 mm
	9 to 200 Hz	Acceleration 1 g ²⁾	9 to 200 Hz	Acceleration 1 g ²⁾	8 to 200 Hz	Acceleration 2 g ²⁾
	200 to 500 Hz	Acceleration 1.5 g ²⁾	200 to 500 Hz	Acceleration 1.5 g ²⁾	200 to 500 Hz	Acceleration 4 g ²⁾
	20 sweeps for each axis ³⁾					

1) Uninterrupted duty with movable frequency in all 3 axes (x, y, z); 1 octave per minute

2) 1 g = 10 m/s²

3) 2 sweeps = 1 frequency cycle ($f_{\min} \rightarrow f_{\max} \rightarrow f_{\min}$)

Shock / Transport (packaged)

Testing performed per EN 60068-2-27	Test values per EN 60721-3-2 / Class 2M1	Test values per EN 60721-3-2 / Class 2M2
Shock ¹⁾ Transport (packaged)	Type I Acceleration 10 g Duration 11 ms 18 shocks	
	Type II -	Type II Acceleration 30 g Duration 6 ms 18 shocks

1) Pulse (half-sine) stress in all 3 axes (x, y, z)

Free fall / Transport (packaged)

Testing performed per EN 60068-2-31 ¹⁾	Test values per EN 61131-2 with shipping packaging		Test values per EN 61131-2 with product packaging		Test values per EN 60721-3-2 / Class 2M1	
	Weight	Height	Weight	Height	Weight	Height
Free fall Transport (packaged)	<10 kg	1.0 m	<10 kg	0.3 m	<20 kg	0.25 m
	10 to 40 kg	0.5 m	10 to 40 kg	0.3 m	20 to 100 kg	0.25 m
	>40 kg	0.25 m	>40 kg	0.25 m	>100 kg	0.1 m
5 attempts						

1) Replacement for EN 60068-2-32

Toppling / Transport (packaged)

Testing performed per EN 60068-2-31	Test values per EN 60721-3-2 / Class 2M1		Test values per EN 60721-3-2 / Class 2M2		Test values per EN 60721-3-2 / Class 2M3	
	Weight	Required	Weight	Required	Weight	Required
Toppling Transport (packaged)	<20 kg	Yes	<20 kg	Yes	<20 kg	Yes
	20 to 100 kg	-	20 to 100 kg	Yes	20 to 100 kg	Yes
	>100 kg	-	>100 kg	-	>100 kg	Yes
		Topple on all edges			Topple on all edges	Topple on all edges

10.2.5 Electrical safety**Overvoltage category**

Requirement per EN 61131-2	Definition per EN 60664-1
Overvoltage category II	Equipment of "overvoltage category II" is energy-consuming equipment to be supplied from the fixed installation.

Pollution degree

Requirement per EN 61131-2	Definition per EN 60664-1
Pollution degree 2	Only non-conductive pollution occurs. Temporary conductivity caused by condensation must occasionally be expected, however.

Protection rating provided by enclosure (IP code)

Requirement per EN 61131-2	Definition per EN 60529	Explanation for the protection of equipment	Explanation for the protection of personnel
≥IP20	First number IP2x	Protected against solid foreign bodies with a diameter ≥12.5 mm.	Protected against touching dangerous parts with fingers.
	Second number IPx0	Not protected.	-
Requirement per manufacturer	Definition per EN 60529	Explanation for the protection of equipment	Explanation for the protection of personnel
Front: IP65	First number IP6x	Dust-proof.	Protected against touching dangerous parts with conductor.
	Second number IP x5	Protection against water jets.	-

10.3 Underwriters Laboratories (UL)

UL mark



Products with this mark are tested by Underwriters Laboratories and listed as "industrial control equipment" in category NRAQ (programmable controllers) with file number E115267.

The mark is valid for the USA and Canada and facilitates the certification of your machines and systems in this economic area.

Standards applied:

UL 61010-1	Safety requirements for electrical equipment for measurement, control and laboratory use - Part 1: General requirements
UL 61010-2-201	Standard for safety requirements for electrical equipment for measurement, control and laboratory use - Part 2-201: Particular requirements for control equipment
CSA C22.2 No. 61010-1	Safety requirements for electrical equipment for measurement, control and laboratory use - Part 1: General requirements
CSA C22.2 No. 61010-2-201	Safety requirements for electrical equipment for measurement, control and laboratory use - Part 2-201: Particular requirements for control equipment

For information about the versions of applicable standards, see the certificate. The certificate is available for download from the B&R website.



Certificate

Home > Downloads > Certificates > UL > Power Panel:
> [E115267 UL CoC Power Panel C30, C50, T50 Series](#)

10.4 Offshore/Maritime

DNV is the world's most well-known ship classification society, which is why selected B&R products undergo type approval at DNV before certification with other maritime classes. DNV tests are performed in accordance with the applicable DNV, IACS E10 and IEC 60945 standards. The tests are therefore compliant with the requirements of other ship classification societies.

Information:

For applied standards, conditions of use and environmental conditions of the different classification societies, see the respective certificates.

Det Norske Veritas (DNV)



Selected B&R products are certified by DNV and suitable for use in maritime environments.

DNV maritime certificates (type approval) are generally accepted by other classification societies during ship acceptance procedures.

For corresponding environmental categories, see the technical data for the respective product.



Certificate

Home > Downloads > Certificates > Maritime > DNV > Power Panel T-Series:
> [DNV type approval certificate - Power Panel T-Series](#)

Lloyd's Register (LR)



Products are suitable for use in maritime environments in accordance with the guidelines set forth by the Lloyd's Register classification society.



Certificate

Home > Downloads > Certificates > Maritime > LR > X20 / Power Panel T-Series:
> [Lloyd's Register](#)

American Bureau of Shipping (ABS)



Products are suitable for use in the maritime sector in accordance with ABS regulations (ABS rules).



Certificate

Home > Downloads > Certificates > Maritime > ABS > Power Panels T30/T50:
> [ABS Certificate of Product Design Assessment](#)

Bureau Veritas (BV)



Products are suitable for use in maritime environments in accordance with the guidelines set forth by the Bureau Veritas classification society.



Certificate

Home > Downloads > Certificates > Maritime > BV > Power Panel T-Series:
> [BV type approval certificate - Power Panel T-Series](#)

10.5 Additional certifications

Eurasian Conformity (EAC)



Products with this mark are tested by an accredited test laboratory and permitted to be imported into the newly established Eurasian Customs Union (based on EU conformity).



Certificate

Home > Downloads > Certificates > EAC > Power Panel:
> [EAC declaration of conformity PowerPanel](#)

11 Environmentally friendly disposal

All programmable logic controllers, operating and monitoring devices and uninterruptible power supplies from B&R are designed to have as little impact on the environment as possible.

11.1 Separation of materials

To ensure that devices can be recycled in an environmentally friendly manner, it is necessary to separate out the different materials.

Component	Disposal
Programmable logic controllers Operating and monitoring devices Uninterruptible power supplies Batteries and rechargeable batteries Cables	Electronics recycling
Paper/Cardboard packaging	Paper/Cardboard recycling
Plastic packaging material	Plastic recycling

Disposal must be carried out in accordance with applicable legal regulations.